

# **ANSI/ASHRAE/IES Standard 90.1-2019 Performance Rating Method Reference Manual**

December 2023

S Goel  
M Rosenberg  
E Mets  
C Eley

## DISCLAIMER

This report was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States Government nor any agency thereof, nor Battelle Memorial Institute, nor any of their employees, makes **any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights.** Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof, or Battelle Memorial Institute. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof.

PACIFIC NORTHWEST NATIONAL LABORATORY  
*operated by*  
BATTELLE  
*for the*  
UNITED STATES DEPARTMENT OF ENERGY  
*under Contract DE-AC05-76RL01830*

Printed in the United States of America

Available to DOE and DOE contractors from the  
Office of Scientific and Technical Information,  
P.O. Box 62, Oak Ridge, TN 37831-0062;  
ph: (865) 576-8401  
fax: (865) 576-5728  
email: [reports@adonis.osti.gov](mailto:reports@adonis.osti.gov)

Available to the public from the National Technical Information Service  
5301 Shawnee Rd., Alexandria, VA 22312  
ph: (800) 553-NTIS (6847)  
email: [orders@ntis.gov](mailto:orders@ntis.gov) <<https://www.ntis.gov/about>>  
Online ordering: <http://www.ntis.gov>

# **ANSI/ASHRAE/IES Standard 90.1-2019 Performance Rating Method Reference Manual**

December 2023

S Goel  
M Rosenberg  
E Mets  
C Eley

Prepared for  
the U.S. Department of Energy  
under Contract DE-AC05-76RL01830

Pacific Northwest National Laboratory  
Richland, Washington 99354

## Acknowledgements

This document was prepared by Pacific Northwest National Laboratory (PNNL) for the U.S. Department of Energy's (DOE's) Building Energy Codes Program. The authors would like to thank the following organizations and individuals:

- Commercial Energy Services Network (COMNET) team for developing the framework for this document through the Standard 90.1-2019 Commercial Building Energy Modeling Guidelines and Procedures.
- California Energy Commission (CEC) for providing guidance through the Nonresidential Alternative Calculation Method (NACM) Reference Manual. The Reference Manual has been built off work originally done by COMNET for the Standard 90.1-2019 Commercial Building Energy Modeling Guidelines and Procedures and by CEC for the NACM Reference Manual.
- American Society of Heating, Refrigerating, and Air-Conditioning Engineers (ASHRAE) 90.1 Standing Standard Project Committee (SSPC) for their insight.
- The external peer review team and advisors:
  - Maria Karpman, Karpman Consulting
  - Matt Swenka, Willdan
  - Andrew Parker, National Renewable Energy Laboratory
  - Sagar Rao, Affiliated Engineers
  - Caitlin Bohnert, Trane Technologies
  - Emily Hoffman, NYC Department of Buildings
  - Greg Schluterman, HFA-AE
  - Gail Hampsmire, Green Building Certification Institute
- Matt Wilburn and Mark Halverson at PNNL for editorial and technical reviews.
- Jeremiah Williams, Chris Perryat DOE
- Michael Tillou, Doug Maddox, David Winiarski at PNNL

## Acronyms and Abbreviations

ACH	air changes per hour
AFUE	annual fuel utilization efficiency
AHRI	Air-Conditioning, Heating and Refrigeration Institute
AHU	air handling unit
ANSI	American National Standards Institute
ARI	Air-conditioning, Heating and Refrigeration Institute
ASHRAE	American Society of Heating, Refrigerating and Air-Conditioning Engineers
ASTM	American Society for Testing Materials
BDL	building design language
C-factor	thermal conductance
CCF	centum cubic feet
CEC	California Energy Commission
CRRC	Cool Roof Rating Council
CFA	conditioned floor area
cfm	cubic feet per minute
CHP	combined heat and power
CHW	chilled water
COMNET	Commercial Energy Services Network
COP	coefficient of performance
DCV	demand controlled ventilation
DDC	direct digital control
DOAS	dedicated outdoor air system
DV	displacement ventilation
DOE	U.S. Department of Energy
DX	direct expansion
EA	effective aperture
$E_c$	combustion efficiency
EF	energy factor
EER	energy efficiency ratio
EFLH	equivalent full load hours
EIA	Energy Information Administration
EILP	exterior installed lighting power
EIR	energy input ratio
ELAP	exterior lighting power allowance
ERV	energy recovery ventilator
$E_t$	thermal efficiency

F-factor	heat transfer coefficient of a slab edge unit of perimeter length
FPLR	function of part load ratio
FT	function of temperature
HSPF	heating seasonal performance factor
HVAC	heating, ventilation, and air conditioning
HW	hot water
IES	Illuminating Engineering Society
ILPA	interior lighting power allowance
kBtu/hr	thousand British thermal units per hour
LPD	lighting power density
MBH	thousand British thermal units per hour
MCF	thousand cubic feet
MBtu	thousand British thermal units
MJ	megajoule
MMBtu	million British thermal units
NACM	Non-residential Alternate Calculation Method
NAECA	National Appliance Energy Conservation Act
NFRC	National Fenestration Rating Council
OA	outdoor air
OAT	outdoor air temperature
PAF	power adjustment factor
PCI	performance cost index
PFP	parallel fan powered
PIU	powered induction unit
PLF	part-load fraction
PNNL	Pacific Northwest National Laboratory
PSZ-AC	packaged single zone air conditioner
PTAC	packaged terminal air conditioner
PTHP	packaged terminal heat pump
PRM	Performance Rating Method
PVAV	packaged variable air volume
RCR	room cavity ratio
RDP	relative daylight potential
SAT	supply air temperature
SEER	seasonal energy efficiency ratio
SHGC	solar heat gain coefficient
SO	source orientation
SRR	skylight roof ratio

SSPC	Standing Standard Project Committee
TOU	time of use
U-factor	thermal transmittance
UFAD	underfloor air distribution system
UMLH	unmet load hours
VAV	variable air volume
VRP	ventilation rate procedure
VT	visible light transmittance
W	watt
w.c.	water column
WSHP	water source heat pump
WWR	window-to-wall ratio

# Contents

Acknowledgements..... ii

Acronyms and Abbreviations .....iii

1.0 Overview..... 1

    1.1 Purpose ..... 1

    1.2 Applications of the PRM-RM..... 1

    1.3 Standard 90.1-2019 Performance Rating Method Compliance Calculations ..... 1

    1.4 Organization..... 4

    1.5 Type of Project Submittal ..... 5

2.0 General Modeling Procedures and Requirements..... 6

    2.1 Simulation General Requirements ..... 6

        2.1.1 Simulation Program..... 6

    2.2 General Requirements for Data from the User ..... 6

        2.2.1 General ..... 6

        2.2.2 Definition of Building Descriptors ..... 6

        2.2.3 Treatment of Descriptors Not Fully Addressed by this Document ..... 7

        2.2.4 Energy Components ..... 7

        2.2.5 Regulated and Unregulated Energy Use..... 8

    2.3 Thermal Blocks, HVAC Zones, and Space Functions..... 9

        2.3.1 Definitions ..... 9

    2.4 Modeling Requirements for Zones ..... 11

        2.4.1 Required Zone Modeling Capabilities..... 11

        2.4.2 Modeling Requirements for Unconditioned Spaces ..... 11

        2.4.3 Modeling Requirements for Parking Garages, Attics, and Crawlspace ..... 12

        2.4.4 Modeling Requirements for Semi-Heated Spaces ..... 13

        2.4.5 Space Use Classification ..... 13

    2.5 Unmet Load Hours..... 13

    2.6 Calculation Procedures ..... 14

    2.7 HVAC Capacity Requirements and Sizing..... 16

        2.7.1 Specifying HVAC Capacities for the Proposed Design ..... 16

        2.7.2 Sizing Equipment in the Baseline Building..... 17

        2.7.3 Proposed Design with No HVAC, Lighting, SHW System or Receptacle Loads..... 18

        2.7.4 Existing Systems ..... 19

3.0 Building Descriptors Reference..... 21

    3.1 Overview..... 21

        3.1.1 HVAC System Map..... 21

        3.1.2 Organization of Information..... 32



3.2 Project Data..... 32

    3.2.1 General Information ..... 32

    3.2.2 Building Model Classification..... 34

    3.2.3 Geographic and Climate Data..... 36

    3.2.4 Site Characteristics ..... 39

    3.2.5 Calendar..... 40

    3.2.6 Simulation Control ..... 41

3.3 HVAC Zones ..... 41

    3.3.1 General Information ..... 42

    3.3.2 Interior Lighting ..... 46

    3.3.3 Receptacle and Process Loads ..... 46

    3.3.4 Occupants ..... 46

    3.3.5 Infiltration..... 47

    3.3.6 Natural Ventilation ..... 50

    3.3.7 Thermal Mass ..... 53

3.4 Space Uses ..... 54

    3.4.1 General Information ..... 55

    3.4.2 Occupants ..... 56

    3.4.3 Interior Lighting ..... 57

    3.4.4 Daylighting Control..... 64

    3.4.5 Receptacle and Process Loads ..... 72

    3.4.6 Commercial Refrigeration Equipment..... 77

    3.4.7 Elevators, Escalators, and Moving Walkways ..... 84

    3.4.8 Gas Process Equipment ..... 87

3.5 Building Envelope Data..... 89

    3.5.1 Building Orientation ..... 90

    3.5.2 Materials..... 90

    3.5.3 Construction Assemblies ..... 91

    3.5.4 Roofs..... 93

    3.5.5 Exterior Wall ..... 96

    3.5.6 Exterior Floors..... 100

    3.5.7 Doors ..... 103

    3.5.8 Fenestration ..... 104

    3.5.9 Below-Grade Walls ..... 111

    3.5.10 Slab Floors in Contact with Ground..... 112

    3.5.11 Heat Transfer between Thermal Zones..... 114

3.6 HVAC Zone Level Systems..... 115

    3.6.1 Zone Temperature Control ..... 115

    3.6.2 Terminal Device Data..... 116

3.6.3	Terminal Heating.....	117
3.6.4	Baseboard Heat.....	118
3.6.5	Zone Level Airflow .....	119
3.7	HVAC Secondary Systems.....	134
3.7.1	Basic System Information .....	142
3.7.2	System Controls.....	145
3.7.3	Fan Systems.....	152
3.7.4	Outdoor Air Controls and Economizers .....	168
3.7.5	Cooling Systems.....	172
3.7.6	Heating Systems .....	194
3.7.7	Humidity Controls and Devices .....	207
3.8	HVAC Primary Systems.....	211
3.8.1	Boilers.....	212
3.8.2	Chillers .....	218
3.8.3	Cooling Towers .....	228
3.8.4	Fluid Economizers.....	235
3.8.5	Pumps .....	238
3.8.6	Thermal Storage .....	245
3.8.7	Heat Recovery Equipment.....	248
3.8.8	Plant Management .....	250
3.9	Miscellaneous Energy Uses .....	251
3.9.1	Water Heating.....	251
3.9.2	Exterior Lighting .....	263
3.9.3	Other Electricity Use .....	267
3.9.4	Other Gas Use.....	268
3.9.5	Swimming Pools.....	269
3.9.6	Transformers.....	271
3.10	On-Site Power Generation .....	272
3.10.1	Photovoltaic Systems.....	272
3.10.2	Wind Systems .....	277
3.10.3	Combined Heat and Power Cogeneration Systems .....	279
3.11	Common Data Structures.....	283
3.11.1	Schedule .....	283
3.11.2	Holidays.....	284
3.11.3	Surface Geometry .....	284
3.11.4	Opening Geometry .....	284
3.11.5	Shading Devices .....	284
3.11.6	Construction Assembly.....	284
3.11.7	Fenestration Construction.....	284

3.11.8	Material.....	284
3.11.9	Slab Construction .....	285
3.11.10	Occupant Heat Rate .....	285
3.11.11	Furniture and Contents .....	285
3.11.12	Reference Position in a Space .....	285
3.11.13	Two Dimensional Curve.....	285
3.11.14	Three-Dimensional Curve .....	285
4.0	Energy Price Data .....	286
4.1	State Average Energy Costs.....	286
4.2	Custom Energy Costs.....	287
4.2.1	Utility Costs: Tariffs.....	287
4.2.2	Utility Costs: Charges.....	290
4.2.3	Utility Costs: Ratchets .....	294
5.0	Reporting .....	297
6.0	References.....	299

## Figures

Figure 1. Information Flow .....	7
Figure 2. Hierarchy of Space, HVAC Zones, and Thermal Block .....	10
Figure 3. Calculation Process for Standard 90.1-2019 Performance Cost Index Using Performance Rating Method .....	15
Figure 4. Example Stepped Daylight Control .....	71
Figure 5. Example Dimming Daylight Control .....	71
Figure 6. Single Maximum VAV Box Control ( <i>Courtesy: Taylor Engineering</i> ) .....	120
Figure 7. Dual Maximum Control Sequence .....	121
Figure 8. Single Maximum Control Sequence for Parallel Fan Powered VAV with Reheat Boxes .....	123
Figure 9. SAT Cooling Setpoint Reset based on Outdoor Air Temperature (OAT).....	149
Figure 10. Example of SAT Heating Setpoint Reset based on Outdoor Air Temperature. ....	151
Figure 11. Chilled Water Supply Temperature Reset Schedule.....	227

## Tables

Table 1. Building Performance Factors (BPF).....	4
Table 2. Organization of the PRM-RM .....	4
Table 3. HVAC System Map .....	22
Table 4. HVAC System Descriptions .....	23
Table 5. Example 1 Calculations .....	25
Table 6. Example 2 Calculations .....	26
Table 7. Example 3 Calculations .....	27
Table 8. Baseline Requirements for Purchased Heat and Purchased Chilled Water Systems .....	31
Table 9. Building Area Types for Standard 90.1-2019 .....	35
Table 10. Acceptable Timesteps for Demand Window Values .....	41
Table 11. Standard 90.1-2019 Heated Space Criteria .....	43
Table 12. Heated Space Criteria for the Baseline Building .....	44
Table 13. Retail Display Lighting Allowance .....	59
Table 14. Light Heat Gain Parameters for Typical Operating Conditions (Based on Table 3, Chapter 18, 2009 ASHRAE Handbook – Fundamentals).....	63
Table 15. Performance Rating Method for Commercial Refrigerators and Freezers .....	77
Table 16. Performance Rating Method for Commercial Casework.....	78
Table 17. Default Power for Walk-In Refrigerators and Freezers (W/ft <sup>2</sup> ).....	80
Table 18. Baseline Elevator Motor .....	85
Table 19. Motor Efficiency Requirements for Hydraulic Motors.....	85
Table 20. Motor Efficiency Requirements for Traction Motors .....	86
Table 21. Standard 90.1-2019 Requirements for Baseline Roof Insulation for each Space Conditioning Category.....	94
Table 22. Standard 90.1-2019 Baseline Building Roof Construction Assemblies .....	95
Table 23. Standard 90.1-2019 Requirements for Baseline Wall Construction for Non-Residential Space Conditioning Categories.....	98
Table 24. Baseline Building Wall Construction Assemblies .....	99
Table 25. Standard 90.1-2019 Requirements for Baseline Steel Joist Floors for Non-Residential Space Conditioning Categories.....	101
Table 26. Baseline Building Exterior Floor Construction Assemblies .....	102
Table 27. Standard 90.1-2019 Requirements for Doors for Baseline Building .....	104
Table 28. Baseline Building Vertical Fenestration Area .....	105
Table 29. U-factor Requirement for Vertical and Horizontal Fenestration .....	107
Table 30. SHGC Requirement for Vertical Fenestration .....	107
Table 31. SHGC Requirement for Horizontal Fenestration.....	107
Table 32. VT Requirement for Vertical Fenestration .....	108
Table 33. VT Requirement for Horizontal Fenestration .....	108

Table 34. Standard 90.1-2019 Requirements for Baseline Wall Construction for Non-Residential Space Conditioning Categories..... 112

Table 35. Baseline Building Below-Grade Wall Construction Assemblies..... 112

Table 36. Baseline Building Slab on Grade Envelope Requirements..... 114

Table 37. Baseline Building HVAC Terminal Devices ..... 116

Table 38. Baseline Building Terminal Heat Type ..... 117

Table 39. Maximum Net Exhaust Flow Rate, cfm per Linear Foot of Hood Length ..... 125

Table 40. Air Distribution Effectiveness (ASHRAE Standard 62.1-2010) ..... 130

Table 41. System 1 and System 2 Descriptions ..... 134

Table 42. System 3 and System 4 Descriptions ..... 134

Table 43. System 5 Description ..... 135

Table 44. System 6 Description ..... 136

Table 45. System 7 Description ..... 137

Table 46. System 8 Description ..... 138

Table 47. System 9 and System 10 Description..... 139

Table 48. System 11 Description ..... 140

Table 49. System 12 and 13 Description ..... 141

Table 50. Summary of Baseline Building Secondary HVAC System Properties ..... 142

Table 51. Baseline Building System Type..... 143

Table 52. Building Descriptor Applicability for Fan Systems..... 153

Table 53. Baseline Fan System Details for Fan System Power ..... 154

Table 54. Baseline Building: Fan Power Limitation Pressure Drop Adjustment ..... 155

Table 55. Baseline Building Fan Control Method ..... 158

Table 56. Minimum Nominal Efficiency for Electric Motors (%) ..... 160

Table 57. Fan Curve Default Values..... 161

Table 58. Cooling Source for Baseline Building System ..... 172

Table 59. Cooling Capacity Curve Coefficients ..... 175

Table 60. Default Coil Bypass Factors ..... 176

Table 61. Coil Bypass Factor Airflow Adjustment Factor ..... 177

Table 62. Coil Bypass Factor Temperature Adjustment Factor..... 177

Table 63. Coil Bypass Factor Part Load Adjustment Factor ..... 177

Table 64. Efficiency Requirements For Baseline Systems with PTAC and PTHPs (efficiency ratings excluding supply fan power)..... 178

Table 65. Performance Rating Method Air Conditioners: System 3 (efficiency ratings excluding supply fan power) ..... 179

Table 66. Performance Rating Method Electrically Operated Unitary and Applied Heat Pumps: System 4..... 179

Table 67. Cooling System Coefficients for EIR-FT ..... 180

Table 68. Cooling System Coefficients for EIR-FPLR ..... 182

Table 69. Cooling System Coefficients for Part-Load Factor (PLF) Correlation (EnergyPlus)..... 182

Table 70. Baseline Building Condenser Type ..... 185

Table 71. Part Load Curve Coefficients – Evaporative Cooler Effectiveness ..... 188

Table 72. Baseline Systems Using Fan Coil Units ..... 190

Table 73. Heating Source for Baseline Building ..... 194

Table 74. Efficiency Requirements for Baseline Systems with Fossil Fuel Furnace ..... 197

Table 75. Furnace Efficiency Curve Coefficients ..... 198

Table 76. Heat Pump Capacity Adjustment Curves (CAP-FT) ..... 201

Table 77. Heat Pump Heating Efficiency Adjustment Curves ..... 202

Table 78. Liquid Desiccant Unit Performance Curves ..... 211

Table 79. Summary of Baseline Primary HVAC Properties ..... 212

Table 80. Default Minimum Unloading Ratios ..... 217

Table 81. Type and Number of Chillers ..... 219

Table 82. Minimum Efficiency Requirements for Water Chilling Packages ..... 221

Table 83. Default Minimum Unloading Ratios ..... 222

Table 84. Default Capacity Coefficients – Electric Air Cooled Chillers ..... 224

Table 85. Default Capacity Coefficients – Electric Water Cooled Chillers ..... 224

Table 86. Default Capacity Coefficients – Fuel- and Steam-Source Water Cooled Chillers ..... 224

Table 87. Default Efficiency EIR-FT Coefficients – Air Cooled Chillers ..... 225

Table 88. Default Efficiency EIR-FT Coefficients – Water Cooled Chillers ..... 226

Table 89. Default Efficiency EIR-FPLR Coefficients – Air Cooled Chillers ..... 226

Table 90. Default Efficiency EIR-FPLR Coefficients – Water Cooled Chillers ..... 226

Table 91. Default Capacity Coefficients – Cooling Towers ..... 231

Table 92. Default Efficiency TWR-FAN-FPLR Coefficients – VSD on Cooling Tower Fan ..... 234

Table 93. Fluid Economizer Sizing Dry-Bulb and Wet-Bulb Requirements for Computer Rooms ..... 237

Table 94. Default Part-Load CIRC-PUMP-FPLR Coefficients ..... 245

Table 95. Defaults for Water Mains Temperature Based on Climate Zone ..... 254

Table 96. Baseline Building Water Heater Type (Standard 90.1-2019 Table G3.1.1-2) ..... 256

Table 97. Exterior Lighting Power Allowances for the Baseline Building ..... 266

## 1.0 Overview

### 1.1 Purpose

This document is intended to be a reference manual for the Appendix G Performance Rating Method (PRM) of ANSI/ASHRAE/IES Standard 90.1-2019 (Standard 90.1-2019). The PRM can be used to demonstrate compliance with the standard and to rate the energy efficiency of commercial and high-rise residential buildings with designs that exceed the requirements of Standard 90.1. Use of the PRM for demonstrating compliance with Standard 90.1 was a new feature of ANSI/ASHRAE/IES Standard 90.1-2016 (Standard 90.1-2016). The procedures and processes described in the PRM reference manual (PRM-RM) are designed to provide consistency and accuracy by filling in gaps and providing additional details needed by users of the PRM. Note that this document has been created independently from ASHRAE and Standing Standard Project Committee (SSPC) 90.1 and is neither sanctioned nor approved by either of those entities.

Interpretations to Standard 90.1-2019 Code requirements can be found out [here](#)<sup>1</sup>. Users can also request official interpretations to code requirements out [here](#)<sup>2</sup>. In cases where the official interpretation conflicts with interpretations provided by the PRM-RM, the official interpretations should be used.

### 1.2 Applications of the PRM-RM

Users of this manual include energy modelers, software developers, and program administrators.

- **Energy Modelers.** When available, modelers can use software that automatically generates the baseline building, and refer to PRM-RM for rules on generating the model of the proposed design. Else, energy modeler can also manually apply the PRM-RM modeling rules and procedures to create the baseline buildings.
- **Software Developers.** Software developers can use the PRM-RM modeling guidelines to customize their software to automatically create the baseline building model and assure that schedules and other modeling assumptions are neutral. The PRM-RM also defines contents for a standard output reports that address the reporting requirements as defined for the PRM as well as United States Green Building Council's (USGBC) Leadership in Energy and Environmental Design (LEED) certification.
- **Program Administrators.** Program administrators, code officials and rating authorities that administer incentive programs that are based on the PRM of Standard 90.1-2019. Program administrators can use this document to better understand the building modeling requirements.

### 1.3 Standard 90.1-2019 Performance Rating Method Compliance Calculations

The modeling procedures in the 2019 standard build upon the 'fixed-baseline' approach added for the 2016 edition of the standard. The baseline building is fixed to be roughly equal in stringency to Standard 90.1-2004 and compliance is determined through a metric called Performance Cost Index (PCI). Section 4.2.1 of Standard 90.1-2019 specifies the process to calculate the target PCI to demonstrate compliance with the Standard. Building Performance Factors (BPF) are defined in this section that are used to calculate a target PCI (PCI<sub>t</sub>). Building Performance Factors for a particular edition of Standard 90.1 are

<sup>1</sup> <https://www.ashrae.org/technical-resources/standards-and-guidelines/standards-interpretations>

<sup>2</sup> <https://www.ashrae.org/standards-research--technology/standards-forms--procedures/how-to-request-an-interpretation>



calculated as a ratio of the prototype building regulated energy cost for a given building prototype, climate zone and edition of Standard 90.1 to the proposed building regulated energy cost for the 2004 edition of Standard 90.1. BPF for all prototypes and climate zones are specified in Standard 90.1-2019.

$$BPF_{YearX} = \sum \frac{\text{Prototype Building Regulated Energy Cost}_{YearX}}{\text{Prototype Building Regulated Energy Cost}_{2004}} / N_p \quad (1)$$

where:

Prototype Building Regulated Energy Cost year x = The portion of annual energy cost due to regulated energy use from the PNNL prototype buildings for a given building prototype, climate zone and edition of Standard 90.1.

Prototype Building Regulated Energy Cost 2004 = The portion of annual energy cost due to regulated energy use from the PNNL prototype buildings for a given building prototype, climate zone and the 2004 edition of Standard 90.1.

$N_p$  = Number of prototype buildings of a particular building type

The target PCI for 90.1-2019 code compliance is a function of the building type, the climate zone and the proportion of regulated to unregulated energy projected to be used by the baseline building (Table 1). Unregulated energy use (defined in Section 2.2.4 of this document) is neutral for 90.1 code compliance. In order to demonstrate compliance with Standard 90.1-2019, the PCI of the proposed building is required to be less than or equal to the PCI<sub>i</sub>, when calculated using the equation below (Rosenberg & Hart 2016). PCI targets can also be associated with performance levels for beyond code programs. On-site renewable energy generated by systems included on the building permit that is used by the building shall be considered free and is not included in the proposed design energy cost. However, for the determining compliance with the standard only renewable energy up to a limit of 5% of the baseline energy cost can be credited towards complying with the PCI<sub>i</sub>. The following rules apply for on-site renewable energy, site-recovered energy and on-site electricity generation systems. Applicability of the rules depends upon whether the building owns the on-site renewables, a lease agreement or a renewable purchase contract. This is discussed in further detail in Section 3.10 of this document.

#### 1. On-Site Renewable Energy Systems

- a. Energy produced by an on-site renewable energy system that is part of a separate building permit may not be used. Credit can be taken for on-site renewable energy systems owned by the building owner.
- b. Energy produced by an on-site renewable energy system that is used by another building may not be included.
- c. Credit can be taken for on-site renewable energy systems where the building owner has signed a lease agreement for the on-site renewable energy system for at least 15 years.
- d. Credit can be taken for on-site renewable energy systems where the building owner has signed a contractual agreement to purchase energy generated by the on-site renewable energy system for at least 15 years.

#### 2. On-Site Power Generation Systems

- a. Where the proposed design includes on-site electricity generation systems other than on-site renewable energy systems, the baseline design shall include the same generation systems excluding its site-recovered energy.
- b. Site-recovered energy shall not be considered purchased energy and shall be subtracted from the proposed design energy consumption prior to calculating the proposed building performance.

$$PCI = \frac{\text{Proposed Building Performance}}{\text{Baseline Building Performance}} \tag{2}$$

$$PCI_t = \frac{[BBUEC + (BPF \times BBREC)]}{BBP} \tag{3}$$

Both the proposed and baseline building are required to include all end use load components when calculating the PCI. Where a building has multiple area types, the required BPF shall be equal to the area-weighted average of the building area types.

PCI = Performance Cost Index calculated in accordance with Equation (2).

BBUEC = Baseline Building Unregulated Energy Cost.

BBREC = Baseline Building Regulated Energy Cost

BPF = Building Performance Factors

BBP = Baseline Building Performance (*BBUEC + BBREC*)

PBP = Proposed Building Performance accounting for the reduced annual purchased energy cost associated with all on-site renewable energy generation systems

PBP<sub>nre</sub> = Proposed Building Performance without any credit for reduced annual energy costs from on-site renewable energy generation systems.

When,

$$(PBP_{nre} - PBP) / BBP > 0.05$$

new buildings, additions to existing buildings and/or alterations to existing buildings shall comply with the following:

$$PCI + [(PBP_{nre} - PBP) / BBP] - 0.05 < PCI_t$$

Regulated energy cost is calculated by multiplying the total energy cost by the ratio of regulated energy use to total energy use for each fuel type. Unregulated energy costs are calculated by subtracting regulated energy cost from total energy cost. For a complete description of regulated and unregulated cost, refer to Section 2.2.4 of this document.

For building area types not listed in Table 4.2.1.1 use “All others.” Where a building has multiple building area types, the required BPF shall be equal to the area-weighted average of the building area types.

Table 1. Building Performance Factors (BPF)

	Climate Zone																
	0A and 1A	0B and 1B	2A	2B	3A	3B	3C	4A	4B	4C	5A	5B	5C	6A	6B	7	8
Multifamily	0.68	0.70	0.66	0.66	0.69	0.68	0.59	0.74	0.76	0.74	0.70	0.73	0.75	0.68	0.71	0.68	0.72
Healthcare/hospital	0.60	0.60	0.58	0.54	0.56	0.55	0.55	0.55	0.54	0.54	0.57	0.52	0.54	0.57	0.52	0.57	0.57
Hotel/motel	0.55	0.53	0.53	0.52	0.53	0.54	0.54	0.53	0.53	0.52	0.50	0.51	0.51	0.50	0.51	0.50	0.50
Office	0.52	0.57	0.50	0.56	0.53	0.56	0.48	0.51	0.52	0.49	0.51	0.51	0.49	0.52	0.51	0.49	0.51
Restaurant	0.63	0.64	0.60	0.60	0.60	0.61	0.58	0.62	0.57	0.61	0.63	0.60	0.64	0.65	0.62	0.67	0.70
Retail	0.51	0.54	0.49	0.55	0.51	0.55	0.53	0.51	0.55	0.54	0.50	0.54	0.55	0.50	0.51	0.48	0.50
School	0.39	0.47	0.38	0.43	0.38	0.42	0.40	0.37	0.40	0.38	0.36	0.40	0.36	0.36	0.37	0.36	0.37
Warehouse	0.38	0.42	0.40	0.42	0.43	0.44	0.43	0.44	0.43	0.46	0.49	0.47	0.48	0.54	0.51	0.57	0.57
All others	0.56	0.57	0.50	0.52	0.50	0.54	0.53	0.53	0.52	0.54	0.51	0.51	0.50	0.50	0.50	0.50	0.46

Prior to 2016, the Appendix G baseline building stringency changed with each version of Standard 90.1 and sometimes with each addendum. This created much confusion for software developers, energy modelers and program administrators. For many use-cases, an excessive amount of time was spent creating the baseline building and verifying its correctness. With the new procedure, the intent is that the baseline building stringency does not change. Instead, as the standard becomes more stringent, a greater level of improvement over the stable baseline is required. The 2004 version of the standard has been used for defining the baseline performance. This version of the standard has been used as a benchmark by ASHRAE and the US DOE for evaluating the stringency of more recent versions of Standard 90.1 and now it is used as a stable baseline for all performance calculations. Each consecutive version of the Standard would update the target PCI without modifying the stringency of the baseline building requirements.

## 1.4 Organization

This document is organized into five chapters, as described below.

Table 2. Organization of the PRM-RM

Chapter	Description
1.0 Overview	The purpose, organization, content, and intent of the manual (this chapter).
2.0 General Modeling Procedures	An overview of the modeling process, outlining the modeling rules and assumptions that are implemented in the same way for both the baseline building and the proposed design, and procedures for determining system types and equipment sizes.
3.0 Building Descriptors Reference	The acceptable range of inputs for the proposed design and a specification for the baseline building.
4.0 Energy Price Data	Process for defining state average and custom utility rates.
5.0 Reporting	Standard output reports required to be generated from a software tool to meet Standard 90.1-2019 PRM reporting requirements.

This document references COMNET (COMNET 2017) for several appendices containing reference material that support definition of the baseline building. References appendices from the Nonresidential Alternative Calculation Method (NACM) can also be used for default assumptions for the proposed and baseline building (CEC 2016).

## 1.5 Type of Project Submittal

The type of project could be any one or combination of the following:

- New building
- Additions to an existing building
- Alterations of an existing building

Baseline for unmodified existing building systems or components is the same as the baseline for new systems and components except for vertical fenestration area in existing buildings, as described in Section 3.5.8. However, it is acceptable to predict performance using building models that exclude parts of the existing building, provided that all of the following conditions are met:

- a. Work to be performed in excluded parts of the building shall meet the requirements of Sections 5 through 10 of Standard 90.1-2019.
- b. Excluded parts of the building are served by HVAC systems that are entirely separate from those serving parts of the building that are included in the building model.
- c. Design space temperature and HVAC system operating set points and schedules on either side of the boundary between included and excluded parts of the building are essentially the same.
- d. If a declining block or similar utility rate is being used in the analysis, and the excluded and included parts of the building are on the same utility meter, the rate shall reflect the utility block or rate for the building plus the addition.

## 2.0 General Modeling Procedures and Requirements

### 2.1 Simulation General Requirements

The proposed building performance and baseline building performance shall be calculated using the same

- a. Simulation program.
- b. Weather data.
- c. Energy rates.

#### 2.1.1 Simulation Program

The simulation program used for compliance with the PRM shall meet the following requirements-

- a. The simulation program shall be a computer-based program for the analysis of energy consumption in buildings. It shall include calculation methodologies for the building components being modeled. When the simulation program does not explicitly model a design, material, or device of the proposed design, an exceptional calculation method shall be used if approved by the rating authority.
- b. The simulation program shall be approved by the rating authority and shall, at a minimum, have the ability to explicitly model all of the requirements stated in Standard 90.1-2019 Section G2.2.1.
- c. The simulation program shall have the ability to either directly determine the proposed building performance and baseline building performance or produce hourly reports of energy use by an energy source suitable for determining the proposed building performance and baseline building performance using a separate calculation engine.
- d. The simulation program shall be capable of performing design load calculations to determine required HVAC equipment capacities and air and water flow rates in accordance with generally accepted engineering standards and handbooks.

The simulation program shall be tested according to ASHRAE Standard 140 (ASHRAE 2017), except for Sections 7 and 8 of Standard 140.

### 2.2 General Requirements for Data from the User

#### 2.2.1 General

This document lists the building descriptors that are used in the simulation. Users must provide valid data for all descriptors that do not have defaults specified and that apply to parts of the building that must be modeled.

#### 2.2.2 Definition of Building Descriptors

Building descriptors provide information about the proposed design and the baseline building. In this chapter, the building descriptors are discussed in the generic terms of engineering drawings and specifications. By using generic building descriptors, this manual avoids bias toward any particular energy simulation engine. The building descriptors in this chapter are compatible with commonly used simulation software.

Each energy simulation program has its own way of accepting building information. EnergyPlus, for instance, uses a comma delimited data file called an IDF file. DOE-2 uses BDL (building design language) to accept information. It is the software’s responsibility to translate the generic terms used in this chapter into the “native language” of the simulation program. Figure 1 illustrates the flow of information.

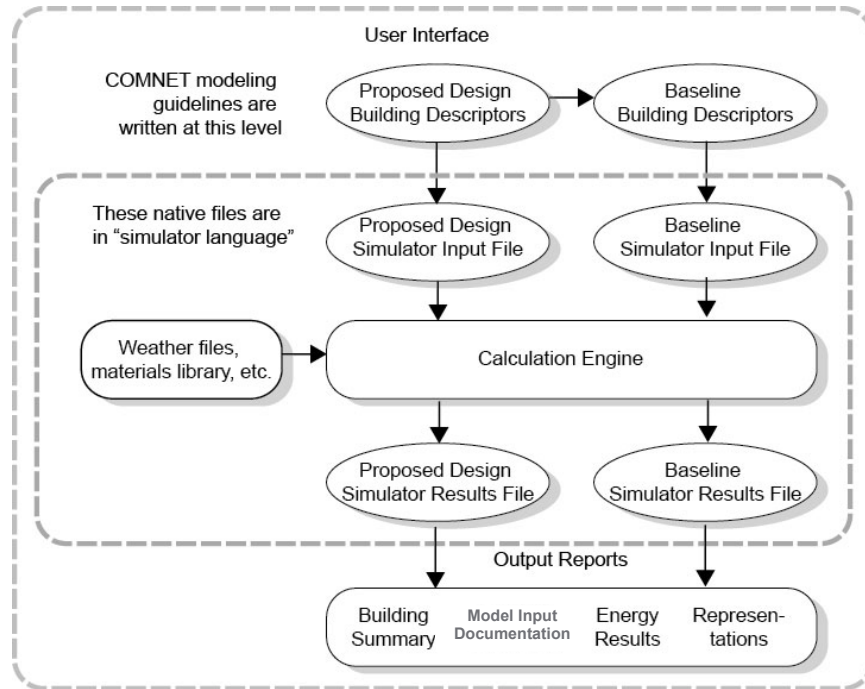


Figure 1. Information Flow

### 2.2.3 Treatment of Descriptors Not Fully Addressed by this Document

The goal of this document is to provide input and rating rules covering a full range of energy-related features encountered in commercial buildings. However, this goal is unlikely to ever be achieved due to the many features that must be covered and the continuous evolution of building materials and technologies. The baseline building design shall be developed by modifying the proposed design as described in this manual and Standard 90.1 Appendix G, Section G3.1. All building systems and equipment shall be modeled identically in the proposed design and baseline building design, except when specifically noted in this manual. Where the baseline building systems and equipment are permitted to be different from the proposed design the baseline building shall be modeled to meet the mandatory and prescriptive requirements of Standard 90.1, Sections 5 through 10. If there are no mandatory or prescriptive requirements for a system or component in Standard 90.1, then those components shall be modeled as described in this document or it shall follow the requirements of other efficiency or equipment codes or standards applicable to the design of the building systems and equipment.

When the simulation program does not explicitly model a design, material, or device of the proposed design, an exceptional calculation method shall be used if approved by the rating authority.

### 2.2.4 Energy Components

ASHRAE Standard 90.1 has requirements to address the energy used for building systems and components including energy used for heating, cooling, ventilation, interior and exterior lighting, service

water heating, motors, transformers, vertical transportation, refrigeration equipment, computer room cooling equipment and other building systems, components and processes with requirements prescribed in Standard 90.1 Sections 5 through 10.

Both the proposed and baseline building performance ratings must include all components of energy use, including receptacle loads, vertical transportation, garage ventilation, outdoor lighting, and process loads, such as refrigerated cabinets in supermarkets and cleanrooms in laboratories. Minimum efficiency requirements for many of these items are present in the prescriptive and mandatory sections of Standard 90.1 and should be modeled according to Standard 90.1-2019 Sections G1.2 and G1.3.

When allowed by the rating authority or building official, energy end-uses considered noninteractive, meaning they have no significant interactions with the heating and cooling energy components, such as exterior lighting or garage ventilation, can be determined through a side calculation instead of being modeled through the simulation program.

## 2.2.5 Regulated and Unregulated Energy Use

Regulated energy is the energy used for components of the building with requirements in Standard 90.1 Sections 5 through 10. This includes the energy used for HVAC, lighting, service water heating, motors, transformers, vertical transportation, refrigeration equipment, computer-room cooling equipment, and other building systems, components, and processes with requirements prescribed in Standard 90.1 Sections 5 through 10.

Unregulated energy is the energy used for all other end-uses in the building, which are primarily process loads. Some process loads do have requirements specifically identified in the standard and those are regulated. For example: some refrigeration systems, computer room cooling systems, fume hoods, items plugged into convenience outlets such as personal computers, printers, refrigerators etc. There is a multitude of *unregulated energy* use within the building that is not addressed by the standard, including but not limited to:

- All the things that are plugged into convenience outlets such as personal computers, printers, coffee machines, and refrigerators; i.e. the receptacle is regulated but the downstream component of the receptacle is not regulated.
- Compressed air systems in manufacturing and warehouse facilities;
- Specialized equipment in laboratories, hospitals, and manufacturing plants.
- Cooking equipment including griddles, fryers, ovens etc.
- Process loads without requirements specifically identified in the standard. For example: computer equipment in the data center, manufacturing equipment, industrial equipment.
- If chiller/boiler is used to provide chilled water or hot water to meet process loads and are covered by conditions in Standard 90.1-2019 Table 6.8.1-3 and Table 6.8.1-6, then the baseline equipment used to model the chilled water and hot water should use the efficiency specified in Standard 90.1-2019 Table G3.5-3 and Table G3.5-6, else it should be modeled as same as proposed.
- Energy used to recharge or refuel vehicles that are used for on-building site transportation purposes are considered unregulated energy and shall be modeled to be the same in the baseline and proposed building model.
  - Energy used to recharge or refuel vehicles that are used for off-building site transportation purposes shall not be modeled in the baseline building or the proposed building model.

Energy modelers must be able to distinguish between regulated and unregulated energy use since this is an important factor in determining the PCI target for compliance with 90.1-2019. The target performance cost index (PCIt) assumes that the unregulated energy use is neutral for both the proposed design and the baseline building, and the procedure for determining PCIt has adjustments for the percent of unregulated energy.

## 2.3 Thermal Blocks, HVAC Zones, and Space Functions

### 2.3.1 Definitions

A *space* is a subcomponent of an HVAC zone that has values identified for lighting, outdoor air ventilation, occupancy, receptacle loads, and hot water consumption requirements. A space could be conditioned, semi-heated, or unconditioned. An *HVAC zone* may contain more than one *space type*.

A Heating Ventilation and Air Conditioning (HVAC) *zone* is a space or collection of spaces within a building having space conditioning requirements that are similar enough to be maintained with a single thermal controlling device. An HVAC zone is a thermal and not a geometric concept: spaces need not be contiguous to be combined within a single HVAC zone. However, daylighting requirements may prevent combining non-contiguous spaces into a single HVAC zone. If individual spaces are not modeled but combined into a zone, the space type breakdown (floor area of each space) should be provided.

A thermal block is a collection of one or more HVAC zones grouped together for simulation purposes. Spaces need not be contiguous to be combined within a single thermal block.

Where HVAC Zones have been designed:

Similar HVAC zones can be combined into a single thermal block provided all of the following conditions are met:

- a. Are served by the same HVAC system or the same type of HVAC system
- b. The space use classification is the same throughout the thermal block or all of the zones have peak coincident internal loads that differ by less than 10 Btu/h·ft<sup>2</sup> from the average.
- c. Have the same occupancy, equipment, lighting, and thermostat schedules and setpoints
- d. All HVAC zones in the thermal block that are adjacent to glazed exterior walls and glazed semiexterior walls face the same orientation or their orientations vary by less than 45 degrees.
- e. All of the zones have schedules that differ by 40 or less equivalent full-load hours per week

Residential spaces shall be modeled using at least one thermal block per dwelling unit, except that those units facing the same orientations may be combined into one thermal block. Corner units and units with roof or floor loads shall only be combined with units sharing these features.

Where the HVAC zones and systems have not yet been designed:

Thermal blocks shall be defined based on similar internal load densities, occupancy, lighting, thermal and space temperature schedules, and in combination with the following guidelines:

- a. Separate thermal blocks shall be assumed for interior and perimeter spaces. Interior spaces shall be those located greater than 15 ft from an exterior wall. Perimeter spaces shall be those located within 15 ft of an exterior wall.



- b. Separate thermal blocks shall be assumed for spaces adjacent to glazed exterior walls; a separate zone shall be provided for each orientation, except that orientations that differ by less than 45° may be considered the same orientation. Each zone shall include all floor area that is 15 ft or less from a glazed perimeter wall, except that floor area within 15 ft of glazed perimeter walls having more than one orientation shall be divided proportionately between zones.
- c. Spaces having floors that are in contact with the ground or exposed to ambient conditions shall have separate thermal blocks from zones that do not share these features.
- d. Floors with identical thermal blocks can be grouped for modeling purposes.
- e. Spaces having exterior ceiling or roof assemblies shall have separate thermal blocks from zones that do not share these features.
- f. Plenums are spaces typically located above the ceiling and/or below the floor above used to transfer air, where lighting fixtures, pipes, ducts and other building services are often located. Plenums are often used as part of a building's return air pathway. Because of the leakage through the ceiling (typically suspended with lay-in panels), the temperature of the plenum tracks the temperature of the space, except that it is generally warmer because of heat stratification and heat produced by lighting fixtures located at the ceiling or in the plenum.

It is generally recommended that plenums be modeled as separate thermal blocks, but at the modeler's discretion, they may be combined with conditioned space below for modeling simplicity. Figure 2 shows the hierarchy of *spaces and HVAC zones*.

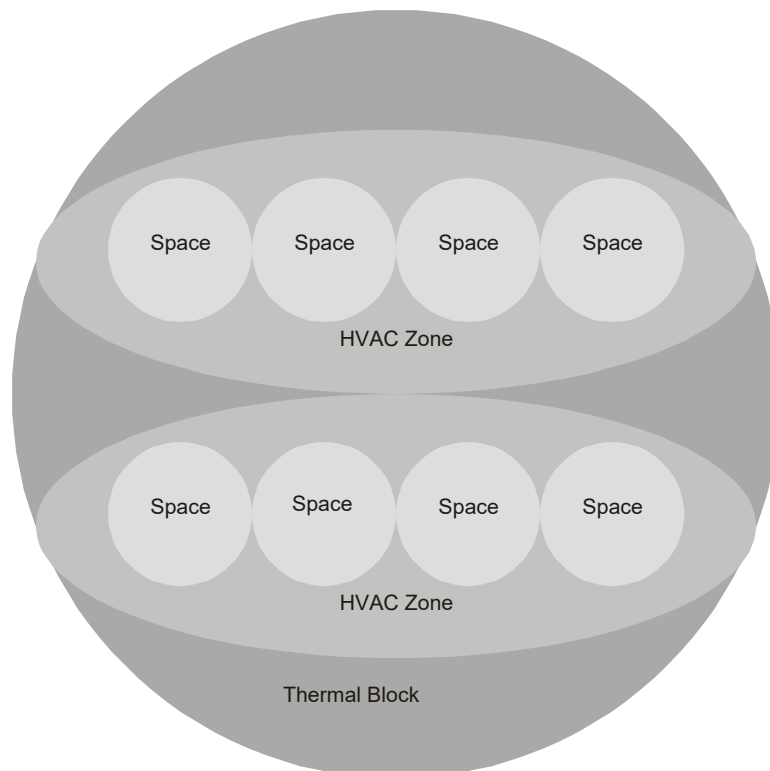


Figure 2. Hierarchy of Space, HVAC Zones, and Thermal Block

## 2.4 Modeling Requirements for Zones

### 2.4.1 Required Zone Modeling Capabilities

For use with the PRM of Standard 90.1-2019, software shall accept input for and be capable of modeling a minimum of 10 thermal zones, each with its own control of temperature. The simulation program shall be able to either (1) directly determine the proposed building performance and baseline building performance or (2) produce hourly reports of energy use by an energy source suitable for determining the proposed building performance and baseline building performance using a separate calculation engine. The simulation program shall be capable of performing design load calculations to determine required HVAC equipment capacities and air and water flow rates in accordance with generally accepted engineering standards and handbooks, for example, ASHRAE Handbook—Fundamentals (ASHRAE 2017).

### 2.4.2 Modeling Requirements for Unconditioned Spaces

An *unconditioned space* is an enclosed space that is neither directly nor indirectly conditioned. These are either (1) spaces that have neither a heating nor a cooling system or (2) spaces that are not cooled and have a heating system output capacity less than 3.4 Btu/h-ft<sup>2</sup> (10 W/m<sup>2</sup>) and a cooling system with sensible output capacity less than 3.4 Btu/h-ft<sup>2</sup> (10 W/m<sup>2</sup>). Examples include stairways, storage spaces, unoccupied adjacent tenant spaces, and attached sunspaces. Ventilated parking garages, attics, and crawlspaces are defined by Standard 90.1-2019 as unenclosed spaces and are not considered as unconditioned spaces. Modeling requirements for ventilated parking garages, attics, and crawlspaces are documented in the section below.

Unconditioned spaces shall be modeled if they are part of the permitted space. Permitted space includes all spaces in the building that are being analyzed for compliance with the use-case, which could be a beyond code program, a code compliance program or any other application which requires compliance with Standard 90.1-2019 PRM. All applicable envelope information shall be specified in a similar manner to conditioned space. If the unconditioned space is not a part of the permitted space, the space may be explicitly modeled or its impact on the permitted space may be approximated by modeling the space as outdoor space and turning off solar gains to the demising wall that separates the permitted space from the adjacent unconditioned space. The baseline envelope of conditioned, semi-heated, or plenum space adjacent to any other “unconditioned” enclosed space would be semi-exterior. Fenestration on these surfaces would be included in the fenestration area calculations for semi-exterior surfaces. For unconditioned spaces that are explicitly modeled, all internal gains and operational loads (occupants, water heating, receptacle, lighting and process loads) shall be modeled as designed if known or as specified in COMNET Appendix B (COMNET 2017) if unknown.

Return air plenums are considered indirectly conditioned spaces and shall be modeled with equipment, lighting power, and occupant loads at zero. Where recessed lights are used, heat from lights can be modeled to be transferred to the plenum.

Indirectly conditioned spaces can be either occupiable or not occupiable. For spaces that are not occupiable (such as plenums), lighting, receptacle, and occupant loads shall be zero. For indirectly conditioned spaces that are occupied, such as retail spaces, portions of restaurants etc., these loads shall be as designed. Indirectly conditioned zones will not have thermostat setpoint schedules. The allocation of zones into conditioned, indirectly-conditioned, and unconditioned zones shall be the same in baseline and proposed building models.

Unconditioned spaces may not be located in the same thermal zone as conditioned spaces. Conditioned spaces and indirectly conditioned spaces may be located in the same zone; when this occurs, the indirectly conditioned spaces will assume the space thermostat schedule of the conditioned space.

### 2.4.3 Modeling Requirements for Parking Garages, Attics, and Crawlspace

Space types such as ventilated parking garage, attics, and crawlspaces are defined by Standard 90.1-2019 as unenclosed spaces, and for the purposes of envelope requirements, envelope components adjacent to them are treated as exterior surfaces. Therefore, the following rules apply:

	Baseline	Proposed
Envelope	Demising Walls: The baseline envelope for spaces (conditioned, semi-heated, and plenum) adjacent to unenclosed spaces shall be considered exterior and modeled with the baseline exterior envelope requirements.	As designed
	Exterior Walls: Surfaces separating unenclosed spaces from the exterior shall be modeled to be the same as the proposed building.	As designed
	All Other Surfaces: All other surfaces, except those classified as ‘Semi-Exterior’ or ‘Exterior’ shall be modeled to be the same as proposed.	As designed
	Window-to-Wall Ratio (WWR) Calculation: As designed	As designed
	Skylight Roof Ratio (SRR) Calculation: Only exterior roofs for enclosed spaces are included in the calculation of skylight area, hence exterior roof area for parking garages, attics or crawlspaces shall not be considered in the calculation of the skylight area.	As designed
Lighting	The lighting power allowance for attics and crawlspaces shall be 0 W/ft <sup>2</sup> for the baseline building unless the space is used as a storage or mechanical room, in which case the lighting power density (LPD) would be the value defined in Table G3.7 of Standard 90.1-2019. . For attics, LPDs should be used in conjunction with floor area that has headroom height of 7.5 ft or greater. <sup>1</sup> The lighting power allowance for parking garages is defined in Table G3.8 of Standard 90.1-2019.	As designed
HVAC System	Ventilated parking garages, attics, and crawlspaces shall be excluded from the floor area used to determine the baseline HVAC system. If these unenclosed spaces have space conditioning or a mechanical ventilation system, the systems are assumed to be the same in both proposed and baseline models.	As designed

<sup>1</sup> Definition of Gross Floor Area from Standard 90.1-2019 Section 3: floor area, gross: the sum of the floor areas of the spaces within the building, including basements, mezzanine and intermediate-floored tiers, and penthouses with a headroom height of 7.5 ft or greater.

## 2.4.4 Modeling Requirements for Semi-Heated Spaces

A semi-heated space is defined as an enclosed space within a building that is heated by a heating system whose output capacity is greater than or equal to 3.4 Btu/h·ft<sup>2</sup> of floor area but is not a conditioned space. Semi-heated spaces are documented under Section 3.3.1 of this manual.

## 2.4.5 Space Use Classification

Space use classifications determine the default or prescribed occupant density, occupant activity level, receptacle power, service water heating, lighting load, area-based minimum outdoor ventilation air, daylighting setpoints, and operating schedules used in the analysis. Process loads and refrigeration loads are also provided for applicable space types. The user shall designate space use classifications that best match the uses for which the building or individual spaces within the building are being designed.

The user may override the default assumptions for some building descriptors dependent on the space use classification with supporting documentation. Details are provided in Section 3.4.1 of this manual.

### 2.4.5.1 Space Use Classification Considerations

Space function inputs and how they translate to thermal zone and HVAC system analysis assumptions are defined by the following rules:

- **Schedule Group:** 12 different schedule groups are defined in COMNET Appendix C (COMNET 2017) for the Standard 90.1-2019 PRM. Each schedule group defines building-specific hourly profiles for thermostat setpoints, HVAC system availability, occupancy, lighting, etc. The schedules of operation may be entered by the user or defaulted to the values defined in COMNET Appendix C (COMNET 2017).
- **Space Functions:** Each building space is assigned one space function. Design internal loads and other space function input assumptions, including the assigned schedule group described above, may be input by the user or can be defaulted to the values defined in COMNET Appendix B (COMNET 2017). This is discussed in Section 3.4 of this manual.
- **HVAC Zones:** The makeup of spaces in thermal zones shall match the proposed building design. If HVAC zones have not yet been designed, they shall be determined in accordance with Section 3.3.1. Where HVAC zones include different space types, peak internal loads and other design inputs for the HVAC zone are determined by weight-averaging the space function design inputs by floor area. Thermal zone schedules are based on the schedule group of the predominant space function (by floor area) included in the thermal zone

## 2.5 Unmet Load Hours

This manual uses the term *unmet load hours* (UMLH) as a criterion for sizing equipment, for qualifying natural ventilation systems, and for other purposes. For a thermal zone, it represents the number of hours during a year when the HVAC system serving the thermal zone is unable to maintain the setpoint temperatures for heating and/or cooling. During periods of unmet loads, the space temperature drifts above the cooling setpoint or below the heating setpoint. A thermal zone is considered to have an unmet load hour if the space temperature is below the heating temperature setpoint or above the cooling temperature setpoint by more than 50% of the temperature control throttling range (1°F with a 2°F throttling range). *Unmet load hours* for the *proposed design* or *baseline building designs* shall not exceed 300 (of the 8760 hours simulated). Alternatively, *unmet load hours* exceeding these limits may be accepted at the discretion of the *rating authority* provided that sufficient justification is given indicating

that the accuracy of the simulation is not significantly compromised by these unmet loads. One hour with unmet loads in one or more thermal zones counts as a single unmet load hour for the building

UMLH can occur because fans, airflows, coils, furnaces, air conditioners, or other equipment is undersized. UMLH can also occur due to user errors, including mismatches between the thermostat setpoint schedules and HVAC operating schedules, or from other input errors. It is the user's responsibility to address causes of UMLH in the proposed design. There can be many reasons for UMLH; the following list is a starting point to help identify the reasons:

- The thermostat schedules should agree with schedules of HVAC system operation, occupant schedules, miscellaneous equipment schedules, outside air ventilation schedules, and other schedules of operation that could affect the HVAC system's ability to meet loads in the thermal block. The number of timesteps in an averaging window can be increased to adjust equipment sizing to address high UMLH. This number should be the same in the proposed and baseline.
- The inputs for internal gains, occupants, and outside air ventilation should be reasonable and consistent with the intended operation of the building.
- The simulated operation of controls can be examined to determine if primary or secondary heating or cooling equipment (pumps, coils, boilers, etc.) is activated. The control scheme for secondary equipment should be verified.

## 2.6 Calculation Procedures

The general calculation procedure is illustrated in Figure 3 and explained in the steps below.

1. The process begins with a detailed description of the proposed design. Information is required to be provided in enough detail to enable an estimate of annual energy use for a typical weather year. This information includes the building envelope, the lighting systems, the HVAC systems, the water heating systems, and other important energy-using systems. This collection of information is referred to in this manual as *building descriptors*. Details on the building descriptors are provided in Chapter 2.
2. If the values of occupant density, equipment power density, ventilation rates, and water heating loads for the proposed building are not known, defaults based on the building type (as specified in Section 2.4.5.1) shall be used. Each building descriptor shall be either a user-defined input or the default value for that input where a default is available.
3. The next step is to simulate the *proposed design* to determine how well the heating and cooling loads are being satisfied. The indicator is the total number of UMLH. Test the number of UMLH and proceed only if the hours are less than or equal to 300 for the year of the proposed design simulation.
4. If the UMLH are greater than 300 for the year, then the user adjusts the proposed building simulation model to reduce the UMLH to less than or equal to 300. See Sections 2.5 and 2.7 for discussion on how UMLHs can be reduced.
5. If the UMLH are less than or equal to 300, then the final simulation is performed. If no changes are made in the model, the simulation from step 3 may be considered final. These calculations produce the results that are compared to the baseline building, which is calculated in steps 7 through 16.
6. The next steps relate to the creation of the baseline building model. The baseline building is created following the rules in this manual. It has the same floor area, number of floors, and spatial configuration as the proposed design; however, systems and components are modified to be in

minimum compliance with Standard 90.1-2019 PRM. The HVAC systems for the baseline building are established according to rules in this manual and depend on the primary building activity (residential or non-residential), the floor area, and the number of stories. See Section 3.1.

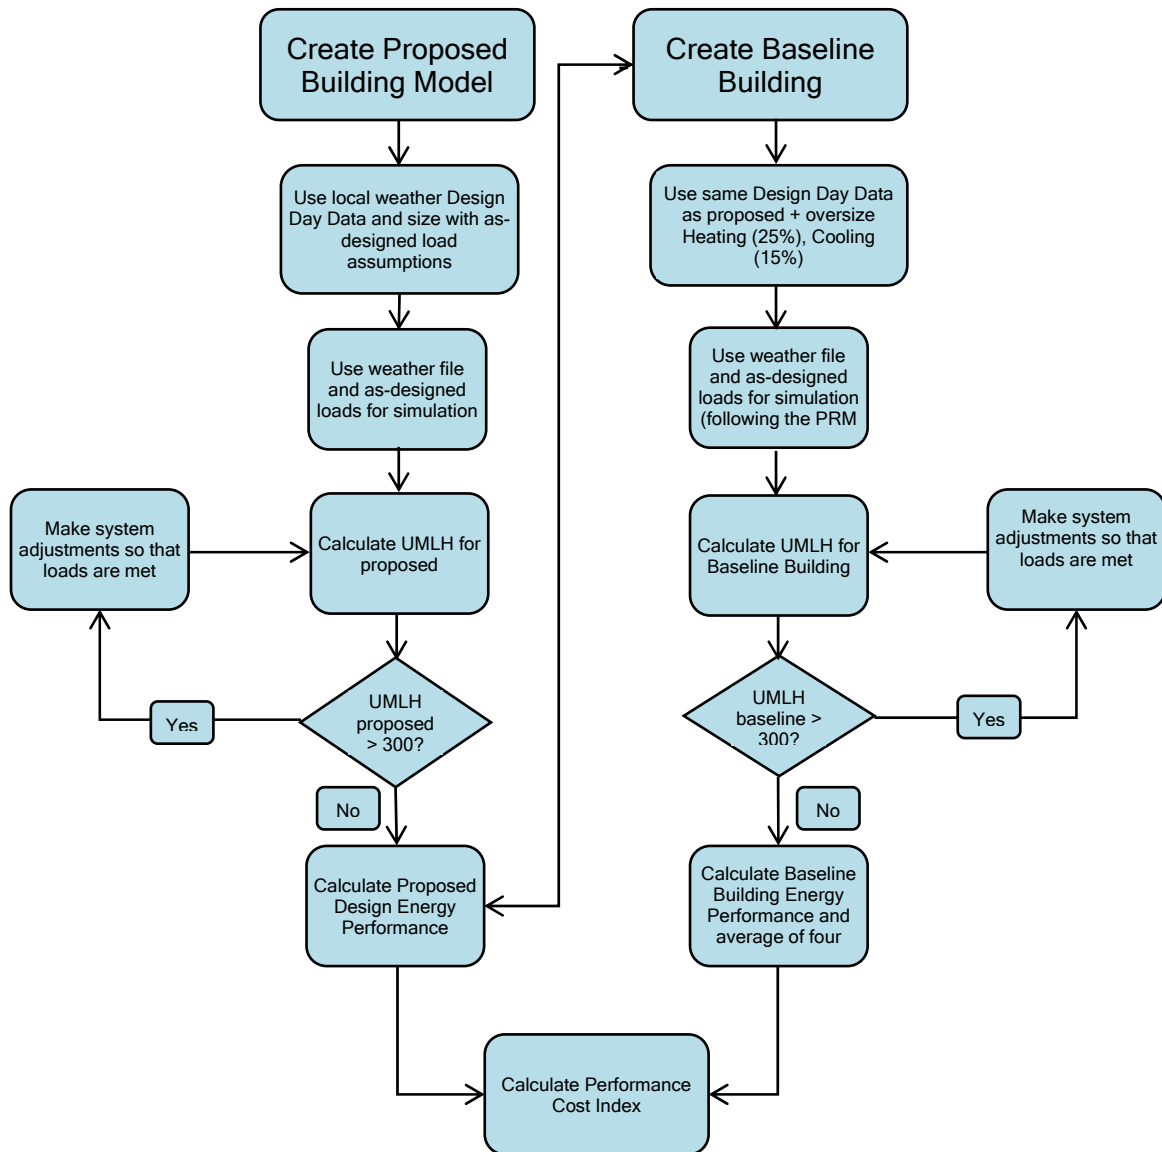


Figure 3. Calculation Process for Standard 90.1-2019 Performance Cost Index Using Performance Rating Method

1. Sizing calculations are performed for the baseline building, and heating equipment is oversized by 25% and cooling equipment by 15%. A sizing run is done for each of the four orientations, and system properties (efficiency, controls, etc.) are specified based on equipment size determined through the corresponding sizing run. Equipment and plant capacities shall be based on coincident loads. This is further discussed in Section 2.7.2 of this manual.
2. The baseline building is simulated to determine the number of UMLH. This is the same as the process performed for the proposed design in step 3.

3. The number of UMLH for the baseline building is then tested to see if they are greater than 300. This is unlikely since the heating and cooling equipment is oversized by 25% for heating and 15% for cooling in step 7.
4. If the UMLH are greater than 300, then steps need to be taken to reduce the unmet hours to less than or equal to 300. See Sections 2.5 and 2.7 for discussion on how UMLHs can be reduced.
5. Once the tests on UMLH are satisfied, the energy consumption of the baseline building is calculated. If the tests on unmet hours are satisfied the first time through, this step is the same as step 9.
6. The baseline building is rotated 90 degrees and modeled again. This is repeated for four orientations. Each time the building is rotated the equipment is resized. This step may be omitted if the building orientation is dictated by the site or if fenestration area on each orientation varies by less than 5%.
7. The baseline energy use for the baseline building is calculated as the average of the energy use for the four orientations.
8. Finally, the performance cost index is calculated as the ratio of the proposed design energy cost and baseline building energy cost.

The next two steps are followed if the PRM is being used for determination of compliance with Standard 90.1.

1. The  $PCI_t$  is calculated in accordance with Section 1.3.
2. The  $PCI$  is compared to the  $PCI_t$  to determine if the proposed building design is in compliance with Standard 90.1.

## 2.7 HVAC Capacity Requirements and Sizing

To ensure that the simulated space-conditioning loads are adequately met, adequate capacity must be available in each component of the HVAC system (e.g., supply-airflow rates, cooling coils, chillers, and cooling towers). If any component of the system is incapable of adequate performance, the simulation program will report UMLH, which need to be addressed following the steps in Section 2.6. Adequate capacities are required in the simulations of both the proposed design and the baseline building. If the equipment capacity is not sufficient to meet demands, then UMLH are evaluated at the building level by looking at the UMLH for each thermal zone being modeled. The subsections below describe the procedures that shall be followed to ensure that both the baseline and proposed building models are simulated with adequate space-conditioning capacities.

### 2.7.1 Specifying HVAC Capacities for the Proposed Design

If loads are not met for more than 300 hours, the software shall require the user to change the proposed design building description to bring the UMLH equal to or below 300. This process might not be automated by the software, in which case the user is required to modify the design model to bring the UMLH within acceptable limits. Two tests must be met:

- Space loads must be satisfied and space temperatures in all zones must be maintained within one half of the throttling range (1°F with a 2°F throttling range) of the scheduled heating or cooling thermostat setpoints. This criterion may be exceeded for no more than 300 hours for a typical year.
- System loads must be satisfied: Plant equipment must have adequate capacity to satisfy the HVAC system loads. This criterion may be exceeded for no more than 300 hours for a typical year.

Equipment sizes for the proposed design shall be entered into the model by the energy analyst and shall agree with the equipment sizes specified in the construction documents. When the simulations of these actual systems indicate that specified space conditions are not being adequately maintained in one or more thermal zone(s), the user shall be prompted to verify the model inputs to reduce the number of UMLHs.

## 2.7.2 Sizing Equipment in the Baseline Building

System coil capacities in the baseline building are automatically oversized by the program (25% for heating and 15% for cooling). Equipment is sized using design day data and weather files for the building location. These are discussed in Section 3.2.3 of this manual. The coil capacities shall be based on sizing runs for each orientation in accordance to Section 2.6 of this manual.

Oversizing would be carried out at the zone level, where the sizing parameters would be applied to the zone design coil loads, but not to the supply airflow. The system sizing calculations would sum the zone design airflow rates to obtain a system level airflow rate. The design conditions and the outdoor airflow rate would be used by the simulation program to calculate a design mixed air temperature. The thermostat setpoint plus the design supply air temperatures (SATs) would allow for the calculation of system design heating and cooling capacities. The sizing option would be specified as “Coincident,” which specifies that the central system airflow rate will be sized on the sum of the coincident zone airflow rates. There would be no oversizing factor specified at the system level or the central plant level. Plant capacities shall be based on coincident loads.

For cooling sizing runs, schedules for internal loads including those used for infiltration, occupants, lighting, gas and electricity using equipment shall be equal to the highest hourly value used in the annual simulation runs and applied to the entire design day. Schedules for infiltration for the cooling sizing runs shall be equal to the highest hourly value used in the annual simulation runs and applied to the entire design day.

For heating sizing runs, schedules for internal loads including those used for occupants, lighting, gas and electricity using equipment shall be equal to the lowest value used in the annual simulation runs. Schedules for infiltration for the heating sizing runs shall be equal to the highest hourly value used in the annual simulation runs and applied to the entire design day.

For the sizing run, thermostat schedules for heating and cooling should be set to the most typical 24 hour profile from the annual simulation run.

**Exception:** For cooling sizing runs in residential dwelling units, the infiltration, occupants, lighting, gas and electricity using equipment hourly schedule shall be the same as the most used hourly weekday schedule from the annual simulation.

If the automatic oversizing percentage is not sufficient to meet demands, then UMLH are evaluated at the building level by looking at the UMLH for each thermal zone being modeled. The first step would be to determine if the UMLH are high (>300) for the proposed building design as well as the baseline building. If that is the case, the issue is usually related to fan operation, HVAC availability, and occupancy schedules where the HVAC system has an incorrectly specified schedule that makes it unavailable during occupied hours. Optimal start controls, if a part of the building design, can also help eliminate UMLH during startup times. Since the same schedules are used for the baseline design, UMLH are seen in the baseline building as well. Other user inputs that could cause UMLH include incorrectly specified zone minimum airflows, which could result in unmet heating load hours. In this case, the software should notify the user and ask the user to verify schedules of operation. If a space is being conditioned via



transfer air, it might be that the temperature of the transfer air is not sufficient to meet space conditioning requirements.

1. If this is not the case and UMLH are seen only with the baseline design, the user or software tool is required to incrementally increase system airflows and equipment capacities, following the steps outlined below.
  - a. In the case where UMLH for cooling are a bigger problem, the equipment in the baseline building model is resized by first increasing the design airflow of all zones with significant UMLH (greater than 150 for an individual zone) by 10%, increasing the design airflow of all zones with some UMLH (between 50 and 150) by 5%. Then, the equipment capacity for the system(s) serving the affected zones is increased to handle the increased zone loads. For the central plant, the chiller(s) and towers are resized proportionally to handle the increased system loads.
  - b. In the case where UMLH for heating are a bigger problem, the same procedure is followed, with zone airflows resized first, then heating secondary equipment capacity and then boiler capacity as necessary. The capacity of the boiler or furnace shall be increased in proportion to capacities of coils required to meet the increased airflows at the baseline supply air. For heat pumps, the capacity of the coil is increased so that the additional load is not met by auxiliary heat.

### **2.7.3 Proposed Design with No HVAC, Lighting, SHW System or Receptacle Loads**

#### **2.7.3.1 No HVAC System Intended**

Standard 90.1-2019 PRM doesn't address buildings that are intended to have no HVAC system. Portions of a building with no heating and cooling system shall be simulated to be unconditioned for the baseline as well.

#### **2.7.3.2 No Lighting System Designed**

For proposed buildings, where lighting neither exists nor is submitted with design documents (including core and shell buildings), lighting shall comply with but not exceed the requirements of Standard 90.1-2019 Section [9](#).

- If space types are known, lighting power shall be determined in accordance with the Space-by-Space Method for the proposed building, as explained in Section 3.4.3 of this document.

If space types are not known, lighting power shall be determined in accordance with the Building Area Method for the proposed building. The lighting power for the baseline building in such cases shall be determined in accordance with Standard 90.1-2019 Table G3.8.

#### **2.7.3.3 No HVAC System Designed**

When the PRM is applied to buildings for which systems have not been designed, such as core and shell office buildings, the systems in the proposed design must be modeled to comply with, but not exceed the requirements of Standard 90.1-2019 Table G3.1 part 10.

In accordance with Standard 90.1 G3.1 part 10, if no heating system exists or has been submitted with design documents, the system type shall be the same system as modeled in the baseline building design and is required to comply with but not exceed the prescriptive requirements as specified in 90.1-2019

Section 6. Similarly, if no cooling system exists or has been submitted with design documents, the system type shall be the same system as modeled in the baseline building design and is required to comply with but not exceed the prescriptive requirements as specified in 90.1-2019 Section 6

Spaces that are cooled but not heated, are required to be simulated with heating. Spaces that are heated but not cooled are required to be simulated with a cooling system, unless they qualify as heated only spaces in accordance with Section 3.1.1.1(d) of this document. Where the space classification for a space is not known, the space shall be categorized as an open office space.

#### **2.7.3.4 No SHW System Designed**

In accordance to Standard 90.1-2019 Section G3.1 part 11, proposed designs where no service water-heating system exists or has been designed and submitted with design documents but the building will have service water-heating loads, a service water-heating system is required to be modeled that matches the system type in the baseline building design, as specified in Standard 90.1-2019 Table G3.1.1-2. The SHW system specified in the proposed building should comply with but not exceed the requirements of Section 7.

#### **2.7.3.5 No Power Systems Designed**

Where power and other systems covered by Standard 90.1-2019 Sections 8 and 10 are not submitted with design documents, these systems are required to comply with but not exceed the requirements specified in those sections.

### **2.7.4 Existing Systems**

In some cases, a complete HVAC system already exists. An example might be an existing speculative building that is being built out for a tenant. In a case like this, the proposed building must match the existing systems and the baseline building must follow the baseline building modeling rules.

#### **2.7.4.1 Incomplete HVAC System Design, Heating-Only or Cooling-Only**

Some buildings, such as retail malls and speculative office buildings, are typically built in phases. For example, the core mechanical system may be installed with the base building while the ductwork and terminal units are installed later as part of tenant improvements. A similar situation can occur with the lighting system or other energy-related features of the building.

There are frequently spaces within a building where the temperature control is not required for occupant comfort but is required to maintain a minimum space temperature for equipment protection. This may require cooling-only or heating-only systems depending on the space needs. Some spaces are heating only to protect against freezing. Other spaces are cooling only to offset high internal heat gain associated with process loads. While these heating-only or cooling-only systems are permitted, they require special consideration when using the Performance Rating Method.

In either of these situations, for the purpose of calculating the proposed building performance rating, the rule is simple: heating or cooling systems that do not exist or that are not yet designed or recorded in the construction documents are assumed to be of the same type that is used in the baseline with characteristics that minimally comply with the applicable mandatory provisions and prescriptive requirements from Standard 90.1 Chapter 6.

- In cases where the space use classification is not known, the default assumption is to classify it as office space.

For heated-only storage buildings, and for thermal zones designed with heating systems in the proposed building serving storage rooms, stairwells, vestibules, electrical/mechanical rooms, and restrooms not exhausting or transferring air from mechanically cooled thermal zones in the proposed design (Standard 90.1-2019 G3.1.1 exception e) the baseline HVAC system is a heating and ventilating system with no cooling. For these applications only, cooling is not modeled for the proposed design.

## 3.0 Building Descriptors Reference

### 3.1 Overview

This chapter specifies the rules that apply to the proposed design and to the baseline building for each building descriptor.

#### 3.1.1 HVAC System Map

The HVAC system in the baseline building depends on the primary building activity, the number of floors, conditioned floor area and climate zone. Details about these systems are provided in subsequent sections.

For many of the building descriptors there is a one-to-one relationship between the proposed design and the baseline building; for example, every wall in the proposed design has a corresponding wall in the baseline building. However, for HVAC systems, this one-to-one relationship generally does not hold. There may be the different number of HVAC systems serving the proposed design compared to the baseline building, and equipment such as cooling towers, circulation pumps, etc. may be present in the baseline but not proposed design.

The HVAC system in the baseline building shall be selected from Table 3, HVAC System Map, and be based on building type, number of floors, conditioned floor area, and climate zone. The selected system shall conform to the descriptions in Table 4, HVAC System Descriptions. For systems 1, 2, 3, 4, 9, 10, 11, 12, and 13, each thermal zone shall be modeled with its own HVAC system. For systems 5, 6, 7, and 8, each floor shall be modeled with a separate HVAC system. Floors with identical thermal zones can be grouped for modeling purposes.

Table 3. HVAC System Map

Building Type	Size	Baseline Building System Type	
		Cool Climates (3b, 3c, and 4-8)	Warm Climates (0 to 3A)
Residential	Any size	System 1 PTAC	System 2 PTHP
Public Assembly	< 120,000 ft <sup>2</sup>	System 3 PSZ-AC	System 4 PSZ-HP
	≥ 120,000 ft <sup>2</sup>	System 12 SZ-CV-HW	System 13 SZ-CV-ER
Retail	Low rise ≤ 2 floors	System 3 PSZ-AC	System 4 PSZ-HP
	Other than low rise	Use “Other Nonresidential”	
Hospital	Not more than 5 floors and not >150,000 ft <sup>2</sup>	System 5 PVAV with Reheat	System 5 PVAV with Reheat
	more than 5 floors or >150,000 ft <sup>2</sup>	System 7 VAV with Reheat	System 7 VAV with Reheat
Heated-only Storage		System 9- Heating and Ventilation	System 10- Heating and Ventilation
Other Nonresidential	Small, 3 floors or less and <25,000 ft <sup>2</sup>	System 3 PSZ-AC	System 4 PSZ-HP
	Medium, 4 or 5 floors and <25,000 ft <sup>2</sup> or 5 floors or less and 25,000 ft <sup>2</sup> to 150,000 ft <sup>2</sup>	System 5 PVAV with Reheat	System 6 PVAV with PFP boxes
	Large, more than 5 floors or >150,000 ft <sup>2</sup>	7 VAV with Reheat	8 VAV with PFP boxes

Building Type Descriptions for Baseline System Definition:

- Residential  
Residential buildings They include, but are not limited to, dwelling units, hotel/motel guest rooms, dormitories, nursing homes, patient rooms in hospitals, lodging houses, fraternity/ sorority houses, hostels, prisons, and fire stations.
- Public Assembly  
Public assembly buildings include houses of worship, auditoriums, movie theaters, performance theaters, concert halls, arenas, enclosed stadiums, ice rinks, gymnasiums, convention centers, exhibition centers, museums, exercise centers and natatoriums
- Heated Only  
This category applies to an entire building with heating only systems in the proposed design, such as warehouses
- Retail  
Retail buildings that are two floors or less must use single-zone packaged equipment. In the baseline building, cooling will always be DX but heating will be dependent upon the climate zone. Retail buildings that are 3 or more stories are included in the Nonresidential category below. Restaurants are also included in the nonresidential category described below.
- Hospital  
This excludes outpatient medical buildings and offices.

- Other Non-Residential

This category would cover all buildings that are not included any other category

Where attributes make a building eligible for more than one baseline system type, the predominant condition should be used to determine the system type for the entire building, except as notes in Section G3.1.1. of Standard 90.1-2019 and also documented in Section 3.1.1.1 of this manual.

Table 4. HVAC System Descriptions

System No.	System Type	Fan Control	Cooling Type	Heating Type (note 3)
1 – PTAC	Package terminal air conditioner	Constant volume	Direct expansion	Hot water fossil fuel boiler
2 – PTHP	Packaged terminal heat pump	Constant volume	Direct expansion	Electric heat pump
3 – PSZ AC	Packaged roof top air conditioner	Constant volume	Direct expansion	Fossil fuel furnace
4 – PSZ HP	Packaged roof top heat pump	Constant volume	Direct expansion	Electric heat pump
5 – PVAV Reheat	Packaged rooftop VAV with reheat	Variable volume	Direct expansion	Hot water fossil fuel boiler
6 – Packaged VAV with PFP Boxes	Packaged rooftop VAV with PFP boxes and reheat	Variable volume	Direct expansion	Electric resistance
7 – VAV with Reheat	Rooftop VAV with reheat	Variable volume	Chilled water	Hot water fossil fuel boiler
8 – VAV with PFP Boxes	VAV with parallel fan-powered boxes and reheat	Variable volume	Chilled water	Electric resistance
9 – Heating and Ventilation	Warm air furnace, gas fired	Constant volume	None	Fossil fuel furnace
10 – Heating and Ventilation	Warm air furnace, electric	Constant volume	None	Electric resistance
11 – SZ-VAV	Single zone VAV	Variable air volume	Chilled Water	See Note 2
12 – SZ-CV-HW	Single zone with hot water heat	Constant volume	Chilled Water	Hot water fossil fuel boiler
13 – SZ-CV-ER	Single zone with electric resistance heat	Constant volume	Chilled Water	Electric resistance

Notes:

1. For purchased chilled water and purchased heat, see G3.1.1.3.
2. System 11 is only used for the exceptions stated below. For climate zones 0-3A, the heating type shall be electric resistance. For all other climate zones the heating type shall be hot-water fossil-fuel boiler.
3. The fossil fuel type shall be natural gas if it is available at the site, otherwise propane.

### 3.1.1.1 Exceptions to HVAC System Requirements

There are several important exceptions to the HVAC mapping rules that apply to zones with unusual internal heat gains, different schedules, or unique outside air needs. Where attributes make a building eligible for more than one baseline system type, use the predominant condition to determine the system type for the entire building except as noted in exceptions below. These exceptions should be applied in the order defined below, to avoid inconsistencies in baseline system definition-

1. Exception (a) for mixed residential and non-residential buildings
2. Exception (d) for heated only zones
3. Exception (e) for baseline system 9 and 10
4. Exception (f) for computer rooms
5. Exception (c) for laboratory spaces
6. Exception (b) for internal loads

a. Mixed Residential and Non-Residential Buildings:

The baseline HVAC system must be determined separately for buildings with both residential and non-residential zones. Additional system type(s) are required to be used if the non-predominant conditions (use type) apply to more than 20,000 ft<sup>2</sup> of conditioned floor area. Residential building types include dormitory, hotel, motel, and multifamily. Residential space types include guest rooms, living quarters, private living space, and sleeping quarters. Other building and space types including common areas associated with residential buildings are considered nonresidential.

b. Internal Loads:

This exception is triggered for HVAC zones with total non-coincident peak internal gains (excluding ventilation or envelope loads) that differ by more than 10 Btu/h-ft<sup>2</sup> (31.5 W/m<sup>2</sup>) from the average of the other HVAC zones served by the system or when the weekly operating hours of the HVAC system are different by more than 40 equivalent full load hours (EFLH) per week from the other HVAC zones served by the system. A full load hour is an hour during which the zone is occupied and supply and return fans operate continuously. The baseline system for such spaces would be system type 3 or 4, depending on the heating source for the main building. This exception does not apply to computer rooms, see (f) below for the exception related to computer rooms.

When multiple proposed systems with schedules varying for less than 40 hours are combined into a single baseline system as a whole floor variable air volume (VAV), the baseline system fan schedule is defined to include the earliest start hour and latest end hour, so that all HVAC zones are designated to have HVAC system availability. Section 3.7.2.1 has more details regarding HVAC availability.

This exception doesn't apply to computer rooms (see f. below).

The process for calculating internal loads for spaces is defined below-

1. Step 1: Eliminate zones that meet both exceptions (internal loads and EFLH)
  - a. Find all zones whose peak coincident internal loads are more than 10 Btu/ft<sup>2</sup> from the area-weighted average of all other zones and whose EFLH are more than 40 hrs from the average of all other zones. Remove all of those zones and assign them to baseline system 3 or 4 depending on the climate zone.
  - b. Repeat until no zones meet this criteria.
2. Step 2: Eliminate zones that meet the EFLH exception
  - a. Find any zones whose EFLH is more than 40 hrs from the average of all other zones. Remove the zone with the highest EFLH greater than 40, and assign to baseline system 3 or 4 depending on climate zone.
  - b. Repeat until no zones meet this criteria
3. Step 3: Eliminate zones that meet the internal loads exception

- a. Find any zones whose peak coincident internal loads are more than 10 Btu/ft<sup>2</sup> from the area-weighted average of all other zones. Remove the zone with the highest peak internal load greater than 10 Btu/ft<sup>2</sup>, and assign system 3 or 4 depending on the climate zone.
  - b. Repeat until no zones meet this criteria
4. Step 4: Assign remaining zones to the appropriate multizone system.

Example 1: For a floor with zones with peak internal gains specified as 9 Btu/h-ft<sup>2</sup>, 14 Btu/h-ft<sup>2</sup>, 16 Btu/h-ft<sup>2</sup>, and 34 Btu/h-ft<sup>2</sup>. The difference between the zone’s peak internal loads and the average for all other zones is shown in Table 5 . Zone D would be subject to the exception since its coincident peak internal gains differ by more than 10 Btu/h-ft<sup>2</sup> from the average for all other zones and the baseline system for this space would be system type 3 or 4 (depending on building heating source). Zone D would then be removed from the list and the the difference between remaining zone’s peak internal loads and average for all other zones would be calculated again. The difference is now under 10 Btu/h-ft<sup>2</sup> and would hence stay on the same baseline system.

Table 5. Example 1 Calculations

Zone	Internal Loads (Btu/hr)	Avg. of All Others Zones (Btu/hr)	Difference from the Average
A	9	21	12
B	14	20	6
C	16	19	3
D	34	13	-21

Example 2: An office building with baseline system 5 has the following thermal blocks on one floor:

- Thermal Block A: Zones with predominantly office occupancy, to be occupied 50 hours per week;
- Thermal Block B: Zones to be occupied 55 hrs per week;
- Thermal Block C: Zones for help desk, to be occupied 65 hours per week.
- Thermal Block D: Zones to be occupied 100 hours per week

Following the methodology outlined above, the difference between the zone’s EFLHs and the average for all other zones is shown in Table 6. Since the difference from the average is greater than 40, Thermal Block D would be modeled with baseline system 3 and the difference between remaining zone’s EFLH and average for all other zones would be calculated again. The difference is now under 40 hours and hence the remaining zones would hence stay on the same baseline system.



Table 6. Example 2 Calculations

Zone	EFLH	Avg. of All Others Zones (EFLH)	Difference from the Average
A	50	73	23
B	55	72	17
C	65	68	3
D	100	57	-43

Example 3: An office building with baseline system 5 has the following thermal zones on one floor:

- Zone A: Occupied 25 hours per week;
- Zone B: Occupied 30 hours per week;
- Zone C: Occupied 35 hours per week;
- Zone D: Occupied 45 hours per week;
- Zone E: Occupied 80 hours per week;
- Zone F: Occupied 90 hours per week;
- The coincident peak internal loads for these zones are 6 Btu/h-ft<sup>2</sup>, 8 Btu/h-ft<sup>2</sup>, 10 Btu/h-ft<sup>2</sup>, 20 Btu/h-ft<sup>2</sup>, 16 Btu/h-ft<sup>2</sup>, and 28 Btu/h-ft<sup>2</sup> respectively.

Following the methodology outlined above, following would be the steps for elimination

1. Step 1: Eliminate zones that meet both exceptions (internal loads and EFLH)
  - a. Based on this, zone F is eliminated and assigned baseline system 3 or 4 depending on the climate zone.
2. Step 2: Eliminate zones that meet the EFLH expectation
3. Step 3: Eliminate zones that meet the internal loads exception

Table 7. Example 3 Calculations

Step 1						
	Schedule			Internal load		
Zone	EFLH	Avg. of All Others Zones (EFLH)	Difference from the Average	Internal loads (Btu/hr)	Avg. of All Others Zones (Btu/hr)	Difference from the Average
A	25	56.0	31	6	16	10
B	30	55.0	25	8	16	8
C	35	54.0	19	10	16	6
D	45	52.0	7	20	14	-6
E	80	45.0	-35	16	14	-2
F	90	43.0	-47	28	12	-16
Step 2						
	Schedule			Internal load		
Zone	EFLH	Avg. of All Others Zones (EFLH)	Difference from the Average	Internal loads (Btu/hr)	Avg. of All Others Zones (Btu/hr)	Difference from the Average
A	25	47.5	22.5	6	14	8
B	30	46.3	16.3	8	13	5
C	35	45.0	10.0	10	13	3
D	45	42.5	-2.5	20	10	-10
E	80	33.8	-46.3	16	11	-5
(Zone F is eliminated and assigned baseline system 3 or 4)						
Step 3						
	Schedule			Internal load		
Zone	EFLH	Avg. of All Others Zones (EFLH)	Difference from the Average	Internal loads (Btu/hr)	Avg. of All Others Zones (Btu/hr)	Difference from the Average
A	25	36.7	11.7	6	13	7
B	30	35.0	5.0	8	12	4
C	35	33.3	-1.7	10	11	1
D	45	30.0	-15.0	20	8	-12
(Zone E is eliminated and assigned baseline system 3 or 4)						
Step 4						
	Schedule			Internal load		
Zone	EFLH	Avg of Others	Diff	Btu/ h-sf	Avg of Others	Diff
A	25	17.7	-7.3	6	6	0
B	26	17.3	-8.7	8	5	-3
C	27	17.0	-10.0	10	5	-5
(Zone D is eliminated and assigned baseline system 3 or 4)						

c. Laboratory Spaces:

All zones with laboratory spaces in a building having a total laboratory exhaust rate greater than 15,000 cfm, use a single system of type 5 or 7 serving only those spaces. The baseline system serving laboratory spaces shall be system 5 (PVAV with hot water reheat) or 7 (VAV with hot water reheat)

depending on the size of the building. If the building is more than 5 floors or >150,000 ft<sup>2</sup> use system 7. Otherwise, use system 5. The lab exhaust fan shall be modeled as constant horsepower reflecting constant volume stack discharge with outdoor air bypass.

d. Heated Only Zones

Thermal zones designed with heating only systems in the proposed design, serving storage rooms, stairwells, vestibules, electrical/mechanical rooms, and restrooms not exhausting or transferring air from mechanically cooled thermal zones in the proposed design shall use system type 9 or 10 in the baseline building design. If a space type doesn't fall in the list of "storage, stairwells, vestibules, electrical/mechanical rooms or restrooms," then, despite being heated only, it would be modeled as heated and cooled. This rule applies even if the total area of such zones is below 20,000 ft<sup>2</sup>.

e. Baseline System 9, 10:

If the baseline HVAC system type is 9 or 10, all zones that are mechanically cooled in the proposed building design shall be assigned to a separate baseline system determined according to Table 3 by using the climate zone and floor area of the mechanically cooled zones. This rule applies even if the total area of such zones is below 20,000 ft<sup>2</sup>.

f. Computer Rooms:

Standard 90.1-2019 defines computer rooms as a room whose primary function is to house equipment for the processing and storage of electronic data and that has a design electronic data equipment power density exceeding 20 W/ft<sup>2</sup> of conditioned floor area. This exception would also apply to server closets or telecom equipment closets if these requirements are met.

All zones with computer rooms would be modeled with systems 3 or 4 with the exception of-

- i. Computer rooms in buildings with a total computer room peak cooling load for the proposed building >3,000,000 Btu/h
- ii. Computer rooms in buildings with a total computer room peak cooling load for the proposed building >600,000 Btu/h where the baseline HVAC system type is 7 or 8.

Computer rooms meeting either of these two exceptions will use system 11 with the heating source determined by climate zone as described in footnote 2 to Table 4.

These special systems serve just the HVAC zones containing spaces that trigger the exceptions. The rest of the building/floor is served by the baseline building HVAC system as indicated in Table 3.

### 3.1.1.2 Process for Determining the Baseline System

This section provides guidance for determining the baseline HVAC system for a proposed design to address all requirements and exceptions specified in Section 3.1.1.

#### Step 1: Determine Predominant Building Type

The building type for use in Table 3 is determined by the "predominant occupancy" type. The predominant occupancy is defined as the occupancy with the greatest conditioned floor area (CFA) and other occupancy types are defined as the "non-predominant occupancy". The building types include:

- a. Residential
- b. Public Assembly
- c. Retail
- d. Hospital

- e. Heated-Only Storage
- f. Other Non-Residential

Once the building type is determined based on the predominant occupancy as described above, the appropriate baseline system is chosen from Table 3 based on:

- a. Number of floors (including floors above grade and below grade but not including floors solely devoted to parking).
- b. Gross conditioned floor area (CFA).
- c. Climate zone

### Step 2: Determine Non-Predominant Building Type(s)

If the CFA of a non-predominant occupancy exceeds 20,000 ft<sup>2</sup>, a separate baseline system is to be chosen from Table 3 for the non-predominant occupancy. The appropriate system for the non-predominant condition is based on the same three criteria as used for the predominant condition as they apply to the non-predominant occupancy. There could be more than one non-predominant occupancy if each exceeds 20,000 ft<sup>2</sup>. For example:

- A building with 100,000 ft<sup>2</sup> residential, 35,000 ft<sup>2</sup> retail and 35,000 ft<sup>2</sup> public assembly, would have the predominant occupancy as residential and non-predominant occupancies as retail and public assemble. The baseline systems for all 3 occupancies would be determined based on the number of floors, gross conditioned floor area and climate zone.

### Step 3: Determine Other Exception Area

As described in the section above, the ‘other exception area’ will be determined in the following order:

1. Exception (d) for heated only zones
2. Exception (e) for baseline system 9 and 10
3. Exception (f) for computer rooms
4. Exception (c) for laboratory spaces
5. Exception (b) for internal loads

Spaces qualify for additional systems if they have unusual internal loads (Section 3.1.1.1 Exception (b)), are certain laboratory spaces (Section 3.1.1.1 Exception (c)), are certain heated only spaces (Section 3.1.1.1 Exception (d)) or are cooled spaces within a heated only building using systems 9 or 10 (Section 3.1.1.1 Exception (e)). The HVAC systems used for these exception areas is determined as described in Section 3.1.1.1.

### Step 4: Calculation of number of floors for a building:

- Calculation of number of floors based on occupancy type:
  - If a mixed occupancy building does not have enough area of each (greater than 20,000 ft<sup>2</sup>) to qualify for additional system type, all floors should be counted as the predominant type.
  - If a mixed occupancy building has enough area of each (where area of each occupancy type is greater than 20,000 ft<sup>2</sup>) to qualify for more than one system type, then a mixed use floor should be counted in both. So, a five-story building with two floors of residential occupancy, two floors of non-residential occupancy, and one floor of both residential and non-residential occupancy

would be defined as three floors of residential occupancy and three floors non-residential occupancy.

- Calculation of number of floors for above-grade and below-grade floors:
  - Both above and below grade floors will be counted for the calculation of number of floors.
- Calculation of number of floors for partially conditioned floors:
  - A floor (above grade or below grade) with any conditioned area should be counted as a floor. However, floors devoted solely to parking (above grade or below grade) would not be included. For example, an unconditioned below- or above-grade parking garage where only the elevator, lobbies, or stairwells are conditioned at each floor

Other example scenarios:

- If a building qualifies for two baseline HVAC systems in accordance with Section G3.1.1 (b) and both systems use hot-water boilers for heating; the same boiler(s) will serve both systems.
- If a building in climate zone 2A has two floors of retail at 30,000 ft<sup>2</sup> and 15 floors of high rise residential at 225,000 ft<sup>2</sup> it will have two system types. System 4 (PSZ-HP) will serve the retail floors and system 2 (PTHP) will serve the residential floors.
- A 6 story dormitory building in climate zone 4a, includes 40,000 ft<sup>2</sup> dorm rooms, 27,000 ft<sup>2</sup> common spaces (corridors, lounge, library, common kitchen and dining, study rooms, etc.). 6,000 ft<sup>2</sup> of the common spaces are storage and mechanical spaces that are heated-only. The predominant occupancy would be residential and the dorm rooms would be modeled with System 1 (PTAC). The common spaces would qualify as non-predominant non-residential (Standard 90.1-2019, Section G3.1.1b) and would be modeled with system 7 (VAV with reheat). The heated only zones will be modeled with baseline system 9.
- A 6 story dormitory building in Climate Zone 4a, includes 19,000 ft<sup>2</sup> dorm rooms, 23,000 ft<sup>2</sup> common spaces (corridors, lounge, library, common kitchen and dining, study rooms, etc.). 6,000 ft<sup>2</sup> of the common spaces are storage and mechanical spaces that are heated-only, hence the effective area for common spaces is 17,000 ft<sup>2</sup>. The predominant occupancy would be residential since the floor area of dorm rooms is more than that of the common spaces or the heated-only spaces and those would be modeled with System 1. The common spaces (excluding the heated-only areas), are less than 20,000 ft<sup>2</sup> hence do not qualify for the occupancy exception and are modeled with system 1. The heated only zones will be modeled with baseline system 9.
- Project is a mixed use 9 story hotel and retail in climate zone 5a. Hotel portion includes 250,000 ft<sup>2</sup> of guest rooms, 170,000 ft<sup>2</sup> of common spaces (corridors, reception, restaurant, etc.), and 70,000 ft<sup>2</sup> event spaces (convention center). The two lower floors (110,000 ft<sup>2</sup>) are occupied by various retail tenants.

The predominant occupancy is residential and the guestrooms would be modeled with baseline system 1. The other areas (convention center, retail, and common areas) are all non-predominant conditions, each over 20,000 ft<sup>2</sup> and thus need to be considered independently according to Standard 90.1-2019 Section G3.1.1b. The 70,000 ft<sup>2</sup> convention center qualifies as public assembly < 120,000 ft<sup>2</sup> and would be modeled with system 3. The retail area is greater than 20,000 ft<sup>2</sup> and would be modeled with system 4. The remaining common spaces would qualify as non-residential more than five floors and will be modeled with baseline system 7. Based on the internal loads for the restaurant space type, it might qualify for baseline system 3 (Standard 90.1-2019, Section G3.1.1c).

### 3.1.1.3 Purchased Heat and Purchased Chilled Water

#### Purchased Heat

For systems using purchased hot water or steam, the heating source shall be modeled as purchased hot water or steam in both the proposed and baseline building designs. Hot water or steam costs shall be based on actual utility rates, and on-site boilers, electric heat, and furnaces shall not be modeled in the baseline building design.

#### Purchased Chilled Water

For systems using purchased chilled water, the cooling source shall be modeled as purchased chilled water in both the proposed and baseline building designs. Purchased chilled water costs shall be based on actual utility rates, and on-site chillers and DX equipment shall not be modeled in the baseline building design.

Baseline system requirements for proposed designs using purchased heat or chilled water for heating or cooling are mentioned in Table 8. Modeling requirements for on-site distribution pumps are documented in Section 3.8.5.

Table 8. Baseline Requirements for Purchased Heat and Purchased Chilled Water Systems

Proposed		Baseline System
Heating	Cooling	
Purchased heat	Chiller or DX	The baseline heating and cooling source shall be based on the applicable cooling system as determined by Table 3 and Table 4.
Boiler/electric resistance or gas furnace	Purchased chilled water	<p>Table 3 and Table 4 shall be used to select the baseline HVAC system type, with the following modifications:</p> <ul style="list-style-type: none"> <li>• Purchased chilled water shall be substituted for the cooling source in Table 4.</li> <li>• Systems 1 and 2 shall be constant volume fan coil units with fossil fuel boiler(s).</li> <li>• Systems 3 and 4 shall be constant volume single zone air handlers with fossil fuel furnace(s). Refer to Section 3.7.6 of this document for details.</li> <li>• System 7 shall be used in place of System 5. Refer to Section 3.8.1 of this document for details.</li> <li>• System 8 shall be used in place of System 6. Refer to Section 3.8.2 of this document for details.</li> </ul>
Purchased heat	Purchased chilled water	<p>Table 3 and Table 4 shall be used to determine the baseline HVAC system type, with the following modifications:</p> <ul style="list-style-type: none"> <li>• Purchased heat and purchased chilled water shall be substituted for the heating types and cooling types in Table 4.</li> <li>• System 1 will be constant volume fan coil units. Refer to Section 3.7.5.5 of this document for details on this system type.</li> <li>• System 3 will be a constant volume single zone air handler. Refer to Section 3.7.5.2 of this document for details.</li> <li>• System 7 will be used in place of System 5. Refer to Section 3.8.2 of this document for details.</li> </ul>

### 3.1.2 Organization of Information

Building descriptors are grouped under objects or building components. A wall or exterior surface (an object) would have multiple building descriptors dealing with its geometry, thermal performance, etc. Each building descriptor contains the following information.

## 3.2 Project Data

### ***Building Descriptor Title***

<i>Applicability</i>	Information on when the building descriptor applies to the proposed design
<i>Definition</i>	A definition for the building descriptor
<i>Units</i>	The units that are used to prescribe the building descriptor. A “List” indicates that a fixed set of choices applies and the user shall only be allowed to enter one of the values in the list.
<i>Input Restrictions</i>	Any restrictions on information that may be entered for the proposed design
<i>Baseline Building</i>	This defines the value for the “baseline building.” A value of “Same as proposed” indicates that the value of the building descriptor is the same as that for the proposed building. In many cases, the value may be fixed, or may be determined from a table lookup. In some cases the input may not be applicable.

### 3.2.1 General Information

#### ***Project Name***

<i>Applicability</i>	All projects
<i>Definition</i>	Name used for the project, if one is applicable
<i>Units</i>	No units
<i>Input Restrictions</i>	Input is optional for the proposed design
<i>Baseline Building</i>	Not applicable

#### ***Project Address***

<i>Applicability</i>	All projects
<i>Definition</i>	Street address, city, state, and zip code
<i>Units</i>	No units
<i>Input Restrictions</i>	Input is mandatory for the proposed design
<i>Baseline Building</i>	Not applicable

#### ***Project Owner***

<i>Applicability</i>	All projects
<i>Definition</i>	Owner(s) of the project or individual or organization for whom the building permit is sought. Information should include name, title, organization, email, and phone number.
<i>Units</i>	No units
<i>Input Restrictions</i>	Input is optional for the proposed design
<i>Baseline Building</i>	Not applicable

**Architect**

<i>Applicability</i>	All projects
<i>Definition</i>	Architect responsible for the building design. Information should include name, title, organization, email, and phone number.
<i>Units</i>	No units
<i>Input Restrictions</i>	Input is optional for the proposed design
<i>Baseline Building</i>	Not applicable

**HVAC Engineer**

<i>Applicability</i>	All projects
<i>Definition</i>	HVAC engineer responsible for the building design. Information should include name, title, organization, email, and phone number.
<i>Units</i>	No units
<i>Input Restrictions</i>	Input is mandatory for the proposed design
<i>Baseline Building</i>	Not applicable

**Lighting Engineer/Designer**

<i>Applicability</i>	All projects
<i>Definition</i>	Lighting engineer/designer responsible for the building design. Information should include name, title, organization, email, and phone number.
<i>Units</i>	No units
<i>Input Restrictions</i>	Input is mandatory for the proposed design
<i>Baseline Building</i>	Not applicable

**Energy Modeler**

<i>Applicability</i>	All projects
<i>Definition</i>	Individual responsible for performing the analysis. Information should include name, title, organization, email, and phone number.
<i>Units</i>	No units
<i>Input Restrictions</i>	Input is mandatory for the proposed design
<i>Baseline Building</i>	Not applicable

**Date**

<i>Applicability</i>	All projects
<i>Definition</i>	Date of completion of the analysis or the date of its most-recent revision
<i>Units</i>	Date format
<i>Input Restrictions</i>	Input is mandatory for the proposed design
<i>Baseline Building</i>	Not applicable



### 3.2.2 Building Model Classification

#### ***Building Type***

<i>Applicability</i>	All Projects
<i>Definition</i>	A building type which is used to determine the performance cost index target.
<i>Units</i>	List: Choose from the following list Multifamily Healthcare/Hospital Hotel/Motel Office Restaurant Retail School Warehouse Grocery Store All Others
<i>Input Restrictions</i>	Required input
<i>Baseline Building</i>	Same as proposed. This choice would determine the baseline performance target for the project.

**Building Classification for Lighting**

<i>Applicability</i>	When the building area method is used instead of the space-by-space method of classifying lighting in the building
<i>Definition</i>	The building type or principal activity. One of two available classification methods for identifying the function of the building or the functions of spaces within the building, which in turn determine lighting-related requirements for the baseline building. Table 9 lists the building classifications that are available under the building area method.

Table 9. Building Area Types for Standard 90.1-2019

Building Area Type
Automotive facility
Convention center
Courthouse
Dining: Bar lounge/leisure
Dining: Cafeteria/fast food
Dining: Family
Dormitory
Exercise center
Fire station
Gymnasium
Health-care clinic
Hospital
Hotel/Motel
Library
Manufacturing facility
Motion picture theater
Multifamily
Museum
Office
Parking garage
Penitentiary
Performing arts theater
Police station
Post office
Religious facility
Retail
School/university
Sports arena
Town hall
Transportation
Warehouse
Workshop

<i>Units</i>	List: Choose a building activity from Table 9
<i>Input Restrictions</i>	For multi-use buildings, the building may be divided and a different building classification may be assigned to each part. Either the building area method or the space-by-space method must be used, but the two classification methods may not be mixed for lighting definitions within a single PRM run.
<i>Baseline Building</i>	Same as proposed

### 3.2.3 Geographic and Climate Data

For the U.S. and U.S. territories, city, state, and county are required to determine climate data from the available data in Normative Appendices B and D of Standard 90.1-2019. In accordance to Section G2.3 of Standard 90.1-2019, the simulation program is required to perform the simulation using hourly values of climatic data, such as temperature and humidity from representative climatic data, for the site in which the proposed design is to be located.

For cities or urban regions with several climatic data entries, and for locations where weather data are not available, the designer shall select available weather data that best represent the climate at the construction site. The selected weather data are required to be approved by the rating authority.

#### **Zip Code**

<i>Applicability</i>	All projects
<i>Definition</i>	Postal designation
<i>Units</i>	List
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Not applicable

#### **Latitude**

<i>Applicability</i>	All projects
<i>Definition</i>	The latitude of the project site
<i>Units</i>	Degrees (°)
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as proposed

#### **Longitude**

<i>Applicability</i>	All projects
<i>Definition</i>	The longitude of the project site
<i>Units</i>	Degrees (°)
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as proposed

#### **Elevation**

<i>Applicability</i>	All projects
<i>Definition</i>	The height of the building site above sea level
<i>Units</i>	Feet (ft)
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as proposed

**DOE Climate Zone**

<i>Applicability</i>	All projects
<i>Definition</i>	One of the 17 U.S. Department of Energy (DOE) climate zones and subzones
<i>Units</i>	List
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as proposed

**Daylight Savings Time Observed**

<i>Applicability</i>	All projects
<i>Definition</i>	An indication that daylight savings time is observed. The schedules of operation are shifted by an hour twice a year and this affects solar gains, temperature, and other factors.
<i>Units</i>	Boolean (True/False)
<i>Input Restrictions</i>	True
<i>Baseline Building</i>	True

**County**

<i>Applicability</i>	All projects
<i>Definition</i>	The county where the project is located
<i>Units</i>	List, N/A
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as proposed

**City**

<i>Applicability</i>	All projects
<i>Definition</i>	The city where the project is located
<i>Units</i>	List, N/A
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as proposed

**State**

<i>Applicability</i>	All projects
<i>Definition</i>	The state where the project is located
<i>Units</i>	List, N/A
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as proposed

**Design Day Data**

<i>Applicability</i>	All projects
<i>Definition</i>	A data structure indicating design day information used for the sizing of the proposed system. Note that this information may not necessarily match the information used in the annual simulation.
<i>Units</i>	Data structure: contains the following:  Cooling Design Dry-Bulb (1%), Cooling Design Wet-Bulb (1%), Heating Design Temperature (99.6%), 1% Enthalpy
<i>Input Restrictions</i>	Not applicable
<i>Baseline Building</i>	Weather conditions used in sizing runs to determine baseline equipment capacities shall be based on design days developed using heating design temperatures, cooling design temperatures and cooling design wet-bulb temperature.  Heating design temperature is defined at the outdoor dry-bulb temperature equal to the temperatures that is exceeded at least 99.6% of the number of hours during a typical year.  Cooling design temperature is defined as the outdoor dry-bulb and wet-bulb temperature equal to the temperature that is exceeded by 1% of the number of hours during a typical weather year.  Refer to Section 2.7.2 of this manual for additional details on baseline equipment sizing.  Note: Standard 90.1-2019 requires the use of summer design day and winter design day. Use of monthly design days is not permitted.

**Weather File**

<i>Applicability</i>	All projects
<i>Definition</i>	The hourly (i.e., 8,760 hour per year) weather data to be used in performing the building energy simulations. Weather data must include outside dry-bulb temperature, outside wet-bulb temperature, atmospheric pressure, wind speed, wind direction, cloud cover, cloud type (or total horizontal solar and total direct normal solar), clearness number, ground temperature, humidity ratio, density of air, and specific enthalpy.
<i>Units</i>	Data file
<i>Input Restrictions</i>	The weather file selected shall be in the same climate zone as the proposed design. If multiple weather files exist for one climate zone, then the weather file closest in distance to the proposed design and in the same climate zone shall be used, or a weather file that best represents the climate at the building site. The modeling professional can use their own discretion for selecting the weather file most representative of their location in this scenario.
<i>Baseline Building</i>	Weather data shall be the same for both the proposed design and baseline building

**Ground Reflectance**

<i>Applicability</i>	All projects
<i>Definition</i>	Ground reflectance affects daylighting calculations and solar gain. The reflectance can be specified as a constant for the entire period of the energy simulation or it may be scheduled, which might be appropriate to account for snow cover in the winter.
<i>Units</i>	Data structure: schedule, fraction
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Ground reflectance shall be the same for both the proposed design and the baseline building.

**Local Terrain**

<i>Applicability</i>	All projects
<i>Definition</i>	An indication of how the local terrain shields the building from the prevailing wind. Estimates of this effect are provided in the ASHRAE Handbook of Fundamentals.
<i>Units</i>	List: the list shall contain only the following choices:

Description
Flat, open country
Rough, wooded country, Suburbs
Towns and cities
Ocean
Urban, industrial, forest

<i>Input Restrictions</i>	Local terrain should be representative of the long-term conditions at the site
<i>Baseline Building</i>	The baseline building terrain should be equal to the proposed design

**3.2.4 Site Characteristics****Shading of Building Site**

<i>Applicability</i>	All projects
<i>Definition</i>	Shading of building fenestration, roofs, or walls by other structures, surrounding terrain, vegetation, and the building itself
<i>Units</i>	Data structure
<i>Input Restrictions</i>	The default is for the site to be unshaded. The effect that structures and significant vegetation or topographical features have on the amount of solar radiation being received by a structure shall be adequately reflected in the computer analysis. All elements whose effective height is greater than their distance from the proposed building and width facing the proposed building is greater than one-third of the proposed building are required to be accounted for in the analysis.
<i>Baseline Building</i>	The proposed design and baseline building are modeled with identical assumptions regarding shading of the building site.

### 3.2.5 Calendar

#### ***Year for Analysis***

<i>Applicability</i>	All projects
<i>Definition</i>	The calendar year to be used for the annual energy simulations. This input determines the correspondence between days of the week and the days on which weather events on the weather tape occur and has no other impact.
<i>Units</i>	List: choose a year (other than a leap year)
<i>Input Restrictions</i>	Allow any year other than a leap year
<i>Baseline Building</i>	Same calendar year as the proposed design

#### ***Schedule of Holidays***

<i>Applicability</i>	All projects																				
<i>Definition</i>	A list of dates on which holidays are observed and on which holiday schedules are used in the simulations																				
<i>Units</i>	Data structure																				
<i>Input Restrictions</i>	The following 10 holidays represent the default set for US holidays. When a holiday falls on a Saturday, the holiday is observed on the Friday preceding the Saturday. If the holiday falls on a Sunday, the holiday is observed on the following Monday. The default holidays can be modified and additional holidays can be defined.																				
	<table> <tr> <td>New Year's Day</td> <td>January 1</td> </tr> <tr> <td>Martin Luther King Day</td> <td>Third Monday in January</td> </tr> <tr> <td>Presidents Day</td> <td>Third Monday in February</td> </tr> <tr> <td>Memorial Day</td> <td>Last Monday in May</td> </tr> <tr> <td>Independence Day</td> <td>July 4</td> </tr> <tr> <td>Labor Day</td> <td>First Monday in September</td> </tr> <tr> <td>Columbus Day</td> <td>Second Monday in October</td> </tr> <tr> <td>Veterans Day</td> <td>November 11</td> </tr> <tr> <td>Thanksgiving Day</td> <td>Fourth Thursday in November</td> </tr> <tr> <td>Christmas Day</td> <td>December 25</td> </tr> </table>	New Year's Day	January 1	Martin Luther King Day	Third Monday in January	Presidents Day	Third Monday in February	Memorial Day	Last Monday in May	Independence Day	July 4	Labor Day	First Monday in September	Columbus Day	Second Monday in October	Veterans Day	November 11	Thanksgiving Day	Fourth Thursday in November	Christmas Day	December 25
New Year's Day	January 1																				
Martin Luther King Day	Third Monday in January																				
Presidents Day	Third Monday in February																				
Memorial Day	Last Monday in May																				
Independence Day	July 4																				
Labor Day	First Monday in September																				
Columbus Day	Second Monday in October																				
Veterans Day	November 11																				
Thanksgiving Day	Fourth Thursday in November																				
Christmas Day	December 25																				
<i>Baseline Building</i>	The baseline building shall observe the same holidays specified for the proposed design																				

### 3.2.6 Simulation Control

#### *Number of Timesteps*

*Applicability* All projects

*Definition* The timestep object specifies the “basic” timestep for the simulation. The value entered here is the number of timesteps to use within an hour. Longer timesteps have lower values for number of timesteps per hour. For example, a value of 6 entered here directs the program to use a zone timestep of 10 minutes and a value of 60 means a 1-minute timestep. The user’s choice for number of timesteps per hour must be evenly divisible into 60; the allowable choices are 1, 2, 3, 4, 5, 6, 10, 12, 15, 20, 30, and 60.

If the model will include calculating the cost of electricity, then the user should be aware that many electric utility tariffs base charges on demand windows of a specified length of time. Demand windows are defined in Section 4.2 of this document. If the choice of number of timesteps per hour is not consistent with the demand window, then unexpected results may be obtained. For reasonable prediction of the maximum rates for electricity use in calculating demand charges, the length of the zone timestep needs to be consistent with the tariff’s demand window. The following table lists the values that are consistent with various demand windows.

Table 10. Acceptable Timesteps for Demand Window Values

Demand Window	Applicable Number of Timesteps per Hour
Quarter Hour	4, 12, 20 or 60
Half Hour	2, 4, 6, 10, 12, 20, 30 or 60
Full Hour, Day, Week	Any

*Units* None

*Input Restrictions* Maximum of 1 hour. If demand window is specified to be less than 1 hour, the length of the zone timestep needs to be consistent with Table 10 to prevent inaccurate results.

*Baseline Building* Same as proposed

### 3.3 HVAC Zones

An HVAC zone is a space or collection of spaces having similar space-conditioning requirements, the same heating and cooling setpoint, and is the basic thermal unit (or zone) used in modeling the building. An HVAC zone can include one or more spaces.

A thermal block is a virtual HVAC zone that consists of multiple actual HVAC zones that have similar characteristics. Section 2.3 of this document outlines the rules for defining HVAC zones and thermal blocks and specifies the rules for combining HVAC zones into thermal blocks. Where HVAC zones have been combined into thermal blocks, the descriptors applicable to HVAC zones below also apply to thermal blocks.



### 3.3.1 General Information

#### ***HVAC Zone Name***

<i>Applicability</i>	All projects
<i>Definition</i>	A unique identifier for the thermal zone.
<i>Units</i>	Text
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Not applicable

#### ***HVAC Zone Associated Building Area Types***

<i>Applicability</i>	All projects
<i>Definition</i>	An associated building area type for each HVAC zone. The permitted building area types are restricted to the building area types defined in Standard 90.1-2019 Section 9.5.1. This mapping is used to identify the baseline HVAC system, baseline SHW system and the WWR for the baseline building.
<i>Units</i>	Text
<i>Input Restrictions</i>	HVAC zones in the proposed building model shall be assigned to a building area type.
<i>Baseline Building</i>	Same as proposed

#### ***HVAC Zone Description***

<i>Applicability</i>	All projects
<i>Definition</i>	A brief description of the HVAC zone that identifies the spaces that makes up the HVAC zone or other descriptive information. The description should tie the HVAC zone to the building plans.
<i>Units</i>	Text
<i>Input Restrictions</i>	HVAC zones in the proposed building model shall match those in the proposed building design, with each temperature control device defining a separate thermal zone.  Refer to Section 2.3 of this manual for guidance on how to define thermal blocks, HVAC zones, and spaces.
<i>Baseline Building</i>	Same as proposed

#### ***Space Conditioning Category***

<i>Applicability</i>	All projects
<i>Definition</i>	Designation of the zone as containing a directly conditioned space, semi-heated, unconditioned, or plenum (i.e., unoccupied but partially conditioned as a consequence of its role as a path for returning air).  <u>Conditioned Space</u> : a space that has a heating and/or cooling system of sufficient size to maintain temperatures suitable for human comfort. Cooled zone, heated space, and indirectly conditioned space are defined as follows: <ul style="list-style-type: none"> <li>• Cooled space: an enclosed space within a building that is cooled by a cooling system whose sensible output capacity is greater than or equal to 3.4 Btu/h·ft<sup>2</sup> of floor area.</li> <li>• Heated space: an enclosed space within a building that is heated by a heating system whose output capacity relative to the floor area is greater than or equal to the criteria in Table 11.</li> </ul>

- Indirectly conditioned space: an enclosed space within a building that is not a heated space or a cooled space, which is heated or cooled indirectly by being connected to adjacent space(s) provided:
  - The product of the U-factor(s) and surface area(s) of the space adjacent to connected space(s) exceeds the combined sum of the product of the U-factor(s) and surface area(s) of the space adjoining the outdoors, unconditioned spaces, and to or from semi-heated spaces (e.g., corridors) or
  - That air from heated or cooled spaces is intentionally transferred (naturally or mechanically) into the space at a rate exceeding 3 air changes per hour (ACH) (e.g., atria).

**Semi-Heated Space:** an enclosed space within a building that is heated by a heating system whose output capacity is greater than or equal to 3.4 Btu/h·ft<sup>2</sup> of floor area but is not a conditioned space.

**Unconditioned space:** an enclosed space within a building that is not a conditioned space or a semi-heated space.

**NOTE:** Crawlspace, attics, and parking garages with natural or mechanical ventilation are not considered enclosed spaces. Rules for unconditioned spaces, not considered enclosed, are documented in Section 2.4.3 of this document.

Table 11. Standard 90.1-2019 Heated Space Criteria

Heating Output (Btu/h·ft <sup>2</sup> )	Climate Zone
>5	0, 1 and 2
>9	3A, 3B
>7	3A, 3B
>10	4A, 4B
>8	4C
>12	5
>14	6
>16	7
>19	8

- Units* List: Conditioned, Semi-heated, and Unconditioned
- Input Restrictions* As designed except spaces designed as semi-heated that are not storage, stairwells, vestibules, electrical/mechanical rooms or restrooms, shall be modeled as a cooled space. The cooling system type shall be the same as the modeled in the baseline building design and shall comply with requirements specified in Standard 90.1-2019 Section 6.
- Baseline Building* Same as proposed for all space types except when spaces are designated as semi-heated spaces in the proposed or baseline building. The criteria for a semi-heated space must be verified in both the baseline building and the proposed building.

For spaces in the proposed building, the following should be verified:

- The heating temperature setpoint is always < 60°F, and
- The proposed system capacity falls within the limits for a semi-heated space.

If these conditions are met, the spaces are designated as semi-heated for the proposed building, and baseline building sizing runs in accordance with Section 2.7.2 are carried out where the space in the baseline building is simulated with semi-heated envelope requirements to verify heating and cooling system capacity.

If the heating system output capacity is greater than or equal to the values in Table 11 and the cooling capacity is greater than 5 Btu/h·ft<sup>2</sup>, then the space is considered conditioned in

the baseline building and should be analyzed with the conditioned envelope requirements in Standard 90.1 Tables G3.4-1 to Tables G3.4-8. If the heating or cooling capacity falls within the range of a semi-heated space, the space is considered a semi-heated space and the baseline building sizing run is complete..

Table 12. Heated Space Criteria for the Baseline Building

Heating Output (Btu/h·ft <sup>2</sup> )	Climate Zone
>5	0, 1 and 2
>10	3
>15	4, 5
>20	6, 7
>25	8

<b>HVAC Zone Type</b>	
<i>Applicability</i>	All projects
<i>Definition</i>	Designation of the thermal zone as directly conditioned, semi-heated, indirectly conditioned (i.e., conditioned only by passive heating or cooling from an adjacent thermal zone), or plenum (i.e., unoccupied but partially conditioned as a consequence of its role as a path for returning air).  A thermal zone may include a single space or more than one space. Each thermal zone shall have a single temperature control device.
<i>Units</i>	List: Directly Conditioned, Indirectly Conditioned, Semi-Heated, Unconditioned or Plenum
<i>Input Restrictions</i>	The default thermal zone type is “directly conditioned”
<i>Baseline Building</i>	The descriptor is identical for the proposed design and baseline building

<b>Occupancy Type</b>	
<i>Applicability</i>	All projects
<i>Definition</i>	Separate exterior building envelope requirements are specified for each of three categories of conditioned space: (a) nonresidential conditioned space, (b) residential conditioned space, and (c) semi-heated space. <ul style="list-style-type: none"> <li>• Non-residential space conditioning category: all occupancies other than residential.</li> <li>• Residential space conditioning categories: spaces in buildings used primarily for living and sleeping. Residential spaces include, but are not limited to, dwelling units, hotel/motel guest rooms, dormitories, nursing homes, patient rooms in hospitals, lodging houses, fraternity/sorority houses, hostels, prisons, and fire stations.</li> <li>• Semi-heated: spaces that meet the semi-heated space criteria.</li> </ul>
<i>Units</i>	Text, unique
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Same as proposed for all space types except semi-heated. A sizing run, with semi-heated envelope construction properties, would need to be done to determine heating capacity per unit area for the baseline building.

**Ventilation System Name**

<i>Applicability</i>	All projects
<i>Definition</i>	The name of the system that provides ventilation to the thermal zone. In most cases, the primary heating/cooling system provides the required ventilation air. For thermal zones served by a dedicated outdoor air system, this descriptor would be used to identify the same. The purpose of this building descriptor is to link the thermal zone to a system.
<i>Units</i>	Text, unique
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	NA

**Primary Heating/Cooling System Name**

<i>Applicability</i>	All projects
<i>Definition</i>	The name of the primary HVAC system that serves this thermal zone. The purpose of this building descriptor is to link the thermal zone to a system. For thermal zones served by a ventilation system like a dedicated outdoor air system (DOAS) and a separate HVAC system that meets the heating and cooling loads, the DOAS system would be defined as the ventilation system and the HVAC system would be defined as the primary heating/cooling system.
<i>Units</i>	Text, unique
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	The baseline building may have a different system mapping if the baseline building has a different HVAC type than the proposed design. Baseline system types 5-8 are required to be one system per floor. This could result in different system names as well.

**Secondary Heating/Cooling System Name**

<i>Applicability</i>	All projects
<i>Definition</i>	The name of the secondary HVAC system that serves this thermal zone. This descriptor is used if more than one HVAC system serves a thermal zone. For example a VAV with perimeter baseboards. The baseboards would be the secondary system. The purpose of this building descriptor is to link the thermal zone to a system.
<i>Units</i>	Text, unique
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	NA

**Floor Area**

<i>Applicability</i>	All projects
<i>Definition</i>	The gross floor area of a thermal zone, including walls and minor spaces for mechanical or electrical services such as chases not assigned to other thermal zones
<i>Units</i>	Square feet (ft <sup>2</sup> )
<i>Input Restrictions</i>	The floor area of the thermal zone is derived from the floor area of the individual spaces that make up the thermal zone
<i>Baseline Building</i>	Same as proposed

### 3.3.2 Interior Lighting

Inputs for interior lighting are specified at the space level (see specification below). In those instances when thermal zones contain just one space, the inputs here will be identical to the inputs for the single space that is contained within the thermal zone.

For those instances when a thermal zone contains more than one space, the software shall either model the lighting separately for each space and sum energy consumption and heat gain for each timestep of the analysis or it must incorporate a procedure to sum inputs or calculate weighted averages such that the lighting power used at the thermal zone level is equal to the combination of lighting power for each of the spaces contained in the thermal zone.

In some cases, combining lighting power at the space level into lighting power for the thermal zone may be challenging and would have to be done at the level of each timestep in the simulation. These cases include:

- a. A thermal zone that contains some spaces that have daylighting and others that do not
- b. A thermal zone that contains spaces with different schedules of operation
- c. A thermal zone that contains some spaces that have a schedule adjusted for lighting controls and other spaces that do not
- d. Combinations of the above

### 3.3.3 Receptacle and Process Loads

Inputs for receptacle and process loads are specified at the space level (see specification below). In those instances when thermal zones contain just one space, the inputs here will be identical to the inputs for the single space that is contained within the thermal zone.

For those instances when a thermal zone contains more than one space, the software shall either (1) model the receptacle and process loads separately for each space and sum energy consumption and heat gain for each timestep of the analysis or (2) incorporate a procedure to sum inputs or calculate weighted averages such that the receptacle and process loads used at the thermal zone level are equal to the combination of receptacle and process loads for each of the spaces contained in the thermal zone.

When the spaces contained in a thermal zone have different schedules, combining receptacle and process loads from the space level may be challenging and would have to be done at the level of each timestep in the simulation. See discussion above on lighting.

### 3.3.4 Occupants

Inputs for occupant loads are specified at the space level (see specification below). In those instances when thermal zones contain just one space, the inputs here will be identical to the inputs for the single space that is contained within the thermal zone.

For those instances when a thermal zone contains more than one space, the software shall either (1) model the occupant loads separately for each space and the heat gain for each timestep of the analysis or (2) incorporate a procedure to sum inputs or calculate weighted averages such that the occupant loads used at the thermal zone level are equal to the combination of occupant loads for each of the spaces contained in the thermal zone.

When the spaces contained in a thermal zone have different occupant schedules, rolling up occupant loads from the space level may be challenging and would have to be done at the level of each timestep in the simulation.

Additionally, for occupants, outside air ventilation is potentially impacted when the Ventilation Rate Procedure (VRP) is used accordance with ASHRAE Standard 62.1-2013 (ASHRAE 2013b) or the International Mechanical Code 2015 (IMC 2015), to determine system level ventilation rates. Demand controlled ventilation (DCV) can also affect the ventilation rates based on occupancy. Section 3.6.5.5 and Section 3.6.5.4 discuss the occupancy-based ventilation requirements for VRP and DCV controls.

### 3.3.5 Infiltration

#### *Infiltration Method*

<i>Applicability</i>	All projects
<i>Definition</i>	<p>Energy simulation programs have a variety of methods for modeling uncontrolled air leakage or infiltration.</p> <ul style="list-style-type: none"> <li>• Some procedures use the effective leakage area (ELA), which is generally applicable for small residential-scale buildings.</li> <li>• The component leakage method requires the user to specify the average leakage through the building envelope per unit area (ft<sup>2</sup>). This could be a function of floor area or a function of area of the above-grade walls.</li> <li>• Other methods require the specification of a maximum rate (like air change hours), which is modified by a schedule.</li> </ul>
<i>Units</i>	List: ELA, Component Leakage Method (function of floor area or function of above-grade wall area or function of all exterior surfaces), ACH
<i>Input Restrictions</i>	<p>For Standard 90.1-2019, a fixed infiltration rate can be specified and calculated.</p> <ul style="list-style-type: none"> <li>• As a leakage per area of exterior envelope, including the gross area of exterior walls, roofs, and exposed floors, but excluding slabs on grade and interior partitions.</li> <li>• A zone ACH input</li> <li>• The default method is component leakage method; however, there are no restrictions on the use of other listed methods.</li> </ul>
<i>Baseline Building</i>	The infiltration method used for the baseline building shall be the same as the proposed design

**Infiltration Data**

<i>Applicability</i>	All projects
<i>Definition</i>	Information needed to characterize the infiltration rate in buildings. The required information will depend on the infiltration method selected above. Infiltration shall be modeled using the same methodology, and adjustments for weather and building operation in both the proposed design and the baseline building design. These adjustments shall be made for each simulation time step and must account for but not be limited to weather conditions and HVAC system operation, including strategies that are intended to positively pressurize the building.  For the effective leakage area method, typical inputs are leakage per exterior wall area in square feet or other suitable units and information to indicate the height of the building and how shielded the site is from wind pressures. Only zones with exterior surfaces are assumed to be subject to infiltration.

*Units* A *data structure* is required to define the effective leakage area model

*Input Restrictions* When the infiltration rate is determined by whole building air leakage testing in accordance with ASHRAE 90.1 - 2019 Section 5.4.3.1.1, the air leakage rate of the building envelope ( $I_{75\text{Pa}}$ ) at a fixed building pressure differential of 0.3 in. H<sub>2</sub>O shall be as measured.

**Note:** This requires that the building be tested and the model updated post construction.

For buildings providing verification in accordance with ASHRAE 90.1 - 2019 section 5.9.2.1(a), the air leakage rate of the building envelope ( $I_{75\text{Pa}}$ ) at a fixed building pressure differential of 0.3 in. H<sub>2</sub>O shall be defaulted to be 0.6 cfm/ft<sup>2</sup> of exterior building enclosure area. When infiltration inputs are based on air leakage testing, test results shall be submitted with the other required documentation. The air leakage rate of the building envelope shall be converted to appropriate units for the simulation program using one of the two methods described below.

Any reasonable inputs may be specified, consistent with the chosen infiltration modeling method. Acceptable ranges for inputs should be defined for each method supported by rating software. The peak infiltration rate of the building envelope ( $I_{75\text{Pa}}$ ) at a fixed building pressure differential of 0.3 in. H<sub>2</sub>O will be defaulted to 0.6 cfm/ft<sup>2</sup> exterior building enclosure area, unless a different value is provided by the user and approved by the rating authority.

$$\text{Infiltration} = I_{design} \cdot F_{schedule} \cdot (A + B \cdot |t_{zone} - t_{odb}| + C \cdot ws + D \cdot ws^2)$$

Where:

<i>Infiltration</i>	= Zone infiltration airflow (m <sup>3</sup> /s-m <sup>2</sup> )
<i>I<sub>design</sub></i>	= Design zone infiltration airflow (m <sup>3</sup> /s-m <sup>2</sup> )
<i>F<sub>schedule</sub></i>	= Fractional adjustment from a prescribed schedule, based on HVAC availability schedules in COMNET Appendix C (COMNET 2017) (unit less)
<i>t<sub>zone</sub></i>	= Zone air temperature (°C)
<i>t<sub>odb</sub></i>	= Outdoor dry bulb temperature (°C)
<i>ws</i>	= Wind speed (m/s)
<i>A</i>	= Overall coefficient (unitless)
<i>B</i>	= Temperature coefficient (1/°C)
<i>C</i>	= Wind speed coefficient (s/m)
<i>D</i>	= Wind speed squared coefficient (s <sup>2</sup> /m <sup>2</sup> )

The DOE-2 Infiltration methodology coefficients would be used, where:

$$A = 0$$

$$B = 0$$

$$C = 0.224$$

$$D = 0$$

When Infiltration normalization per above grade wall area is used, the air leakage rate of the building envelope ( $I_{75Pa}$ ), at a pressure differential of 0.3 in. H<sub>2</sub>O shall be converted to appropriate units for the simulation program using the following formula describing infiltration as a function of exterior wall area:

$$I_{EW} = 0.112 \times I_{75Pa} \times S/A_{EW}$$

Source: (ANSI/ASHRAE/IES 2019)

When Infiltration normalization per floor area is used, the air leakage rate of the building envelope ( $I_{75Pa}$ ), at a pressure differential of 0.3 in. H<sub>2</sub>O shall be converted to appropriate units for the simulation program using the following formula describing infiltration as a function of floor area:

$$I_{FLR} = 0.112 \times I_{75Pa} \times S/A_{FLR}$$

When using the measured air leakage rate of the building envelope at a pressure differential of 0.3 in. H<sub>2</sub>O for the proposed design, the air leakage rate shall be calculated as follows:

$$I_{75pa} = Q/S$$

Where:

$I_{75Pa}$  = Air leakage rate of the building envelope expressed in cfm/ft<sup>2</sup> at a fixed building pressure differential of 0.3 in. H<sub>2</sub>O, or 75 Pa

$Q$  = Volume of air in cfm flowing through the whole building envelope when subjected to an indoor/outdoor pressure differential of 0.3 in H<sub>2</sub>O or 1.57 PSF in accordance with ASHRAE 90.1 - 2019 Section 5.4.3.1.1

$S$  = Total area of the envelope air pressure boundary (expressed in ft<sup>2</sup>), including the lowest floor, any below or above-grade walls, and roof (or ceiling) (including windows and skylights), separating the interior conditioned space from the unconditioned environment

$I_{EW}$  = Adjusted air leakage rate (expressed in cfm/ft<sup>2</sup>) of the building envelope at a reference wind speed of 10 mph and the above ground exterior wall area

$A_{EW}$  = Total above-grade exterior wall area, ft<sup>2</sup>

$I_{FLR}$  = Adjusted air leakage rate (expressed in cfm/ft<sup>2</sup>) of the building envelope at a reference wind speed of 10 mph and relative to gross floor area

$A_{FLR}$  = Gross floor area. ft<sup>2</sup>



*Baseline Building* The air leakage rate of the building envelope ( $I_{75\text{Pa}}$ ) at a fixed building pressure differential of 0.3 in.  $\text{H}_2\text{O}$  shall be defaulted to be 1.0  $\text{cfm}/\text{ft}^2$  of exterior building enclosure area.

Infiltration modeling approach for the baseline building shall be identical to the proposed. The following aspects are required to be the same for baseline and proposed building models:

- The same methodology as defined in the section above
- Adjustments for weather. The coefficients A, B, C, D will be same as designed. If not provided by user, they would be the same as the default values outlined above.
- Building operation in both the proposed design and the baseline design
- HVAC system operation, including strategies that are intended to positively pressurize the building

**NOTE:** If a value for  $I_{75\text{Pa}}$  or Q is provided by the user for the proposed design, the infiltration value would be flagged and reported by the software tool.

### ***Infiltration Schedule***

*Applicability* When an infiltration method is used that requires the specification of a schedule to adjust the peak infiltration rate.

*Definition* With the ACH method and other methods (see above), it may be necessary to specify a schedule that modifies the infiltration rate for each hour or time step of the simulation. Such schedules are typically used to account for building pressurization due to the HVAC system.

*Units* Data structure: schedule, fractional

*Input Restrictions* The schedules for infiltration can be specified by the user or the default schedule can be used. The default infiltration schedule shall be set equal to 1 when the fan system is off, and 0.25 when the fan system is on. This is based on the assumption that when the fan system is on it brings the pressure of the interior space above the pressure of the exterior, and decreases the infiltration of outside air. When the fan system is off, interior pressure drops below exterior pressure and infiltration increases. Schedules other than the default shall be permitted to account for building ingress and egress.

Infiltration schedule shall be 1 for spaces that include fan systems that do not supply outside air and do not run continuously when the space is occupied in accordance with Standard 90.1-2019 Table G3.1(4) 'Schedule'.

*Baseline Building* The infiltration schedule for the baseline building shall be the same as the proposed design.

### **3.3.6 Natural Ventilation**

Natural ventilation may be modeled for a thermal zone in the proposed design when the following conditions are met:

- Outside air intake from natural ventilation systems shall not be less than the minimum required outdoor air ventilation rates during occupied times in the proposed building model.
  - Controls for cooling system operation and availability of natural ventilation are automatic.
  - Rating authority approves of the proposed procedure.
- **In the case when the thermal zone does not have a cooling system:** The thermal zone in the proposed design is modeled with no cooling when the natural ventilation system maintains temperature. For periods when the space temperature is greater than the cooling setpoint, a cooling system like the

one for the baseline building is assumed to operate to maintain temperature. The fans in this simulated system cycle with loads. The corresponding thermal zone in the baseline building is not modeled with natural ventilation. The baseline building HVAC system, as defined in Standard 90.1-2019, Section G3.1.1 (Table 3 and Table 4 of this document), provides cooling to maintain thermostat setpoint.

- **In the case where the thermal zone has a cooling system:** In the case where the thermal zone has an installed cooling system in the proposed design, the fans are required to operate when natural ventilation is insufficient to meet cooling or outdoor air ventilation loads. The cooling system comes on when natural ventilation is insufficient to maintain the temperature setpoint.

The corresponding thermal zone in the baseline building is not modeled with natural ventilation. In the baseline building, the fans are required to run constantly during occupied periods, and cycle with loads during unoccupied periods, same as the proposed building. The baseline building HVAC system, as defined in Standard 90.1-2019, Section G3.1.1 (Table 3 and Table 4 of this document), provides cooling to maintain thermostat setpoint.

The infiltration rate for the proposed building will be as designed. If natural ventilation is modeled as an increased infiltration rate, it will be specified through two inputs: “Infiltration through building envelope” and “Infiltration as a result of automatically controlled natural ventilation system”. Infiltration as a result of automatically controlled natural ventilation is not modeled for the baseline building.

Outputs for the proposed building with natural ventilation need to demonstrate that minimum outdoor air requirements are being met during all occupied hours.

#### *Natural Ventilation Method*

<i>Applicability</i>	All thermal zones with natural ventilation
<i>Definition</i>	The method used to model natural ventilation. The choices will depend to some extent on the capabilities of the energy simulation program. One procedure that could be used with most energy simulation programs would be to approximate the effect of natural ventilation by scheduling a high rate of infiltration when conditions are right. The schedule would typically be developed through computational fluid dynamic software or with other software that can estimate the cooling benefit of natural ventilation and relate it to climate so that the schedule can be developed.
<i>Units</i>	List: Choices depend on the capabilities of the energy simulation program
<i>Input Restrictions</i>	As designed. If natural ventilation is modeled as an increased infiltration rate, it shall be specified through two inputs: “Infiltration through building envelope” and “Infiltration as a result of Automatically Controlled Natural Ventilation System.”
<i>Baseline Building</i>	The baseline building is not modeled with natural ventilation. If natural ventilation is modeled as an increased infiltration rate in the proposed design, the component “Infiltration as a result of Automatically Controlled Natural Ventilation” is not modeled for the baseline building.  <b>NOTE:</b> If the effect of natural ventilation is approximated by scheduling a high rate of infiltration, additional documentation needs to be provided, supporting the calculation process.

**Airflow Rate**

<i>Applicability</i>	All projects with natural ventilation that use a method that requires the specification of an airflow rate
<i>Definition</i>	The rate of airflow through the thermal zone when the natural ventilation system is operating
<i>Units</i>	ACH or cfm
<i>Input Restrictions</i>	The airflow rate for the proposed design shall be determined using sound engineering methods, and supporting documentation shall be provided.  If not modeled directly by the simulation program, the exceptional calculation method shall be used, with proper documentation submitted.
<i>Baseline Building</i>	The baseline building is not modeled with natural ventilation

**Natural Ventilation Schedule**

<i>Applicability</i>	All projects with natural ventilation that use a method that requires a schedule
<i>Definition</i>	A schedule that modifies the airflow rate through the thermal zone dictates when natural ventilation is enabled
<i>Units</i>	Data structure: schedule, fractional
<i>Input Restrictions</i>	The schedule for the proposed design shall be determined using sound engineering methods and keyed to outdoor temperature and perhaps other conditions on the weather file used for the simulation
<i>Baseline Building</i>	The baseline building is not modeled with natural ventilation

**Minimum Indoor Temperature**

<i>Applicability</i>	All projects with natural ventilation or mixed mode ventilation with automatic controls
<i>Definition</i>	The minimum indoor temperature below which natural ventilation is disabled
<i>Units</i>	°F
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable

**Maximum Indoor Temperature**

<i>Applicability</i>	All projects with natural ventilation or mixed mode ventilation with automatic controls
<i>Definition</i>	The maximum indoor temperature above which natural ventilation is disabled
<i>Units</i>	°F
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable

**Minimum Outdoor Temperature**

<i>Applicability</i>	All projects with natural ventilation or mixed mode ventilation with automatic controls
<i>Definition</i>	The minimum outdoor temperature below which natural ventilation is disabled
<i>Units</i>	°F
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable

**Maximum Outdoor Temperature**

<i>Applicability</i>	All projects with natural ventilation or mixed mode ventilation with automatic controls
<i>Definition</i>	The maximum outdoor temperature above which natural ventilation is disabled
<i>Units</i>	°F
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable

**3.3.7 Thermal Mass**

This set of building descriptors characterize the thermal mass that is not explicitly captured by the definition of exterior surfaces and interior partitions.

**Thermal Response Characteristics**

<i>Applicability</i>	All projects
<i>Definition</i>	<p>This building descriptor only addresses the building structure's response to changes in temperature and heat flux. Thermal mass associated with floors, interior walls, and other building envelope components is derived from the thermal properties and materials that make up these components. However, if interior partitions are not explicitly entered (see below) their effect may be captured with this input.</p> <p>The thermal capacitance of the building contents are typically specified in terms of the composite weight of the building contents in lb/ft<sup>2</sup> or absolute lb. In this instance, the software assumes an average specific heat for the contents. This input can also be specified as the mass of the contents multiplied by the specific heat of the contents. The latter method would be a summation, since each item may have a different specific heat.</p>
<i>Units</i>	lb/ft <sup>2</sup> or lb
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	The interior thermal mass in the baseline building shall be the same as the proposed design

***Furniture and Contents***

<i>Applicability</i>	All projects
<i>Definition</i>	A specification of the mass and heat capacity of furniture and other elements in the interior of the building. This includes information about the coverage and weight of furniture in the space as well as how much of the floor is covered by furniture. The latter affects how much of the solar gain that enters the space is directed to the floor with delayed heat gain and how much becomes a more instantaneous load.
<i>Units</i>	Data structure
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	The interior thermal mass and modeling assumptions in the baseline building shall be the same as the proposed design.

**3.4 Space Uses**

Each thermal zone discussed above may be subdivided into space uses. This section presents the building descriptors that relate to the space uses. Space uses and the defaults associated with them are listed in COMNET Appendix B (COMNET 2017). Every thermal zone shall have at least one space, as defined in this section. Daylit spaces should generally be separately defined.

### 3.4.1 General Information

#### **Space Function**

<i>Applicability</i>	All projects
<i>Definition</i>	<p>Spaces need to be identified using the Space-by-Space method, when known. When space types are not known, the Building Area Method can be used for the space use classification. The building area types and space-by-space type classifications will be defined from Standard 90.1-2019, Section 9.5.1 and Section 9.6.1 respectively.</p> <p>More than one building type category may be used in a building if it is a mixed-use facility. If space type categories are used, the user may simplify the placement of the various space types within the building model, provided that building-total areas for each space type are accurate.</p> <p>The allowed building types in building area method or space-by-space method are documented in COMNET Appendix B (COMNET 2017). The building or space type provides default values for the following:</p> <ul style="list-style-type: none"> <li>• Number of Occupants (occupant density)</li> <li>• Equipment Power Density</li> <li>• Lighting Power Density</li> <li>• Hot Water Load</li> <li>• Ventilation Rate</li> <li>• Schedules</li> </ul> <p>When the space classification for a space is not known, the space is required to be classified as an office space.</p>
<i>Units</i>	List
<i>Input Restrictions</i>	<p>The space-by-space method is restricted to the space types defined in Section 9 of Standard 90.1 and listed in COMNET Appendix B (COMNET 2017)</p> <p>The user may simplify the placement of the various space types within the building model, provided that building total areas and orientation of glazed exterior walls for each space type are accurate</p>
<i>Baseline Building</i>	Same as proposed

#### **Floor Area**

<i>Applicability</i>	All projects that use the space-by-space classification method (see above)
<i>Definition</i>	The floor area of the space. The area of the spaces that make up a thermal zone shall sum to the floor area of the thermal zone.
<i>Units</i>	Square feet (ft <sup>2</sup> )
<i>Input Restrictions</i>	Area shall be measured to the outside of exterior walls and to the center line of partitions
<i>Baseline Building</i>	Same as proposed

### 3.4.2 Occupants

COMNET Appendix B (COMNET 2017) provides space level information on occupancy, lighting, and plug load schedules, as well as occupant density, allowed LPD, and occupant heat gain.

#### **Number of Occupants**

<i>Applicability</i>	All projects
<i>Definition</i>	The number of persons in a space. The number of persons is modified by an hourly schedule (see below), which approaches but does not exceed 1.0. Therefore, the number of persons specified by the building descriptor is similar to design conditions as opposed to average occupancy.
<i>Units</i>	The number of persons may be specified in an absolute number, ft <sup>2</sup> /person, or persons/1000 ft <sup>2</sup>
<i>Input Restrictions</i>	The design occupancy is to be used when known. For cases where the design occupancy is not known, the number of occupants given by space function in COMNET Appendix B (COMNET 2017) can be used.
<i>Baseline Building</i>	Same as proposed

#### **Occupant Heat Rate**

<i>Applicability</i>	All projects
<i>Definition</i>	The sensible and latent heat produced by each occupant in an hour. This depends on the activity level of the occupants and other factors. Heat produced by occupants must be removed by the air conditioning system as well as the outside air ventilation rate and can have a significant impact on energy consumption.
<i>Units</i>	Btu/h, specified separately for sensible and latent gains
<i>Input Restrictions</i>	The occupant heat rate is determined by the user and, if unknown, can use the values in COMNET Appendix B (COMNET 2017)
<i>Baseline Building</i>	Same as proposed

#### **Occupancy Schedule**

<i>Applicability</i>	All projects
<i>Definition</i>	The occupancy schedule modifies the number of occupants to account for expected operational patterns in the building. The schedule adjusts the heat contribution from occupants to the space hourly to reflect time-dependent usage patterns. The occupancy schedule can also affect other factors such as outside air ventilation, depending on the control mechanisms specified.
<i>Units</i>	Data structure: schedule, fractional
<i>Input Restrictions</i>	The actual occupancy schedule is to be used when known. When actual schedules are not known, default values specified in COMNET Appendix C (COMNET 2017) may be used
<i>Baseline Building</i>	Same as proposed

### 3.4.3 Interior Lighting

For building descriptors related to exterior lighting, see Section 3.9.6 of this document.

#### ***Lighting Classification Method***

<i>Applicability</i>	Each space in the building
<i>Definition</i>	Indoor lighting power can be specified using the building area method, or the space-by-space method. The procedure specified in Standard 90.1-2019, Section 9.6.1 should be followed while determining applicable space types, and in Section 9.5.1 to determine applicable building types.
<i>Units</i>	List
<i>Input Restrictions</i>	<p>When a lighting system exists or a lighting system has been designed, it is not applicable. Where lighting neither exists nor is submitted with design documents:</p> <ul style="list-style-type: none"> <li>• Where space types are known, lighting power shall be determined in accordance with the Space-by-Space Method (Standard 90.1-2019, Section 9.6.1).</li> <li>• Where space types are not known, lighting power shall be determined in accordance with the Building Area Method (Standard 90.1-2019, Section 9.5.1).</li> </ul>
<i>Baseline Building</i>	<p>Space by Space in accordance with Standard 90.1-2019 Table G3.7.</p> <p>However, where lighting neither exists nor is submitted with design documents and the proposed design lighting power is determined according to the Building Area Method, the baseline building design lighting power shall be determined in accordance with Standard 90.1-2019 Table G3.8.</p>



### **Regulated Interior Lighting Power**

<i>Applicability</i>	All projects
<i>Definition</i>	Total connected lighting power for all regulated interior lighting power applications except <i>Additional Lighting Power: Retail Display Lighting Power</i> . This includes the loads for lamps and ballasts and task and furniture-mounted fixtures.
<i>Units</i>	Watts
<i>Input Restrictions</i>	<p>As designed. Where a complete lighting system exists or has been submitted with the design documents, the lighting system power is determined by applying the rules of Standard 90.1-2019 Section 9.1.3 and 9.1.4 to the existing or designed fixtures and equipment excluding the applications described in the <i>Unregulated Lighting Power</i> and <i>Additional Lighting Power: Retail Display Lighting Power</i> subsections below. The modeled lighting power in each thermal block must be based on the fixtures within each thermal block. For spaces without unregulated lighting power or additional lighting power, this input will be the same as the proposed building interior lighting power.</p> <p>For areas of the building where lighting neither exists nor is fully designed:</p> <ul style="list-style-type: none"> <li>• Where space types are known, lighting power shall be determined in accordance with the Space-by-Space Method (Standard 90.1-2019, Section 9.6.1) using the values in Table 9.6.1.</li> <li>• Where space types are not known, lighting power shall be determined in accordance with the Building Area Method (Standard 90.1-2019, Section 9.6.1) using the values in Table 9.5.1.</li> <li>• For dwelling units, hotel/motel guest rooms, and other spaces in which lighting systems are connected via receptacles and are not shown on design documents, lighting power used in the simulation shall be equal to the lighting power allowance in Standard 90.1-2019 Table 9.6.1 for the appropriate space type or as designed, whichever is greater. For the dwelling units, lighting power used in the simulation shall be equal to 0.60 W/ft<sup>2</sup> or as designed, whichever is greater. However, lighting use can be reduced for the portion of the space illuminated by the specified fixtures provided that they maintain the same illuminance level as in the baseline. Such reduction shall be demonstrated by calculations. For additional guidance, Karpman 2019 provides additional guidance on modeling dwelling unit lighting.</li> </ul>
<i>Baseline Building</i>	<p>Where the complete lighting system exists or have been submitted with the design documents, the modeled Lighting Power in each thermal block is the sum of the product of the LPDs for the space types from Standard 90.1-2019, Table G3.7 and the floor areas for the corresponding spaces.</p> <p>For areas of the building where lighting neither exists nor is fully designed in the proposed building:</p> <ul style="list-style-type: none"> <li>• Where space types are known, baseline lighting power shall be determined using the values in Standard 90.1-2019 Table G3.7 as described above. The baseline LPD for dwelling units shall be based on the LPD requirements as specified in Standard 90.1-2019 Table G3.7.</li> <li>• Where space types are not known, the baseline lighting power in each thermal block is the sum of the product of the area of the block and the LPD in the Building Area Method, Table G3.8 of Standard 90.1-2019.</li> </ul>

**Additional Lighting Power: Retail Display Lighting Power**

*Applicability* All projects that have display lighting in retail spaces when using the space-by-space classification

*Definition* Display lighting is special lighting to highlight merchandise. To qualify for display lighting under these standards, the lighting must be specifically designed and directed to highlight merchandise and separately controlled from the general lighting. ASHRAE Standard 90.1-2019 defines the following types of retail lighting:

Table 13. Retail Display Lighting Allowance

Area Type	Lighting Power Allowance	Notes
Retail Area Type 1	0.45 W/ft <sup>2</sup>	Includes all retail sales floor area that doesn't qualify for Type 2, 3, or 4
Retail Area Type 2	0.45 W/ft <sup>2</sup>	Includes the sales floor area for vehicles, sporting goods, and small electronics.
Retail Area Type 3	1.05 W/ft <sup>2</sup>	Includes sales floor area for the sale of furniture, clothing, cosmetics, and artwork.
Retail Area Type 4	1.88 W/ft <sup>2</sup>	Includes sales floor area for jewelry, crystal, and china.

The additional allowance is a base allowance of 1000 W and additional allowance based on the retail area type and the total area being illuminated.

*Units* W/ft<sup>2</sup>

*Input Restrictions* As designed. The default for lighting power for retail display wattage is 0.0 watts. The user is required to specify the purpose for additional interior lighting power allowance through retail display lighting. These are then required to be classified in one of the four categories mentioned above in Table 13

*Baseline Building* The modeled Lighting Power in each thermal block in the baseline building is the sum of the product of the LPDs for the space types from Standard 90.1-2019, Table G3.7 and the floor areas for the corresponding spaces. There is no additional allowance for display lighting in the baseline building.

**Additional Lighting Power: Decorative Lighting**

*Applicability* All projects that have decorative lighting for highlighting art and exhibits in galleries, museums and monuments, when using the space-by-space classification

*Definition* Decorative lighting is special that is an essential element for the function performed in galleries, museums, and monuments. To qualify for decorative lighting under these standards, the lighting must be specifically designed for the purpose of decorative appearance or for highlighting art or exhibits not exempted in Standard 90.1-2019 Table 9.2.3.1, Item 11. and separately controlled from the general lighting.

*Units* W/ft<sup>2</sup>

*Input Restrictions* As designed. The default for lighting power for decorative lighting is 0.0 watts. The user is required to specify the purpose for additional interior lighting power allowance through decorative lighting.

*Baseline Building* The modeled Lighting Power in each thermal block in the baseline building is the sum of the product of the LPDs for the space types from Standard 90.1-2019, Table G3.7 and the floor areas for the corresponding spaces. There is no additional allowance for decorative lighting in the baseline building.

### **Unregulated Interior Lighting Power**

<i>Applicability</i>	All projects
<i>Definition</i>	<p>This includes power for lighting equipment and applications exempt from LPD requirements. However, these exceptions apply only to lighting systems that are an addition to general lighting and are controlled by an independent control device.</p> <p>Standard 90.1-2019, Section 9.2.2.3, exempts the following lighting systems from all requirements:</p> <ol style="list-style-type: none"> <li>a. Display or accent lighting that is an essential element for the function performed in galleries, museums, and monuments.</li> <li>b. Lighting that is integral to equipment or instrumentation and is installed by its manufacturer.</li> <li>c. Lighting specifically designed for use only during medical or dental procedures and lighting integral to medical equipment.</li> <li>d. Lighting integral to both open and glass-enclosed refrigerator and freezer cases.</li> <li>e. Lighting integral to food warming and food preparation equipment.</li> <li>f. Lighting specifically designed for the life support of nonhuman life forms.</li> <li>g. Lighting in retail display windows, provided the display area is enclosed by ceiling-height partitions.</li> <li>h. Lighting in interior spaces that have been specifically designated as a registered interior historic landmark.</li> <li>i. Lighting that is an integral part of advertising or directional signage.</li> <li>j. Exit signs.</li> <li>k. Lighting that is for sale or lighting educational demonstration systems.</li> <li>l. Lighting for theatrical purposes, including performance, stage, and film and video production.</li> <li>m. Lighting for television broadcasting in sporting activity areas.</li> <li>n. Casino gaming areas.</li> <li>o. Furniture-mounted supplemental task lighting that is controlled by automatic shutoff and complies with Standard 90.1-2019 Section 9.4.1.3(c).</li> <li>p. Mirror lighting in dressing rooms and accent lighting in religious pulpit and choir areas.</li> <li>q. Parking garage transition lighting—lighting for covered vehicle entrances and exits from buildings and parking structures—that complies with Standard 90.1-2019 Section 9.4.1.2(a) and 9.4.1.2(c); each transition zone shall not exceed a depth of 66 ft inside the structure and a width of 50 ft.</li> </ol>
<i>Units</i>	W/ft <sup>2</sup> or watts
<i>Input Restrictions</i>	As designed. The unregulated lighting power should be cross-referenced to the type of exception and to the construction documents. The default for unregulated lighting power is zero.
<i>Baseline Building</i>	The unregulated interior lighting in the baseline building shall be the same as the proposed design.

**Interior Lighting Power**

<i>Applicability</i>	All spaces or projects
<i>Definition</i>	Interior lighting power is the power used by all installed electric lighting in each space.
<i>Units</i>	Watts
<i>Input Restrictions</i>	Derived – not a user input. The proposed value includes all lighting and is the sum of the proposed <i>Regulated Interior Lighting Power</i> , <i>Additional Lighting Power: Retail Display Lighting Power</i> and <i>Unregulated Interior Lighting Power</i>
<i>Baseline Building</i>	The baseline value is the sum of the baseline <i>Regulated Interior Lighting Power</i> , the <i>Additional Lighting Power: Retail Display Lighting Power</i> and the <i>Unregulated Interior Lighting Power</i> .

**Automatic Interior Lighting Controls (including indoor parking garages)**

<i>Applicability</i>	All projects
<i>Definition</i>	Automatic interior lighting controls include automatic daylight responsive controls for sidelighting and toplighting, occupancy sensors, and programmable controls such as scheduled shutoff controls. Lighting controls included in Section 9.4.1.1 of Standard 90.1-2019 are mandatory and must be included in the proposed building design. Modeling of daylighting controls is discussed in Section 3.4.4. Modeling of occupancy sensors and other automatic controls is accomplished as described below.
<i>Units</i>	List: Control types : <ol style="list-style-type: none"> <li>a. Occupancy Sensor with full automatic on           <p>All of the lighting is automatically controlled to turn on when occupants are detected and turn off within 20 minutes when no occupants are detected in the space</p> </li> <li>b. Occupancy Sensor restricted to partial automatic on           <p>Between 50% and less than 100% of lighting is automatically controlled to turn on when occupants are detected and 100% of the lighting is turned off within 20 minutes when no occupants are detected in the space</p> </li> <li>c. Occupancy Sensor restricted to manual on           <p>None of the lighting is automatically controlled to turn on when occupants are detected and 100% of the lighting is turned off within 20 minutes when no occupants are detected in the space</p> </li> <li>d. Automatic Daylight Responsive Controls for Sidelighting           <p>Refer to Section 3.4.4 for additional details related to daylighting controls.</p> </li> <li>e. Automatic Daylight Responsive Controls for Toplighting           <p>Refer to Section 3.4.4 for additional details related to daylighting controls.</p> </li> <li>f. Scheduled Shut-Off           <p>All lighting in a space automatically shut-off when a space is scheduled to be unoccupied, using either a time of day control device or a signal from an automatic control device or security system.</p> </li> </ol>
<i>Input Restrictions</i>	For each space in the proposed building indicate which control types from the list above are included and the wattage of lighting that is controlled. For spaces where lighting neither exists nor is submitted with design documents, mandatory controls as specified in Standard 90.1-2019 Section 9.4 shall be included.

Credit for lighting controls other than daylighting controls is taken by decreasing the lighting schedule in the proposed building design according to the following.

- Scheduled shut-off in buildings 5,000 ft<sup>2</sup> or greater – no credit.
- Scheduled shut-off in buildings < 5,000 ft<sup>2</sup> – decrease lighting schedule by 10% for all hours in spaces without occupancy sensor controls.
- Occupancy sensors with full automatic on – decrease the lighting schedule by the occupancy sensor reduction factor from Table G3.7 in each space with full automatic on occupancy sensors.
- Occupancy sensors with manual on or partial automatic on - decrease the lighting schedule by the occupancy sensor reduction factor from Table G3.7 multiplied by 1.25 in each space with manual on or partial on occupancy sensors.
- Occupancy sensors of any configuration controlling individual office work stations - decrease the lighting schedule by 30% for lighting with occupancy sensors controlling individual work stations in open office areas.

*Baseline Building* The lighting schedule for the baseline building shall be the same as proposed before lighting control credits described above are taken.

### **Lighting Schedules**

<i>Applicability</i>	All projects
<i>Definition</i>	Schedule of operation for interior lighting power used to adjust the energy use of lighting systems hourly to reflect time-dependent patterns of lighting usage. Different schedules may be defined for different lighting circuits, depending on the capabilities of the software.
<i>Units</i>	Data structure: schedule, fractional (not exceeding 1.0)
<i>Input Restrictions</i>	Actual schedules are required to be used when available. For cases where design schedules are not available, an appropriate schedule from COMNET Appendix C (COMNET 2017) may be used. The schedules for the proposed building shall be modified according to <i>Automatic Interior Lighting Controls</i> and <i>Daylighting Modeling Method</i>
<i>Baseline Building</i>	The baseline building shall use the same lighting schedules as the proposed design, previous to any adjustments made for automatic lighting controls or daylighting controls.

### **Fixture Type**

<i>Applicability</i>	All interior lighting fixtures
<i>Definition</i>	The type of lighting fixture, which is used to determine the light heat gain distribution
<i>Units</i>	List: one of three choices: Recessed with Lens, Recessed/Downlight, Not in Ceiling
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	As designed

**Luminaire Type**

<i>Applicability</i>	All interior lighting fixtures
<i>Definition</i>	The type of lighting luminaire, which is used to determine the light heat gain distribution  The dominant luminaire type determines the daylight dimming characteristics, when there is more than one type of luminaire in the space.
<i>Units</i>	List: Linear Fluorescent, Compact Fluorescent Lighting (CFL), Incandescent, Light Emitting Diode (LED), Metal Halide, Mercury Vapor, High Pressure Sodium
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	As designed

**Light Heat Gain Distribution**

<i>Applicability</i>	All projects
<i>Definition</i>	The distribution of the heat generated by the lighting system that is directed to the space, the plenum, the HVAC return air, or other locations. This input is a function of the luminaire type and location. Luminaires recessed into a return air plenum contribute more of their heat to the plenum or the return air stream if the plenum is used for return air; while pendant mounted fixtures hanging in the space contribute more of their heat to the space. Common luminaire type/space configurations are listed in Table 3, Chapter 18, 2009 ASHRAE Handbook of Fundamentals, summarized in Table 14 below. Typically the data will be linked to a list of common luminaire configurations similar to Table 14 so that the user chooses a luminaire type category and heat gain is automatically distributed to the appropriate locations.
<i>Units</i>	List (of luminaire types) or data structure consisting of a series of decimal fractions that assign heat gain to various locations
<i>Input Restrictions</i>	Default values listed in Table 14 shall be used as a default when the luminaire categories apply. Where lighting fixtures having different heat venting characteristics are used within a single space, the wattage weighted average heat-to-return-air fraction shall be used. When lighting is entered through the LPD input, this value can be specified by the user for the proposed building.
<i>Baseline Building</i>	Same as proposed

Table 14. Light Heat Gain Parameters for Typical Operating Conditions (Based on Table 3, Chapter 18, 2009 ASHRAE Handbook – Fundamentals)

Luminaire	Lamp	Ducted/Direct Return		Plenum Return	
		Space Fraction	Radiative Fraction	Space Fraction	Radiative Fraction
Recessed with Lens	Fluorescent	1.00	0.67	0.45	0.67
	Fluorescent	1.00	0.58	0.69	0.58
	CFL	1.00	0.97	0.20	0.97
	Incandescent	1.00	0.97	0.75	0.97
	LED	1.00	0.97	1.00	0.97
Recessed/Downlight	Metal Halide	1.00	0.97	0.75	0.97
	All	1.00	0.54	1.00	0.54

In this table, the Space Fraction is the fraction of the lighting heat gain that goes to the space; the radiative fraction is the fraction of the heat gain to the space that is due to radiation, with the remaining heat gain to the space due to convection.

Hence:

$$\begin{aligned} \text{Return Air Fraction} &= 1 - \text{Space Fraction} \\ \text{Fraction Radiant} &= \text{Space Fraction} \times \text{Radiative Fraction} \end{aligned}$$

The ASHRAE Handbook of Fundamentals does not distinguish between the short wave and long wave portions of the radiant fraction. For implementation using EnergyPlus (USDOE 2015), 100% of the radiant fraction is assigned to the long wave property in the tool (Field:Fraction Radiant), and the short wave portion (Field:Fraction Visible) is left as default, which is zero.

In addition, the only difference in implementation for fraction radiant vs. fraction visible is that:

- For the long wave portion, the heat absorbed by room surfaces is calculated as the long wave radiation multiplied by the thermal absorptance of the room materials.
- For the short wave portion, the heat absorbed is the short wave radiation multiplied by the solar absorptance of the room materials. For most materials, these values are close, i.e., for gypsum board thermal absorptance = 0.9 and solar absorptance = 0.7.

### 3.4.4 Daylighting Control

This group of building descriptors is applicable for spaces that have daylighting controls or daylighting control requirements. Spaces that have daylighting should be defined separately from spaces that do not.

#### *Daylight Modeling Method*

*Applicability* Daylighted spaces

*Definition* The method used to model daylighting. Building descriptors are provided in this section for an internal daylighting model, two variations of an external daylighting model, and a simplified approach based on power adjustment factors (PAFs):

**Internal daylighting model.** With this method, the simulation model has the capability to model the daylighting contribution for each hour of the simulation and make an adjustment to the lighting power for each hour, taking into account factors such as daylighting availability, geometry of the space, daylighting aperture, control type and the lighting system. The assumption is that the geometry of the space, the reflectance of surfaces, the size and configuration of the daylight apertures, and the light transmission of the glazing are taken from other building descriptors.

**External daylighting model.** An external daylighting model may be used in combination with an hourly simulation program to calculate daylighting savings as long as it produces consistent results and makes use of the key assumptions described below for internal daylighting models. Exterior daylight models include, but are not limited to, the following types of methods:

**Schedule adjustments.** With this method, a space is modeled in a standalone daylighting program to determine the amount of interior daylight available different times of the year and for different times of the day. In addition this program has an electric lighting model that calculates the electricity savings by hour based on interior illuminance and the daylighting control type (switching, dimming etc.). These savings values are converted into a schedule of electric lighting power reduction multipliers. This lighting power reduction schedule is applied to the proposed design energy simulation model and results in reduced electric lighting energy consumption and reduced internal heat gain, both of which are reflected in the proposed design energy consumption.

**Daylight ratio.** With this method, an outside program pre-calculates a relationship between outdoor daylight conditions (illuminances or luminance) and interior illuminance.

Within the rating software, interior illuminance is calculated from the daylighting ratios and the daylight conditions derived from data on the local weather file. The remainder of the calculations are the same as for an internally calculated daylight model where the interior illuminances are compared to an illuminance setpoint and electric lighting power is calculated based on control type. The two most widely used methods of pre-calculating daylighting ratios are the modified daylight factor method and the daylight coefficients method.

- a. The modified daylight factor method uses pre-calculated diffuse and direct illuminance daylight factors and multiplies these by diffuse and direct beam outdoor illuminance from the weather file to calculate interior illuminance (Winkelmann & Selkowitz 1985). Daylight factors are calculated from a simulation of the space that relies on user entered information about the space modeled such as orientation, geometry, material properties (transmittances and reflectance), etc. For any given hour, the interior illuminance at the reference point is calculated by the direct beam angle specific daylight factor multiplied by the outdoor direct beam and clear sky illuminance and this is added to the overcast daylight factor multiplied by the overcast sky illuminance. Outdoor direct beam, clear sky and overcast sky illuminances are calculated from the weather data used in the proposed building energy simulation.
- b. The daylight coefficients method is essentially a similar but more accurate method that relates internal illuminance to the luminance of patches of the sky (Tregenza & Waters 1983). The sky is divided up into patches as defined by altitude and azimuth. The daylight coefficients are ratios of interior illuminance to luminance for patches or areas on the sky dome. An outside daylight simulation program uses information about the space modeled: its orientation, geometry, material properties (transmittances and reflectance), etc., and calculates daylight coefficients for each sky patch. The precalculated daylight coefficients are then used to calculate interior illuminances for each hour. The illuminance for a location with the space at any point in time is the product of the luminance for each sky patch multiplied by the specific daylight coefficient for each sky patch integrated over the entire sky dome. The luminance for each sky patch is calculated from the weather data used in the proposed building energy simulation.

<i>Units</i>	Watts
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable

***Daylight Areas***

<i>Applicability</i>	All daylighted spaces
<i>Definition</i>	<p>The floor area that is daylighted. The skylit area is the portion of the floor area that gets daylighting from a skylight. Two types of sidelighted daylighted areas are recognized. The primary daylighted area is the portion that is closest to the daylighting source and receives the most illumination. The secondary daylighted area is an area farther from the daylighting source, but still receives useful daylight.</p> <p>Sidelighted Areas:</p> <p><u>Primary Sidelighted Area:</u> The primary daylight area for sidelighting is the area near the window with a width equal to the width of the vertical fenestration plus smaller of</p> <ol style="list-style-type: none"> <li>a. One half of the vertical fenestration head height (where head height is the distance from the floor to the top of the glazing) or</li> <li>b. The distance to any 5 ft or higher opaque vertical obstruction.</li> </ol>



The primary sidelighted area depth is the horizontal distance perpendicular to the vertical fenestration, which is the smaller of

- a. One vertical fenestration head height or
- b. The distance to any 5 ft or higher opaque vertical obstruction.

Secondary Sidelighted Area: The total secondary sidelighted area is the combined secondary sidelighted area within a space. Each secondary sidelighted area is directly adjacent to a primary sidelighted area. The secondary sidelighted area width is the width of the vertical fenestration plus, on each side, the smaller of-

- a. One half of the vertical fenestration head height or
- b. the distance to any 5 ft or higher opaque vertical obstruction.

The secondary sidelighted area depth is the horizontal distance perpendicular to the vertical fenestration, which begins at the edge of the primary sidelighted area depth and ends at the smaller of-

- a. One vertical fenestration head height or,
- b. The distance to any 5 ft or higher opaque vertical obstruction.

If the adjacent primary sidelighted area ends at a 5 ft or higher opaque vertical obstruction, there is no secondary sidelighted area beyond such obstruction.

Toplighted Areas under Skylights:

The daylight area under skylights is the combined daylight area under each skylight within a space. The daylight area under each skylight is bounded by the opening beneath the skylight and horizontally in each direction, the smaller of

- a. 70% of the ceiling height ( $0.7 \times CH$ ) or
- b. the distance to the nearest face of any opaque vertical obstruction, where any part of the obstruction is farther away than 70% of the distance between the top of the obstruction and the ceiling ( $0.7 \times [CH - OH]$ , where CH = the height of the ceiling at the lowest edge of the skylight and OH = the height to the top of the obstruction)

Toplighted Areas under Roof Monitors:

The daylight area under roof monitors is the combined daylight area under each roof monitor within each space. The daylight area under each roof monitor is the product of

- a. The width of the vertical fenestration above the ceiling level plus, on each side, the smallest of
  - 2 ft,
  - The distance to any 5 ft or higher vertical obstruction, or
  - The distance to the edge of any primary sidelighted area

And

- b. the smaller of the following horizontal distances inward from the bottom edge of the vertical fenestration:
  - The monitor sill height (MSH) (the vertical distance from the floor to the bottom edge of the monitor glazing).
  - The distance to the nearest face of any opaque vertical obstruction, where any part of the obstruction is farther away than the difference between the height of the obstruction and the monitor sill height (MSH – OH).

*Units* ft<sup>2</sup>

*Input Restrictions* The daylight areas in a space are derived using other modeling inputs like dimensions of the fenestration and ceiling height of the space.

*Baseline Building* Not applicable

**Daylight Control Requirements**

*Applicability* All spaces with daylighting controls

*Definition* The conditions that determine if daylighting has to be modeled in a space.

Standard

The daylighting control system is required to have the following characteristics:

- a. The calibration adjustment control shall be located no higher than 11 ft above the finished floor.
  - b. The photocontrol shall reduce electric lighting in response to available daylight using continuous dimming or with at least one control point between 50% and 70% of design lighting power, a second control point between 20% and 40% of design lighting power or the lowest dimming level the technology allows, and a third control point that turns off all the controlled lighting.
  - c. The calibration shall not require the physical presence of a person at the sensor while the calibration is processing.
- 
- a. The photocontrol shall reduce electric lighting in response to available daylight using continuous dimming or with at least one control point that is between 50% and 70% of design lighting power, a second control point between 20% and 40% of design lighting power or the lowest dimming level the technology allows, and a third control point that turns off all the controlled lighting.
  - b. The calibration shall not require the physical presence of a person at the sensor while the calibration is processing.
  - c. General lighting in overlapping toplighted and sidelighted daylight areas shall be controlled together with general lighting in the daylight area under skylights or daylight area under roof monitors.

*Units*

List:

- Primary Sidelighting Controls
- Secondary Sidelighting Controls
- Toplighting controls

*Input Restrictions*

- a. Primary sidelighted areas where the tops of the existing adjacent structures are twice as high above the windows as their distance from the windows
- b. Sidelighted areas where the total glazing area is less than 20 ft<sup>2</sup>
- c. Retail spaces.

In accordance with Standard 90.1-2019, Section 9.4.1.1(f), automatic controls are required for toplighted areas when the combined input power for all general lighting completely or partially within daylight area under skylights and daylight area under roof monitors is 150 W or greater,

Exceptions to Toplight Area Control Requirements:

- a. Daylighted areas under skylights where it is documented that existing adjacent structures or natural objects block direct beam sunlight for more than 1500 daytime hours per year between 8 a.m. and 4 p.m.
- b. Daylighted areas where the skylight EA is less than 0.006 (0.6%).

$$\text{Skylight Effective Aperture} = \frac{0.85 \times \text{Skylight Area} \times \text{Skylight VT} \times \text{WF}}{\text{Daylit Area under Skylight}}$$

Where:

*Skylight Area* = Total fenestration area of skylights

*Skylight VT* = Area weighted average visible transmittance of skylights as determined in accordance with Standard 90.1-2019, Section 5.8.2.5

*WF* = Area weighted average well factor, where well factor is 0.9 if light well depth is less than 2 ft, or 0.7 if light well depth is 2 ft or greater. Light well depth is measured vertically from the underside of the lowest point on the skylight glazing to the ceiling plane under the skylight.

- c. Buildings in climate zone 8 where the input power of the general lighting within daylight areas is less than 200W.

*Baseline Building* Daylighting controls are not modeled for the baseline building.

***Installed General Lighting Power in the Primary and Toplight Daylit Zone***

*Applicability* Daylighted spaces

*Definition* The installed lighting power of general lighting in the primary and toplight daylit zone. The primary and toplight daylit zone shall be defined on the plans and be consistent with the definition of the primary and toplight daylit zone in the Standard. Note that a separate building descriptor, Fraction of Controlled Lighting, defines the fraction of the lighting power in the space that is controlled by daylighting.

*Units* Watts

*Input Restrictions* As designed

*Baseline Building* Not applicable

**Installed General Lighting Power in the Secondary Daylit Zone**

<i>Applicability</i>	Daylighted spaces
<i>Definition</i>	The installed lighting power of general lighting in the secondary daylit zone. The secondary daylit zone shall be defined on the plans and be consistent with the definition of the secondary daylit zone in the Standard. Note that a separate building descriptor, Fraction of Controlled Lighting, defines the fraction of the lighting power in the space that is controlled by daylighting.
<i>Units</i>	Watts
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable

**Reference Position for Illuminance Calculations**

<i>Applicability</i>	All spaces or thermal zones, depending on which object is the primary container for daylighting controls
<i>Definition</i>	The position of the two daylight reference points within the daylit space. Lighting is maintained at or above the illuminance setpoint. Thus, for step switching controls, the combined daylight illuminance plus uncontrolled electric light illuminance at the reference position must be greater than the setpoint illuminance before the controlled lighting can be dimmed or tuned off for stepped controls. Similarly, dimming controls will be dimmed so that the combination of the daylight illuminance plus the controlled lighting illuminance is equal to the setpoint illuminance.
<i>Units</i>	Data structure
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable

**Daylight Illuminance Setpoint**

<i>Applicability</i>	Spaces with daylighting controls
<i>Definition</i>	The design illuminance for the daylit space for purposes of daylighting control
<i>Units</i>	Footcandles
<i>Input Restrictions</i>	As designed, but should be consistent with the visual tasks in the space and the recommendations of Illuminating Engineering Society of North America (IES) or other lighting design guidance.
<i>Baseline Building</i>	Not applicable. <b>NOTE:</b> If the user input for illumination setpoint is above or below the IESNA specification, the input should be flagged and reported in the compliance reports. The user needs to provide documentation in support of the illumination setpoint specified for the proposed design.

### ***Fraction of Zone Controlled Lighting Power***

<i>Applicability</i>	Spaces with daylighting controls
<i>Definition</i>	The fraction of the zone's electric lighting power that is controlled by the daylight illuminance through all the first and second reference points
<i>Units</i>	Numeric: fraction
<i>Input Restrictions</i>	<p>If there is only one reference point, then a fraction equal to:</p> <p>1.0 – (Fraction of Zone Controlled by First Reference Point) is assumed to have no lighting control.</p> <p>If there are 2 reference points:</p> <p>1.0 – ([Fraction of Zone Controlled by First Reference Point] + [Fraction of Zone Controlled by Second Reference Point]) is assumed to have no lighting control.</p>
<i>Baseline Building</i>	Not applicable

### ***Daylighting Control Type***

<i>Applicability</i>	Spaces with daylighting controls
<i>Definition</i>	<p>The type of control that is used to control the electric lighting in response to daylight available at the reference point. The options are as follows:</p> <ul style="list-style-type: none"> <li>• Stepped dimming controls have discrete steps of light output, but typically the intermediate steps of light output are associated with higher levels of fraction of rated power. When the lights are fully off or fully on, the fraction of rated power matches the fraction of light output. Stepped controls vary the electric input power and lighting output power in discrete, equally spaced steps. See Figure 4.</li> <li>• Continuous dimming controls have a fraction to rated power to fraction of rated output that is a linear interpolation of the minimum power fraction at the minimum dimming light fraction to rated power (power fraction = 1.0) at full light output. See Figure 5.</li> <li>• Continuous dimming + off controls are the same as continuous dimming controls except that these controls can turn all the way off when none of the controlled light output is needed. See Figure 5.</li> </ul>

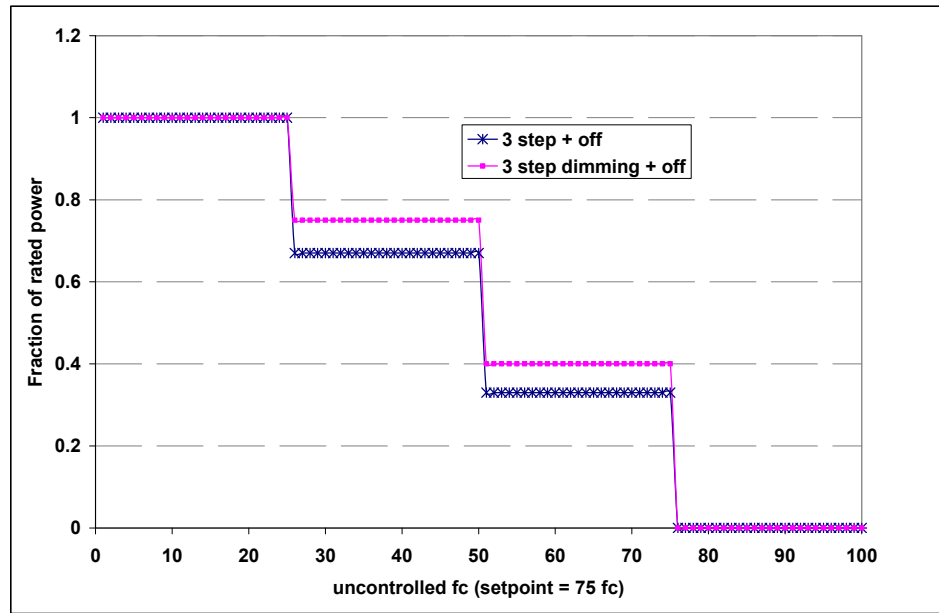


Figure 4. Example Stepped Daylight Control

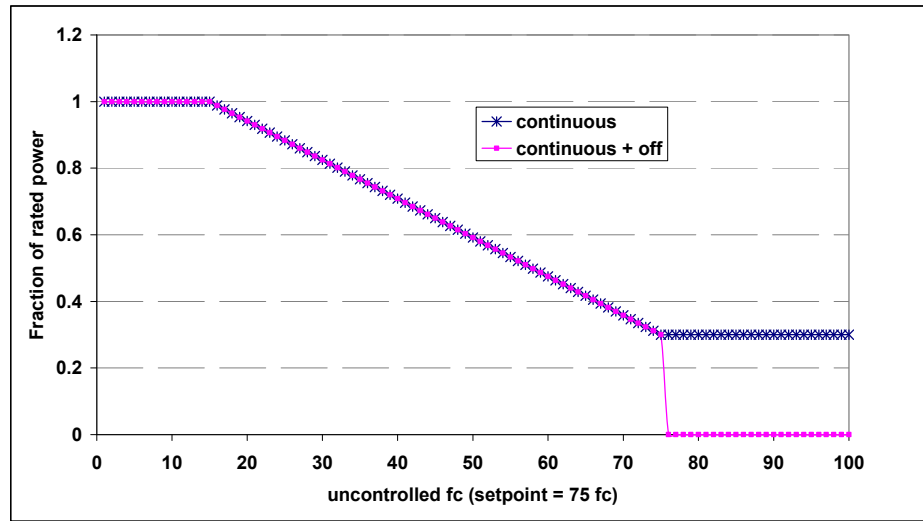


Figure 5. Example Dimming Daylight Control

*Units* List (see above)

*Input Restrictions*

*Baseline Building* Not applicable

**Minimum Dimming Power Fraction**

<i>Applicability</i>	Spaces with daylighting controls
<i>Definition</i>	The minimum power fraction when controlled lighting is fully dimmed. Minimum power fraction = (Minimum power) / (Full rated power).
<i>Units</i>	Numeric: fraction
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable

**Minimum Dimming Light Fraction**

<i>Applicability</i>	Spaces with daylighting controls
<i>Definition</i>	Minimum light output of controlled lighting when fully dimmed. Minimum light fraction = (Minimum light output) / (Rated light output)
<i>Units</i>	Numeric: fraction
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable

**Number of Control Steps**

<i>Applicability</i>	Daylighted spaces that use stepped controls
<i>Definition</i>	Number of control steps. For step dimming, identifies number of steps that require fraction of rated light output and rated power fraction.
<i>Units</i>	Numeric: integer
<i>Input Restrictions</i>	As designed if stepped controls are provided in proposed building
<i>Baseline Building</i>	Not applicable

**3.4.5 Receptacle and Process Loads**

Receptacle loads contribute to heat gains in spaces and directly use energy.

**Receptacle Power**

<i>Applicability</i>	All building projects
<i>Definition</i>	<p>Receptacle power is power for typical general service loads in the building. Receptacle power includes equipment loads normally served through electrical receptacles, such as office equipment and printers, but does not include either task lighting or equipment used for HVAC purposes. Receptacle power values are generally higher than the largest hourly receptacle load that is actually modeled because the receptacle power values are modified by the receptacle schedule, which approaches but does not exceed 1.0.</p> <p>The equipment plugged into receptacles are considered unregulated loads, hence no credit is given for improvements to the efficiency of that equipment, when the PRM is used for compliance with the standard. However, when quantifying performance that exceeds the requirements of Standard 90.1, credit for reductions in receptacle power may be granted as described below under <i>Baseline Building</i>.</p> <p>Control of those receptacles is regulated by Standard 90.1 and that is discussed in descriptor <i>Automatic Receptacle Control</i>.</p>
<i>Units</i>	Total power (W) for the space or power density (W/ft <sup>2</sup> )

Software shall also use the prescribed values below to specify the latent heat gain fraction and the radiative/convective heat gain split.

For software that specifies the fraction of the heat gain that is lost from the space, this fraction shall be prescribed at 0 unless the equipment is located under an exhaust hood.

*Input Restrictions* Receptacle and process loads, such as those for office and other equipment, shall be estimated based on the building type or space type category. These loads shall be included in simulations of the building and shall be included when calculating the baseline building performance and proposed building performance.

For Standard 90.1-2019, receptacle loads in the proposed design may be calculated in one of two ways:

- As designed or assumed by the design team for loads calculation. Great care must be used in the application of space design receptacle loads from HVAC or electrical designers as these may not include appropriate diversity to represent annual operation.
- Standard 90.1-2019 recommended defaults may be used, in which case the same values must be used for the baseline building and there is no credit for reductions.

*Baseline Building* The receptacle power and process loads in the baseline building shall be the same as the proposed design.

However, when quantifying performance that exceeds the requirements of Standard 90.1 (but not when using the Performance Rating as an alternative path for minimum standard compliance), with approval of the rating authority, variations of the power requirements, schedules, or control sequences of the equipment modeled in the baseline building from those in the proposed design shall be allowed by the rating authority based upon documentation that the equipment installed in the proposed design represents a significant verifiable departure from documented conventional practice. In such bases, the baseline shall be determined based on prescriptive requirements in Standard 90.1-2019. When no such prescriptive requirements exist, it shall be equal to requirements of other efficiency or equipment codes or standards applicable to the design of the building systems and equipment.

The burden of this documentation is to demonstrate that accepted conventional practice would result in baseline building equipment different from that installed in the proposed design. If baseline building plug loads differ from the proposed building, this input must be flagged and instructions given to provide the proper documentation.



### ***Receptacle Heat Gain Fraction***

<i>Applicability</i>	All projects
<i>Definition</i>	<p>The electrical input to the equipment ultimately appears as heat that contributes to zone loads. This heat can be divided into four different fractions. These are given by the input fields:</p> <ul style="list-style-type: none"> <li>• <b>Fraction Latent:</b> This field is a decimal number between 0.0 and 1.0 and is used to characterize the amount of latent heat given off by electric equipment in a zone. The number specified in this field will be multiplied by the total energy consumed by electric equipment to give the amount of latent energy produced by the electric equipment. This energy affects the moisture balance within the zone.</li> <li>• <b>Fraction Radiant:</b> This field is a decimal number between 0.0 and 1.0 and is used to characterize the amount of long-wave radiant heat being given off by electric equipment in a zone. The number specified in this field will be multiplied by the total energy consumed by electric equipment to give the amount of long wavelength radiation gain from electric equipment in a zone.</li> <li>• <b>Fraction Lost:</b> This field is a decimal number between 0.0 and 1.0 and is used to characterize the amount of “lost” heat being given off by electric equipment in a zone. The number specified in this field will be multiplied by the total energy consumed by electric equipment to give the amount of heat that is “lost” and does not impact the zone energy balances. This might correspond to electrical energy converted to mechanical work or heat that is vented to the atmosphere.</li> <li>• <b>Fraction Convected:</b> This field is a decimal number between 0.0 and 1.0 and is used to characterize the fraction of the heat from electric equipment convected to the zone air.</li> </ul> <p>The sum of all 4 of these fractions should be 1.</p>
<i>Units</i>	Data structure: fraction
<i>Input Restrictions</i>	<p>As designed. If not specified by the user, default values for receptacle power heat gain fractions will be used.</p> <p>Radiative = 0.20, Latent = 0.00, Convective = 0.80, Lost = 0.00</p>
<i>Baseline Building</i>	Same as proposed

**Receptacle Schedule**

<i>Applicability</i>	All projects
<i>Definition</i>	Schedule for receptacle power loads used to adjust the intensity hourly to reflect time-dependent patterns of usage. These schedules are assumed to reflect the mandatory automatic receptacle control requirements.
<i>Units</i>	Data structure: schedule, fraction
<i>Input Restrictions</i>	Actual schedules shall be used when known. Default schedules documented in COMNET Appendix C (COMNET 2017) can be used when design schedules are not available.
<i>Baseline Building</i>	<p>Schedules for the baseline building shall be identical to those for the proposed design except when-</p> <ul style="list-style-type: none"> <li>• Receptacle controls are installed in spaces not required by Standard 90.1-2019 Section 8.4.2. In this case the schedule can differ between baseline and proposed and the receptacle schedule for the proposed building can be modified as explained in the descriptor 'Automatic Receptacle Control'. Or, when quantifying performance that exceeds the requirements of Standard 90.1 (but not when using the Performance Rating as an alternative path for minimum standard compliance ), with approval of the rating authority, variations of the power requirements, schedules, or control sequences of the equipment modeled in the baseline building from those in the proposed design shall be allowed based upon documentation that the equipment installed in the proposed design represents a significant verifiable departure from documented conventional practice. The burden of this documentation is to demonstrate that accepted conventional practice would result in baseline building equipment different from that installed in the proposed design. If baseline building plug loads differ from the proposed building, this input must be flagged and instructions given to provide the proper documentation.</li> </ul>

**Computer Room Equipment Schedule**

<i>Applicability</i>	All projects with computer rooms
<i>Definition</i>	Schedule for computer room equipment loads used to adjust the intensity hourly to reflect time-dependent patterns of usage. Standard 90.1-2019 requires the use of a randomized schedule for computer rooms. The randomized computer room equipment schedule is intended to capture part load system performance in the proposed and base case models. While it is not realistic to have computer room loads vary drastically month to month, it is common for loads to vary gradually over months or years. The schedule shown here captures this effect in a single annual simulation. It also allows the various load conditions to be simulated under the various weather conditions.
<i>Units</i>	Data structure: schedule, fraction
<i>Input Restrictions</i>	<p>Computer room equipment schedules shall be modeled as a constant fraction of the peak design load per the following monthly schedule:</p> <p>Month 1, 5, 9—25%</p> <p>Month 2, 6, 10—50%</p> <p>Month 3, 7, 11—75%</p> <p>Month 4, 8, 12—100%</p>
<i>Baseline Building</i>	Same as proposed

**Automatic Receptacle Control**

*Applicability* All projects

*Definition* Automatic receptacle controls include devices that control receptacles based on time of day, occupancy sensors or a central control signal based on occupancy as required by Standard 90.1-2019, Section 8.4.2 requires that 50% of all applicable receptacle and 25% of applicable branch circuit feeders to be controlled using automatic receptacle controls which function on either:

- a. A scheduled basis using a time-of-day operated control device that turns receptacles off at specific programmed times. This shall be provided for controlled areas of no more than 5000 ft<sup>2</sup> and not more than one floor (the occupant shall be able to manually override the control device for up to two hours);
- b. An occupant sensor that shall turn receptacles off within 20 minutes of all occupants leaving a space; or
- c. An automated signal from another control or alarm system that shall turn receptacles off within 20 minutes after determining that the area is unoccupied.

All controlled receptacles should be uniformly distributed throughout the space.

Plug-in controls devices cannot be used to comply with these requirements

Exceptions to this requirement include:

- a. Receptacles specifically designated for equipment requiring continuous operation (24/day, 365 days/year).
- b. Spaces where an automatic control would endanger the safety or security of the room or building occupants.

*Units* No units

*Input Restrictions* As designed. For each space in the proposed building indicate which receptacle control strategies from the list above are included and the percentage of receptacles that are controlled. .

When receptacle controls are installed in spaces not required by Standard 90.1-2019 Section 8.4.2, credit for receptacle controls in the proposed design can be taken by decreasing the receptacle schedule in the proposed building design according to the following.

$$RPC = RC \times 10\%$$

Hence, the receptacle schedule for each hour for the proposed building =

$$EPS_{pro} = EPS_{bas} \times (1 - RPC)$$

Where:

*RPC* = Receptacle power credit

*RC* = Percentage of receptacles controlled according to one of the methods described above.

*EPS<sub>bas</sub>* = Baseline equipment power hourly schedule (fraction)

*EPS<sub>pro</sub>* = Proposed equipment power hourly schedule (fraction)

*Baseline Building* Same as proposed before the automatic receptacle control credit is applied

### 3.4.6 Commercial Refrigeration Equipment

Commercial refrigeration equipment includes the following:

- Walk-in refrigerators
- Walk-in freezers
- Refrigerated casework

Walk-in refrigerators and freezers typically have remote condensers. Some refrigerated casework has remote condensers, while some has a self-contained condenser built into the unit. Refrigerated casework with built-in condensers rejects heat directly to the space while remote condensers reject heat in the remote location, typically on the roof or behind the building.

Refrigerated casework can be further classified by the purpose, the type of doors and, when there are no doors, the configuration: horizontal, vertical, or semi-vertical. DOE has developed standards for refrigerated casework. Table 15 shows these classifications along with the standard level of performance, expressed in kWh/d, which depends on the class of equipment, the total display area, and the volume of the casework. Table 16 shows the performance requirements for walk-in refrigerators and freezers.

Table 15. Performance Rating Method for Commercial Refrigerators and Freezers

Equipment Type	Application	Energy Use Limits kWh/day	Test Procedure
Refrigerator with solid doors		$0.125 \times V + 2.76$	
Refrigerator with transparent doors		$0.172 \times V + 4.77$	
Freezers with solid doors	Holding temperature	$0.398 \times V + 2.28$	AHRI 1200
Freezers with transparent doors		$0.94 \times V + 5.10$	
Refrigerators/freezers with solid doors		$0.12 \times V + 4.77$	
Commercial refrigerators	Pulldown	$0.181 \times V + 5.01$	

Note: V is the chiller or frozen compartment volume (ft<sup>3</sup>) as defined in Association of Home Appliance Manufacturers Standard HRF-1.

Table 16. Performance Rating Method for Commercial Casework

Equipment Class <sup>(a)</sup>	Family Code	Operating Mode	Rating Temperature	Energy Use Limits, <sup>(b),(c)</sup> kWh/day	Test Procedure	
VOP.RC.M	Vertical open	Remote condensing	Medium temperature	$1.01 \times TDA + 4.07$	AHRI 1200	
SVO.RC.M	Semivertical open	Remote condensing	Medium temperature	$1.01 \times TDA + 3.18$		
HZO.RC.M	Horizontal open	Remote condensing	Medium temperature	$0.51 \times TDA + 2.88$		
VOP.RC.L	Vertical open	Remote condensing	Low temperature	$2.84 \times TDA + 6.85$		
HZO.RC.L	Horizontal open	Remote condensing	Low temperature	$0.68 \times TDA + 6.88$		
VCT.RC.M	Vertical transparent door	Remote condensing	Medium temperature	$0.48 \times TDA + 1.95$		
VCT.RC.L	Vertical transparent door	Remote condensing	Low temperature	$1.03 \times TDA + 2.61$		
SOC.RC.M	Service over counter	Remote condensing	Medium temperature	$0.62 \times TDA + 0.11$		
VOP.SC.M	Vertical open	Self-contained	Medium temperature	$2.34 \times TDA + 4.71$		
SVO.SC.M	Semivertical open	Self-contained	Medium temperature	$2.23 \times TDA + 4.59$		
HZO.SC.M	Horizontal open	Self-contained	Medium temperature	$1.14 \times TDA + 5.55$		
HZO.SC.L	Horizontal open	Self-contained	Low temperature	$2.63 \times TDA + 7.08$		
VCT.SC.I	Vertical transparent door	Self-contained	Ice Cream	$1.63 \times TDA + 3.29$		
VCS.SC.I	Vertical solid door	Self-contained	Ice Cream	$0.55 \times V + 0.88$		
HCT.SC.I	Horizontal transparent door	Self-contained	Ice Cream	$1.33 \times TDA + 0.43$		
SVO.RC.L	Semivertical open	Remote condensing	Low temperature	$2.84 \times TDA + 6.85$		
VOP.RC.I	Vertical open	Remote condensing	Ice Cream	$3.6 \times TDA + 8.7$		
SVO.RC.I	Semivertical open	Remote condensing	Ice Cream	$3.6 \times TDA + 8.7$		
HZO.RC.I	Horizontal open	Remote condensing	Ice Cream	$0.87 \times TDA + 8.74$		
VCT.RC.I	Vertical transparent door	Remote condensing	Ice Cream	$1.2 \times TDA + 3.05$		
HCT.RC.M	Horizontal transparent door	Remote condensing	Medium temperature	$0.39 \times TDA + 0.13$		
HCT.RC.L	Horizontal transparent door	Remote condensing	Low temperature	$0.81 \times TDA + 0.26$		
HCT.RC.I	Horizontal transparent door	Remote condensing	Ice Cream	$0.95 \times TDA + 0.31$		
VCS.RC.M	Vertical solid door	Remote condensing	Medium temperature	$0.16 \times V + 0.26$		AHRI 1200
VCS.RC.L	Vertical solid door	Remote condensing	Low temperature	$0.33 \times V + 0.54$		
VCS.RC.I	Vertical solid door	Remote condensing	Ice Cream	$0.39 \times V + 0.63$		

Equipment Class <sup>(a)</sup>	Family Code	Operating Mode	Rating Temperature	Energy Use Limits, <sup>(b),(c)</sup> kWh/day	Test Procedure
HCS.RC.M	Horizontal solid door	Remote condensing	Medium temperature	$0.16 \times V + 0.26$	
HCS.RC.L	Horizontal solid door	Remote condensing	Low temperature	$0.33 \times V + 0.54$	
HCS.RC.I	Horizontal solid door	Remote condensing	Ice Cream	$0.39 \times V + 0.63$	
SOC.RC.L	Service over counter	Remote condensing	Low temperature	$1.3 \times TDA + 0.22$	
SOC.RC.I	Service over counter	Remote condensing	Ice Cream	$1.52 \times TDA + 0.26$	
VOP.SC.L	Vertical open	Self-contained	Low temperature	$5.87 \times TDA + 11.82$	
VOP.SC.I	Vertical open	Self-contained	Ice Cream	$7.45 \times TDA + 15.02$	
SVO.SC.L	Semivertical open	Self-contained	Low temperature	$5.59 \times TDA + 11.51$	
SVO.SC.I	Semivertical open	Self-contained	Ice Cream	$7.11 \times TDA + 14.63$	
HZO.SC.I	Horizontal open	Self-contained	Ice Cream	$3.35 \times TDA + 9.0$	
SOC.SC.I	Service over counter	Self-contained	Ice Cream	$2.13 \times TDA + 0.36$	
HCS.SC.I	Horizontal solid door	Self-contained	Ice Cream	$0.55 \times V + 0.88$	

- (a) Equipment class designations consist of a combination (in sequential order separated by periods [AAA].[BB].[C]) of the following:  
 (AAA) An equipment family code (VOP = vertical open, SVO = semivertical open, HZO = horizontal open, VCT = vertical transparent doors, VCS = vertical solid doors, HCT = horizontal transparent doors, HCS = horizontal solid doors, and SOC = service over counter); (BB) An operating mode code (RC = remote condensing and SC = self-contained); and (C) A rating temperature code (M = medium temperature [38°F], L = low temperature [0°F], or I = ice cream temperature [15°F]). For example, “VOP.RC.M” refers to the “vertical open, remote condensing.”
- (b) V is the volume of the case (ft<sup>3</sup>) as measured in AHRI Standard 1200, Appendix C.
- (c) TDA is the total display area of the case (ft<sup>2</sup>) as measured in AHRI Standard 1200, Appendix D.

The PRM doesn’t include standard levels of performance for walk-in refrigerators and freezers. COMNET (COMNET 2017) default values for these are given in Table 17. These values are expressed in W/ft<sup>2</sup> of refrigerator or freezer area. This power is assumed to occur continuously. Some walk-ins have glass display doors on one side so that products can be loaded from the back. Glass display doors increase the power requirements of walk-ins. Additional power is added when glass display doors are present. The total power for walk-in refrigerators and freezers is given in Equation (4).

$$P_{Walk-in} = (A_{Ref} \cdot PD_{Ref} + N_{Ref} \cdot D_{Ref}) + (A_{Frz} \cdot PD_{Frz} + N_{Frz} \cdot D_{Frz}) \tag{4}$$

Where:

- $P_{Walk-in}$  = The estimated power density for the walk-in refrigerator or freezer in (W)
  - $A_{xxx}$  = The area of the walk-in refrigerator or freezer (ft<sup>2</sup>)
  - $N_{xxx}$  = The number of glass display doors (unitless)
  - $PD_{xxx}$  = The power density of the walk-in refrigerator or freezer taken from Table 17 (W/ft<sup>2</sup>)
  - $D_{xxx}$  = The power associated with a glass display door for a walk-in refrigerator or freezer (W/door)
- xxx subscript indicating a walk-in freezer (Frz) or refrigerator (Ref)

Table 17. Default Power for Walk-In Refrigerators and Freezers (W/ft<sup>2</sup>)

Floor Area	Refrigerator	Freezer
100 ft <sup>2</sup> or less	8.0	16.0
101 ft <sup>2</sup> to 250 ft <sup>2</sup>	6.0	12.0
251 ft <sup>2</sup> to 450 ft <sup>2</sup>	5.0	9.5
451 ft <sup>2</sup> to 650 ft <sup>2</sup>	4.5	8.0
651 ft <sup>2</sup> to 800 ft <sup>2</sup>	4.0	7.0
801 ft <sup>2</sup> to 1,000 ft <sup>2</sup>	3.5	6.5
More than 1,000 ft <sup>2</sup>	3.0	6.0
Additional Power for Each Glass Display Door	105	325

Source: These values are determined using the procedures of the Heatcraft Engineering Manual, Commercial Refrigeration Cooling and Freezing Load Calculations and Reference Guide, August 2006. The energy efficiency ratio (EER) is assumed to be 12.39 for refrigerators and 6.33 for freezers. The specific efficiency is assumed to be 70 for refrigerators and 50 for freezers. Operating temperature is assumed to be 35°F for refrigerators and -10°F for freezers.

### Refrigeration Modeling Method

<i>Applicability</i>	All buildings that have commercial refrigeration for cold storage or display
<i>Definition</i>	<p>The method used to estimate refrigeration energy and to model the thermal interaction with the space where casework is located. Three methods are included in this manual:</p> <ul style="list-style-type: none"> <li>• Modeling Defaults COMNET defaults. With this method, the methodology described above can be used for modeling walk-in refrigerators and freezers. Schedules are assumed to be continuous operation.</li> <li>• Performance rating method. With this method, the energy modeler takes inventory of the refrigerated casework in the rated building and sums the rated energy use (typically in kWh/day). All refrigeration equipment is then assumed to operate continuously.</li> <li>• Explicit refrigeration model. With this method, all components of the refrigeration system are explicitly modeled in DOE-2.2R or another hourly simulation program with this capability. This method is not covered by this manual.</li> <li>• AHRI Rated Energy. Rated energy use in accordance to AHRI 1200.</li> </ul>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	<p>When refrigeration equipment in the proposed design is rated in accordance with AHRI 1200, the rated energy use shall be modeled.</p> <p>For all other refrigeration equipment shall be modeled using actual equipment capacities and efficiencies using the performance rating method. If actual equipment capacities and efficiencies are not know, COMNET defaults can be used.</p>
<i>Baseline Building</i>	If refrigeration equipment is listed in Table 15 and Table 16 of this manual, then the baseline building design shall be modeled according to Table 15 and Table 16. For refrigeration equipment not listed in either of these two tables, the baseline building shall be modeled to be the same as the proposed design.

### Refrigeration Power

<i>Applicability</i>	All buildings or spaces that have commercial refrigeration for cold storage or display and do not use the explicit refrigeration model
<i>Definition</i>	Commercial refrigeration power is the average power for all commercial refrigeration equipment, assuming constant year-round operation. Equipment includes walk-in refrigerators and freezers, open refrigerated casework, and closed refrigerated casework. It does not include residential type refrigerators used in kitchenettes or refrigerated vending machines. These are covered under <i>receptacle power</i> .
<i>Units</i>	Kilowatts (kW) or W/ft <sup>2</sup>
<i>Input Restrictions</i>	With the performance rating method, refrigeration power is estimated by summing the kWh/day for all the refrigeration equipment in the space and dividing by 24 hours. The refrigeration power for walk-in refrigerators and freezers is added to this value.
<i>Baseline Building</i>	<p>When the performance rating method is used, refrigeration power for casework shall be determined from Table 15 and Table 16; the power for walk-in refrigerators and freezers shall be the same as the proposed design.</p> <p>However, variations of the power requirements, schedules, or control sequences of the refrigeration equipment modeled in the baseline building from those in the proposed design shall be allowed by the rating authority based upon documentation that the refrigeration equipment installed in the proposed design represents a significant verifiable departure from documented conventional practice.</p> <p>The burden of this documentation is to demonstrate that accepted conventional practice would result in Baseline Building refrigeration equipment different from that installed in the proposed design. Occupancy and occupancy schedules shall not be changed.</p> <p><b>NOTE:</b> Any variation between proposed and baseline refrigeration power should be reported for rating authority approval and inspection.</p>

### Remote Condenser Fraction

<i>Applicability</i>	All buildings that have commercial refrigeration for cold storage or display and use the DOE performance ratings methods
<i>Definition</i>	<p>The fraction of condenser heat that is rejected to the outdoors. For self-contained refrigeration casework, this value will be zero. For remote condenser systems, this value is 1.0 and the heat gain fraction to the space through the condenser is zero. For combination systems, the value should be weighted according to refrigeration capacity.</p> <p>For refrigeration with self-contained condensers and compressors, the heat that is removed from the space is equal to the heat that is rejected to the space, since the evaporator and condenser are both located in the same space. There may be some latent cooling associated with operation of the equipment, but this may be ignored with the DOE performance ratings methods. The operation of self-contained refrigeration units may be approximated by adding a continuously operating electric load to the space that is equal to the energy consumption of the refrigeration units. Self-contained refrigeration units add heat to the space that must be removed by the HVAC system. Hence, in the scenario where the compressor or compressor rack for the case is separate from the case itself but still within the conditioned zone of the display cases, the remote condenser fraction is zero and all the heat ends up in the zone. For self contained cases, the heat added to the zone is calculated as shown below,</p>

$$Q_{\text{sensible credit}} = -(kW \times 3.413)$$



Where

$kW$  = The power of the refrigeration system determined by using the DOE performance rating method (kW)

$Q_{\text{sensible-credit}}$  = The rate of heat removal from the space due to the continuous operation of the refrigeration system (Btu/h). A positive number means that heat is being removed from the space. A negative number means heat is being added to the space.

When the condenser is remotely located, heat is removed from the space but rejected outdoors. In this case, the refrigeration equipment functions in a manner similar to a continuously running split system air conditioner. Some heat is added to the space for the evaporator fan, the anti-fog heaters, and other auxiliary energy uses, but refrigeration systems with remote condensers remove more heat from the space where they are located than they add. The HVAC system must compensate for this imbalance.

For remotely located condensers using the DOE performance rating method, the heat that is removed from the space, i.e. the  $Q_{\text{sensible credit}}$ , is determined as follows:

$$Q_{\text{sensible-credit}} = [Q_{\text{rated}} * (1 - \text{LHR}_{\text{rated}}) * \text{RTF} - (Q_{\text{rated}} * \text{Elec}_{\text{ratio}})] * L_{\text{case}}$$

Where

$Q_{\text{sensible-credit}}$  = The rate of heat removal from the space due to the continuous operation of the refrigeration system (Btu/h). A positive number means that heat is being removed from the space.

$Q_{\text{rated}}$  = case gross rated total refrigeration cooling capacity per unit length (Btu/h)

$\text{LHR}_{\text{rated}}$  = latent heat ratio of the refrigerated case at rated conditions

$\text{RTF}$  = runtime fraction of the refrigerated case

$\text{Elec}_{\text{ratio}}$  = Ratio of cooling capacity required due to cooling load associated with use of lights, fans, anti-sweat heaters divided by  $Q_{\text{rated}}$ . Depending on case design, not all electric power per unit length may contribute to cooling load.

$L_{\text{case}}$  = length of the case, ft

Use manufacturer data where available. If unavailable, use the defaults below. Note: these defaults are based on data from a single manufacturer.

Type	Average Ratio of Elec Input to Total BTUH	Average Ratio of Latent Heat to Total BTUH	Average Calculated RTF (runtime fraction of the refrigerated case)
HZO-M	0.15	0.31	0.69
HZO-L	0.29	0.18	0.74
HZO-I	0.28	0.18	0.74
SOC-M	0.70	0.09	0.86
SOC-L	0.71	0.09	0.89
SOC-I	0.67	0.08	0.85
SVO-M	0.14	0.28	0.68
SVO-L	0.21	0.24	0.71
SVO-I	0.12	0.35	0.67

VCT-M	0.54	0.11	0.78
VCT-L	0.70	0.07	0.86
VCT-I	0.67	0.08	0.85
VOP-M	0.17	0.25	0.69
VOP-L	0.21	0.24	0.71
VOP-I	0.12	0.35	0.67
HCT-M	0.54	0.11	0.78
HCT-L	0.70	0.07	0.86
HCT-I	0.67	0.08	0.85
VCT-M	0.62	0.10	0.82
VCT-L	0.71	0.08	0.88
VCT-I	0.67	0.08	0.85
HCS-M	0.62	0.10	0.82
HCS-L	0.71	0.08	0.88
HCS-I	0.67	0.08	0.85

<i>Units</i>	Fraction
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as the proposed design

### **Refrigeration COP**

<i>Applicability</i>	All buildings that have commercial refrigeration for cold storage or display and use the DOE performance ratings methods
<i>Definition</i>	The coefficient of performance (COP) of the refrigeration system. This is used only to determine the heat removed or added to the space, not to determine the refrigeration power or energy.
<i>Units</i>	Fraction
<i>Input Restrictions</i>	This value is prescribed to be 3.6 for refrigerators and 1.8 for freezers <sup>1</sup>
<i>Baseline Building</i>	Same as the proposed design

### **Refrigeration Schedule**

<i>Applicability</i>	All buildings that have commercial refrigeration for cold storage or display
<i>Definition</i>	The schedule of operation for commercial refrigeration equipment. This is used to convert refrigeration power to energy use.
<i>Units</i>	Data structure: schedule, fractional
<i>Input Restrictions</i>	Continuous operation is prescribed
<i>Baseline Building</i>	Same as the proposed design

<sup>1</sup> These values are consistent with the assumptions for the default values for walk-ins, which assume an EER of 12.39 for refrigerators and 6.33 for freezers.

### 3.4.7 Elevators, Escalators, and Moving Walkways

Elevators, escalators, and moving walkways account for 3% to 5% of electric energy use in buildings.<sup>1</sup> Buildings up to about five to seven stories typically use hydraulic elevators because of their lower initial cost. Mid-rise buildings commonly use traction elevators with geared motors, while high-rise buildings typically use gearless systems where the motor directly drives the sheave. The energy using components include the motors and controls as well as the lighting and ventilation systems for the cabs.

Elevators are custom designed for each building. In this respect they are less like products than they are engineered systems, e.g., they are more akin to chilled water plants where the engineer chooses a chiller, a tower, pumping, and other components, which are field engineered into a system. The main design criteria are safety and service. Some manufacturers have focused on energy efficiency of late and introduced technologies such as advanced controls that optimize the position of cars for minimum travel and regeneration motors that become generators when a loaded car descends or an empty car rises. These technologies can result in 35% to 40% savings.<sup>2</sup>

The motors and energy using equipment is often located within the building envelope so it produces heat that must be removed by ventilation or by air conditioning systems. In energy models, a dedicated thermal zone (elevator shaft) will typically be created and this space can be indirectly cooled (from adjacent spaces) or positively cooled. Motors, drives, and braking equipment are usually located in a separate space that is often cooled by independent cooling equipment. The elevator energy use should be divided equally between the shaft and the equipment room. In the scenario, where geometrically modeling a separate elevator shaft is complicated, it is acceptable to model separate “virtual” shaft space/zones on each floor. These spaces need to be identified so that they’re not included in the gross floor area calculation.

#### *Elevator/Escalator Power*

<i>Applicability</i>	All buildings that have elevators, escalators, or moving walkways
<i>Definition</i>	The power for elevators, escalators, and moving walkways for different modes of operation. Elevators typically operate in three modes: active (when the car is moving passengers), ready (when the lighting and ventilation systems are active but the car is not moving), and standby (when the lights and ventilation systems are off). Escalators and moving walkways are either active or turned off.
<i>Units</i>	W/unit
<i>Input Restrictions</i>	The power values for different modes of operation for elevators, escalators, and moving walkways can be defined by the user if that information is available for the specific equipment being installed.
<i>Baseline Building</i>	Escalator power shall be same as proposed. However, when quantifying performance that exceeds the requirements of Standard 90.1 (but not when using the Performance Rating as an alternative path for minimum standard compliance ), with approval of the rating authority, variations of the power requirements, schedules, or control sequences of escalators modeled in the baseline building from those in the proposed design shall be allowed by the rating authority based upon

<sup>1</sup> Sachs, Harvey M., Opportunities for Elevator Energy Efficiency Improvements, American Council for an Energy Efficient Economy, April 2005.

documentation that the equipment installed in the proposed design represents a significant verifiable departure from documented conventional practice.

The elevator peak motor power shall be calculated as follows:

$$\text{bhp} = (\text{Weight of Car} + \text{Rated Load} - \text{Counterweight}) \times \text{Speed of Car} / (33,000 \times h_{\text{mechanical}}) \tag{5}$$

$$P_m = \text{bhp} \times 746 / h_{\text{motor}} \tag{6}$$

Where:

Weight of Car = the proposed design elevator car weight, lb

Rated Load = the proposed design elevator load at which to operate, lb

Counterweight of Car = the elevator car counterweight, from Table 18, lb

Speed of Car = the speed of the proposed elevator, ft/min

$h_{\text{mechanical}}$  = the mechanical efficiency of the elevator from Table 18

$h_{\text{motor}}$  = the motor efficiency from Table G3.9.2

$P_m$  = peak elevator motor power, W

The percent of peak power for each mode of operation specified in Table 18 shall be the same as proposed.

Table 18. Baseline Elevator Motor

Number of Stories (Including Basement)	Motor Type	Counterweight	Mechanical Efficiency	Motor Efficiency
≤ 4	Hydraulic	None	58%	Table 19
>4	Traction	Proposed design counterweight, if not specified use weight of the car plus 40% of the rated load	64%	Table 20

Table 19. Motor Efficiency Requirements for Hydraulic Motors

Horsepower	Full-Load Efficiency
10	72%
20	75%
30	78%
40	78%
100	80%

Table 20. Motor Efficiency Requirements for Traction Motors

Motor Horsepower	Minimum Nominal Full-Load Efficiency, %
1	82.5
1.5	84
2	84
3	87.5
5	87.5
7.5	89.5
10	89.5
15	91
20	91
25	92.4
30	92.4
40	93
50	93
60	93.6
75	94.1
100	94.5
125	94.5
150	95
200	95

#### *Elevator/Escalator Schedule*

<i>Applicability</i>	All buildings that have commercial elevators, escalators, or moving walkways
<i>Definition</i>	The schedule of operation for elevators, escalators, and moving walkways. This is used to convert elevator/escalator power to energy use.
<i>Units</i>	Data structure: schedule, state
<i>Input Restrictions</i>	The schedule specified for the building should match the operation patterns of the building. If no schedules are present, defaults based NACM <sup>1</sup> (CEC 2016) on the building area type or space type may be used.
<i>Baseline Building</i>	<p>Same as the proposed design</p> <p>However, with approval of the rating authority variations of the schedules, or control sequences of elevators, escalators, and moving walkways modeled in the baseline building from those in the proposed design shall be allowed based upon documentation that operation of the elevators, escalators, and moving walkways installed in the proposed design represent a significant verifiable departure from documented conventional practice.</p> <p><b>NOTE:</b> If elevators, escalators, and moving walkways loads/schedule for the baseline building differ from the proposed design, this needs to be flagged and reported in the compliance reports.</p>

<sup>1</sup> [http://www.energy.ca.gov/title24/2016standards/ACM\\_Supporting\\_Content//](http://www.energy.ca.gov/title24/2016standards/ACM_Supporting_Content//)

***Elevator/Escalator Ventilation Fan Power***

<i>Applicability</i>	All buildings that have commercial elevators
<i>Definition</i>	The schedule of operations for elevator ventilation fans
<i>Units</i>	Watts
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	The baseline elevator cab ventilation shall be 0.33 W/cfm and will be modeled with the same airflow as the proposed design.

***Elevator/Escalator Ventilation Fan Schedule***

<i>Applicability</i>	All buildings that have commercial elevators
<i>Definition</i>	The schedule of operation for the ventilation fan for the elevator cab
<i>Units</i>	Data structure: schedule, state
<i>Input Restrictions</i>	As designed. The elevator cab ventilation is required to be de-energized while the elevator is in standby mode or off. Therefore ventilation fans shall be modeled with the same schedule as the elevator motor.
<i>Baseline Building</i>	The baseline elevator ventilation fan shall be modeled to run continuously

***Elevator/Escalator Lighting Power***

<i>Applicability</i>	All buildings that have commercial elevators
<i>Definition</i>	The lighting power density for the elevator cab
<i>Units</i>	Watts
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	The baseline elevator cab lighting power density shall be 3.14 W/ft <sup>2</sup> and based on the same size elevators as the proposed design.

***Elevator/Escalator Lighting Schedule***

<i>Applicability</i>	All buildings that have commercial elevators
<i>Definition</i>	The schedule of operation for the elevator cab lighting
<i>Units</i>	Data structure: schedule, state
<i>Input Restrictions</i>	As designed. The elevator cab lighting is required to be de-energized while the elevator is in standby mode or off. Therefore cab lighting shall be modeled with the same schedule as the elevator motor.
<i>Baseline Building</i>	The baseline elevator cab lighting shall be modeled to run continuously

**3.4.8 Gas Process Equipment**

Commercial gas equipment includes the following:

- Ovens
- Fryers
- Grills
- Other equipment

The majority of gas equipment is located in the space, but is often placed under an exhaust hood, and may contribute both sensible and latent heat. Gas equipment is typically modeled by specifying the rate of peak gas consumption and modifying this with a fractional schedule. Energy consumption data for gas equipment is only beginning to emerge.

Because of these limits, the procedure for commercial gas is limited. The procedure consists of default values for power density for both the proposed design and the baseline building. These defaults can be overridden if actual values are known. No credit for commercial gas energy efficiency features is offered.

COMNET Appendix B (COMNET 2017) specifies default values that can be used for process and gas loads. Schedules are specified in COMNET Appendix C (COMNET 2017) that reflect diversity in equipment operation. Process and gas loads can also be specified through an input for peak equipment power and associated diversity schedule.

### **Gas Equipment Power and Power Density**

<i>Applicability</i>	All buildings that have commercial gas equipment
<i>Definition</i>	Commercial gas power density is the peak power for commercial gas equipment, with operation schedules defined through a separate descriptor.  The gas equipment energy use can also be defined through an input of peak gas equipment power with operation schedules defined through a separate descriptor.
<i>Units</i>	Btu/h or Btu/h-ft <sup>2</sup>
<i>Input Restrictions</i>	As designed. For cases where design values are not available, defaults specified in COMNET Appendix B (COMNET 2017) may be used.
<i>Baseline Building</i>	Same as the proposed design. However, when quantifying performance that exceeds the requirements of Standard 90.1 (but not when using the Performance Rating as an alternative path for minimum standard compliance ), variations of the power requirements, schedules, or control sequences of the gas equipment modeled in the baseline building from those in the proposed design shall be allowed by the rating authority based upon documentation that the gas equipment installed in the proposed design represents a significant verifiable departure from documented conventional practice.  The burden of this documentation is to demonstrate that accepted conventional practice would result in baseline building gas equipment different from that installed in the proposed design. Occupancy and occupancy schedules shall not be changed.

**NOTE: ANY VARIATION BETWEEN PROPOSED AND BASELINE GAS EQUIPMENT POWER SHOULD BE FLAGGED FOR RATING AUTHORITY APPROVAL AND INSPECTION.**

### **Gas Equipment Heat Gain Fractions**

<i>Applicability</i>	All projects
<i>Definition</i>	The fuel input to the gas equipment ultimately appears as heat that contributes to zone loads. This heat can be divided into four different fractions. These are given by the input fields. <ul style="list-style-type: none"> <li>• Fraction Latent: This field is a decimal number between 0.0 and 1.0 and is used to characterize the amount of latent heat given off by the gas equipment in a zone. The number specified in this field will be multiplied by the total energy consumed by gas equipment to give the amount of latent energy produced by the gas equipment. This energy affects the moisture balance within the zone.</li> <li>• Fraction Radiant: This field is a decimal number between 0.0 and 1.0 and is used to characterize the amount of long-wave radiant heat being given off by gas equipment in a</li> </ul>

zone. The number specified in this field will be multiplied by the total energy consumed by gas equipment to give the amount of long wavelength radiation gain from electric equipment in a zone.

- **Fraction Lost:** This field is a decimal number between 0.0 and 1.0 and is used to characterize the amount of “lost” heat being given off by gas equipment in a zone. The number specified in this field will be multiplied by the total energy consumed by gas equipment to give the amount of heat that is “lost” and does not impact the zone energy balances. This might correspond to gas energy converted to mechanical work or heat that is vented to the atmosphere.
- **Fraction Convected:** This field is a decimal number between 0.0 and 1.0 and is used to characterize the fraction of the heat from gas equipment convected to the zone air.

The sum of all 4 of these fractions should be 1.

<i>Units</i>	Data structure: fraction
<i>Input Restrictions</i>	As designed. If not specified by the user, default values for gas equipment heat gain fractions will be used.  For software that specifies the fraction of the heat gain that is lost from the space, this fraction shall be defaulted to 0.70.  The default values for fraction radiant, fraction latent, and fraction convected will be specified as 0.15, 0.05, and 0.10 respectively.
<i>Baseline Building</i>	Same as proposed

#### **Gas Equipment Schedule**

<i>Applicability</i>	All buildings that have commercial gas equipment
<i>Definition</i>	The schedule of operation for commercial gas equipment. This is used to convert gas power to energy use.
<i>Units</i>	Data structure: schedule, fractional
<i>Input Restrictions</i>	As determined by building owner or design professional
<i>Baseline Building</i>	Same as the proposed design

#### **Gas Equipment Location**

<i>Applicability</i>	All buildings that have commercial gas equipment
<i>Definition</i>	The assumed location of the gas equipment for modeling purposes. Choices are in the space or external.
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Same as the proposed design

### **3.5 Building Envelope Data**

The user shall provide accurate descriptions for all building envelope assemblies including exterior walls, windows, doors, roofs, exterior floors (including floors above unconditioned spaces), slab-on-grade floors, below grade walls, and below grade floors. The user shall provide data for all of the required descriptors listed in Section 3.5 of this document that correspond with these assemblies. However, the following exception applies:



- Exterior surfaces whose azimuth orientation and tilt differ by no more than 45° and are otherwise the same may be described as a single surface or described using multipliers. This specification would permit a circular form to be described as an octagon.

For unenclosed spaces such as parking garages, crawlspaces and attics, refer to Section 2.4.3 of this manual for modeling requirements.

### 3.5.1 Building Orientation

#### **Orientation**

<i>Applicability</i>	All projects
<i>Definition</i>	The building orientation
<i>Units</i>	Degrees (°)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	The baseline building performance shall be generated by simulating the building with its actual orientation and again after rotating the entire building 90, 180, and 270 degrees, then averaging the results. The building shall be modeled so that it does not shade itself.

Exceptions:

- If it can be demonstrated to the satisfaction of the Program Evaluator that the building orientation is dictated by site considerations.
- Buildings where the vertical fenestration area on each orientation varies by less than 5%.

**NOTE:** Exception ‘a’ would need a flag on the software tool user interface, and if checked, it would need to be supported through documentation.

### 3.5.2 Materials

Energy simulation programs commonly define construction assemblies by listing a sequence of material layers that make up the construction assembly. Typical construction assemblies and their respective material layers are defined in Normative Appendix A of Standard 90.1-2019.

#### **Material Name**

<i>Applicability</i>	When construction assemblies reference materials that are not standard
<i>Definition</i>	The name of a construction material used in the exterior envelope of the building
<i>Units</i>	Text, unique
<i>Input Restrictions</i>	Material name is a required input for materials not available from the standard list. The user may not modify entries for predefined materials.
<i>Baseline Building</i>	Not applicable

**Density**

<i>Applicability</i>	All non-standard materials
<i>Definition</i>	The density (or mass per unit of volume) of the construction material
<i>Units</i>	lb/ft <sup>3</sup>
<i>Input Restrictions</i>	Density is a required input when non-standard materials are specified as documented in an ASHRAE handbook, a comparably reliable reference, or manufacturers' literature
<i>Baseline Building</i>	Not applicable

**Specific Heat**

<i>Applicability</i>	All non-standard materials
<i>Definition</i>	The specific heat capacity of a material is numerically equal to the quantity of heat that must be supplied to a unit mass of the material to increase its temperature by 1°F
<i>Units</i>	Btu/lb·°F
<i>Input Restrictions</i>	Specific heat is a required input when non-standard materials are specified. The specific heat capacity of the construction material as documented in an ASHRAE handbook, a comparably reliable reference, or manufacturers' literature.
<i>Baseline Building</i>	Not applicable

**Thermal Conductivity**

<i>Applicability</i>	All non-standard materials
<i>Definition</i>	The thermal conductivity of a material of unit thickness is numerically equal to the quantity of heat that will flow through a unit area of the material when the temperature difference through the material is 1 °F.
<i>Units</i>	Btu/h·ft·°F
<i>Input Restrictions</i>	Thermal conductivity is a required input for non-standard materials as documented in an ASHRAE handbook, a comparably reliable reference, or manufacturers' literature.
<i>Baseline Building</i>	Not applicable

**Thickness**

<i>Applicability</i>	All non-standard materials
<i>Definition</i>	The thickness of a material
<i>Units</i>	ft or in.
<i>Input Restrictions</i>	Thickness is a required input for non-standard materials
<i>Baseline Building</i>	Not applicable

**3.5.3 Construction Assemblies**

For use with Standard 90.1-2019, construction assemblies for the proposed design shall be created by selecting from a library of building construction layers in Standard 90.1-2019, Appendix A. The software shall specify all composite layers that consist of both framing and insulation and shall use established methods defined in the Standard 90.1- 2019 Appendix A or the ASHRAE Handbook of Fundamentals for calculating effective R-values of composite layers.

**Assembly Name**

<i>Applicability</i>	All projects
<i>Definition</i>	The name of a construction assembly that describes a roof, wall, or floor assembly. The name generally needs to be unique so it can be referenced precisely by surfaces.
<i>Units</i>	Text: unique
<i>Input Restrictions</i>	Construction name is a required input
<i>Baseline Building</i>	Not applicable

**Specification Method**

<i>Applicability</i>	All projects
<i>Definition</i>	The method of describing a construction assembly. The simpler method is to describe the U-factor of the construction assembly, which can account for thermal bridging and other factors. However, this method does not account for the time delay of heat transfer through the construction assembly. Generally, with the U-factor method, heat transfer is assumed to occur instantly. The more complex method is to describe the construction assembly as a series of layers, each layer representing a material. With this method, heat transfer is delayed in accord with the thermal mass and other properties of the assembly. For below-grade constructions, a C-factor can be specified; for slab-on-grade constructions, an F-factor is specified.
<i>Units</i>	List: layers, U-factor, C-factor, F-factor, R-value
<i>Input Restrictions</i>	The layers method shall be used for all constructions except for metal building or similar constructions with negligible thermal mass may use the U-factor method
<i>Baseline Building</i>	Construction assembly for the baseline building will be defined in layers

**Layers**

<i>Applicability</i>	All construction assemblies that use the layers method of specification
<i>Definition</i>	A structured list of material names that describe a construction assembly, beginning with the exterior finish and progressing through the assembly to the interior finish. Materials are described in Section 3.5.2
<i>Units</i>	List: layers of construction assembly
<i>Input Restrictions</i>	The user is required to describe all layers in the actual assembly and model the proposed design based on the layer descriptions
<i>Baseline Building</i>	See building descriptors for roofs, exterior walls, exterior floors, doors, fenestration, and below-grade walls

### 3.5.4 Roofs

#### Geometry

The geometry of roofs, walls, floors, doors, and fenestration should match the construction documents or as-built drawings as accurately as possible. Curved surfaces such as a dome or semi-circular wall may be approximated by a series of flat constructions with orientation or tilt differences of no more than 45 degrees from the actual surface.

#### **Roof Name**

<i>Applicability</i>	All roof surfaces
<i>Definition</i>	A unique name or code that identifies the roof and ties it to the construction documents submitted for energy code review. It is not mandatory to name roofs.
<i>Units</i>	Text: unique
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	None

#### **Roof Type**

<i>Applicability</i>	All roof surfaces
<i>Definition</i>	One of three classifications of roofs defined in Standard 90.1-2019, i.e., insulation entirely above deck, metal building, and attic and other. The prescriptive U-factor requirements for roofs depend on the type. The PRM fixes the type for the baseline building to “insulation entirely above deck.”
<i>Units</i>	List: Attic and Other Roofs; Metal Building Roofs; and Roofs with Insulation Entirely Above Deck
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	The baseline building roof type is of the type “insulation entirely above deck.” Refer to descriptor ‘Roof Construction’ for more details.

#### **Roof Geometry**

<i>Applicability</i>	All roofs, required input
<i>Definition</i>	Roof geometry defines the position, orientation, azimuth, tilt, and dimensions of the roof surface. The geometry of roofs should match the construction documents or as-built drawings as accurately as possible. Unusual curved surfaces such as a dome or semi-circular wall may be approximated by a series of flat constructions with orientation or tilt differences of no more than 45 degrees from the actual surface. The details of how the coordinate system is implemented may vary among software programs. The data structure for surfaces is described in Section 3.11.3 of this manual.
<i>Units</i>	Data structure: surface
<i>Input Restrictions</i>	The only restriction is that the surfaces defined must agree with the building being modeled, as represented on the construction drawings or as-built drawings
<i>Baseline Building</i>	Roof geometry will be identical in the proposed and baseline building designs

**Roof Construction**

<i>Applicability</i>	All roofs, required input
<i>Definition</i>	A specification containing a series of layers that result in a construction assembly for the proposed design. The first layer in the series represents the outside (or exterior) layer and the last layer represents the inside (or interior) layer. See the building descriptors above for roof construction type.
<i>Units</i>	List: layers
<i>Input Restrictions</i>	The construction assembly, as designed, defined by a series of layers. Each layer specified must consist of materials as described in Section 3.5.2.  <b>NOTE:</b> Table A9.2A in Standard 90.1-2019 Appendix A specifies the effective insulation/framing layer R-values for roof and floor insulation installed between metal framing 4' OC. These values are intended to be used for all other framing, 16", 2' and 3'.
<i>Baseline Building</i>	Roofs in the baseline building are of the type "insulation entirely above deck." The insulation requirement is determined by climate zone and baseline standard. The baseline building roof construction shall be modeled as layers.  For new construction, the baseline building roof type is insulation above deck. The U-factor required for baseline roof construction is defined in Table 21. The layer by layer construction corresponding to each U-factor shall be modeled as shown in Table 22. For existing buildings, the baseline roof shall follow the same rules as new buildings.

Table 21. Standard 90.1-2019 Requirements for Baseline Roof Insulation for each Space Conditioning Category

	U-Factor (Btu/ ft <sup>2</sup> ·°F·h/)		
	Nonresidential	Residential	Semiheated
Climate Zone 0 and 1	0.063	0.063	1.282
Climate Zone 2	0.063	0.063	0.218
Climate Zone 3	0.063	0.063	0.218
Climate Zone 4	0.063	0.063	0.218
Climate Zone 5	0.063	0.063	0.173
Climate Zone 6	0.063	0.063	0.173
Climate Zone 7	0.063	0.063	0.173
Climate Zone 8	0.048	0.048	0.093

Table 22. Standard 90.1-2019 Baseline Building Roof Construction Assemblies

Construction	Layer	Thickness (inch)	Conductivity (Btu/h ft F)	Density (lb/ft <sup>2</sup> )	Specific Heat (Btu/lb F)	R-value (ft <sup>2</sup> ·°F·h/ Btu)	U-Factor
Roof R-20 c.i.	Exterior air film					0.17	
	Roofing membrane					0.00	
	R-20 continuous insulation	4.8	0.02	1.8	0.29	20.00	
	Steel deck	0.06	26	480	0.10	0.00	
	Interior air film					0.61	
	Total for assembly					20.78	0.048
Roof R-15 c.i.	Exterior air film					0.17	
	Roofing membrane					0.00	
	R-15 continuous insulation	3.6	0.02	1.8	0.29	15.00	
	Steel deck	0.06	26	480	0.10	0.00	
	Interior air film					0.61	
	Total for assembly					15.78	0.063
Roof R-10 c.i.	Exterior air film					0.17	
	Roofing membrane					0.00	
	R-10 continuous insulation	2.4	0.02	1.8	0.29	10.00	
	Steel deck	0.06	26	480	0.10	0.00	
	Interior air film					0.61	
	Total for assembly					10.78	0.093
Roof R-5 c.i.	Exterior air film					0.17	
	Roofing membrane					0.00	
	R-5 continuous insulation	1.2	0.02	1.8	0.29	5.00	
	Steel deck	0.06	26	480	0.10	0.00	
	Interior air film					0.61	
	Total for assembly					5.78	0.173
Roof R-3.8 c.i.	Exterior air film					0.17	
	Roofing membrane					0.00	
	R-3.8 continuous insulation	0.9	0.02	1.8	0.29	3.80	
	Steel deck	0.06	26	480	0.10	0.00	
	Interior air film					0.61	
	Total for assembly					4.58	0.218
NR	Exterior air film					0.17	
	Roofing membrane					0.00	
	Steel deck	0.06	26	480	0.10	0.00	
	Interior air film					0.61	
	Total for assembly					116.18	1.28

### **Roof Solar Reflectance and Thermal Emittance**

<i>Applicability</i>	All opaque exterior roof surfaces exposed to ambient conditions
<i>Definition</i>	The solar reflectance of a material. For roofing materials, the 3-year-aged reflectance value from a laboratory accredited by a nationally recognized accreditation organization such as the Cool Roof Rating Council (CRRC) testing should be used.
<i>Units</i>	
<i>Input Restrictions</i>	For roof surfaces: The default value is prescribed to be 0.3 for solar reflectance and 0.9 for emittance.  For roofs these defaults may be overridden when 3-year-aged data for reflectance and emittance is determined according to CCR-1 Standard.
<i>Baseline Building</i>	Roofs in the baseline building shall be modeled with a solar reflectance shall be 0.30 and thermal emittance of 0.90

### **3.5.5 Exterior Wall**

#### **Exterior Wall Name**

<i>Applicability</i>	All walls, optional input
<i>Definition</i>	A unique name or code that relates the exterior wall to the design documents. This is an optional input since there are other acceptable ways to key surfaces to the construction documents.
<i>Units</i>	
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	None

#### **Wall Type**

<i>Applicability</i>	All wall surfaces, optional
<i>Definition</i>	One of four categories of above-grade wall assemblies used to determine minimum insulation requirements for walls. The four wall type categories are as follows: <ol style="list-style-type: none"> <li>Mass walls</li> <li>Metal building walls</li> <li>Steel framed walls</li> <li>Wood framed and other</li> </ol> <p>A mass wall is defined as a wall with total heat capacity greater than (1) 7 Btu/ft<sup>2</sup>·°F or (2) 5 Btu/ft<sup>2</sup>·°F, provided that the wall has a material unit weight not greater than 120 lb/ft<sup>3</sup>. (Heat capacity is defined as the product of the specific heat in Btu/lb -F, the thickness in ft, and the density in lb/ ft<sup>3</sup>.) Opaque spandrel panels are considered opaque wall and not fenestration. Standard 90.1-2019 defines fenestration as an assembly in the building envelope which allows light to pass. Hence an opaque spandrel wall is considered an exterior wall and not fenestration.</p>
<i>Units</i>	
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	All walls in the baseline building are modeled as “steel framed”

**Wall Geometry**

<i>Applicability</i>	All walls, required input
<i>Definition</i>	Wall geometry defines the position, orientation, azimuth, and tilt of the wall surface. The geometry of roofs should match the construction documents or as-built drawings as accurately as possible. Curved surfaces such as a dome or semi-circular wall may be approximated by a series of constructions. The details of how the coordinate system is implemented may vary between simulation engines. The data structure for surfaces is described in Section 3.11.3 of this manual.
<i>Units</i>	
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Wall geometry in the baseline building is identical to the proposed design

**Wall Solar Reflectance**

<i>Applicability</i>	All opaque exterior surfaces exposed to ambient conditions
<i>Definition</i>	The solar reflectance of a material
<i>Units</i>	
<i>Input Restrictions</i>	For walls and other non-roof surfaces, the default reflectance is 0.3. The default values may be overridden only when the lower reflectance can be documented by manufacturers' literature or tests.
<i>Baseline Building</i>	Same as proposed

**Wall Thermal Emittance**

<i>Applicability</i>	All opaque exterior surfaces exposed to ambient conditions; this is prescribed for exterior walls at 0.9
<i>Definition</i>	The thermal emittance of a material. For roofing materials, the 3-year-aged emittance value from CRRC testing should be used if available.
<i>Units</i>	
<i>Input Restrictions</i>	For walls and other non-roof surfaces: The value is prescribed to be 0.9. The default values may be overridden only in cases when the lower emittance can be documented by manufacturers' literature or tests.
<i>Baseline Building</i>	Same as proposed



**Wall Construction**

<i>Applicability</i>	All walls that use the layers method
<i>Definition</i>	<p>A specification containing a series of layers that result in a construction assembly for the proposed design. The first layer in the series represents the outside (or exterior) layer and the last layer represents the inside (or interior) layer. See the building descriptors above for wall construction type.</p> <p>Several software tools add the interior and exterior air films automatically to an envelope assembly. The interior and exterior air films should not be included in the construction in such cases.</p>
<i>Units</i>	
<i>Input Restrictions</i>	As designed, with the construction assembly defined by a series of layers. Each layer specified, must consist of materials as described in Section 3.5.2.
<i>Baseline Building</i>	The baseline building wall type is steel framed where the insulation is installed within the cavity of the steel stud framing. The baseline building wall construction shall be modeled as layers. The U-factor required for baseline wall construction is defined in Table 23. The layer by layer construction corresponding to each U-factor shall be modeled as shown in Table 24. For existing buildings, the baseline walls shall follow the same rules as new buildings.

Table 23. Standard 90.1-2019 Requirements for Baseline Wall Construction for Non-Residential Space Conditioning Categories

	U-Factor (Btu/ft <sup>2</sup> . °F. h)		
	Nonresidential	Residential	Semiheated
Climate Zone 0 and 1	0.124	0.124	0.352
Climate Zone 2	0.124	0.084	0.352
Climate Zone 3	0.124	0.084	0.352
Climate Zone 4	0.124	0.064	0.124
Climate Zone 5	0.084	0.064	0.124
Climate Zone 6	0.084	0.064	0.124
Climate Zone 7	0.064	0.064	0.124
Climate Zone 8	0.064	0.055	0.124

Table 24. Baseline Building Wall Construction Assemblies

Construction	Layer	Thickness (inch)	Conductivity (Btu/h ft °F)	Density (lb/ft <sup>3</sup> )	Specific Heat (Btu/lb °F)	R-value (ft <sup>2</sup> ·°F·h/Btu)	U-factor (Btu/ft <sup>2</sup> ·°F·h)
Wall R-13 + R-15.6	Air film					0.17	
	Stucco	0.400	0.4167	116	0.2	0.08	
	R-15.6 continuous insulation	1.800	0.0200	1.8	0.29	15.6	
	Gypsum board	0.625	0.0930	50	0.2	0.56	
	R-13 insulation/steel framing					6.00	
	Gypsum board	0.625	0.0930	50	0.2	0.56	
	Interior air film					0.68	
	Total for assembly					23.65	0.055
Wall R-13 + R-7.5	Air film					0.17	
	Stucco	0.400	0.4167	116	0.2	0.08	
	R-7.5 continuous insulation	1.800	0.0200	1.8	0.29	7.50	
	Gypsum board	0.625	0.0930	50	0.2	0.56	
	R-13 insulation/steel framing					6.00	
	Gypsum board	0.625	0.0930	50	0.2	0.56	
	Interior air film					0.68	
	Total for assembly					15.55	0.064
Wall R-13 + R-3.8	Air film					0.17	
	Stucco	0.400	0.4167	116	0.2	0.08	
	R-3.8 continuous insulation	0.912	0.0200	1.8	0.29	3.80	
	Gypsum board	0.625	0.0930	50	0.2	0.56	
	R-13 insulation/steel framing					6.00	
	Gypsum board	0.625	0.0930	50	0.2	0.56	
	Interior air film					0.68	
	Total for assembly					11.85	0.084
Wall R-13	Air film					0.17	
	Stucco	0.400	0.4167	116	0.2	0.08	
	Gypsum board	0.625	0.0930	50	0.2	0.56	
						6.00	
	Gypsum board	0.625	0.0930	50	0.2	0.56	
	Interior air film					0.68	0.124
	Total for assembly					8.05	
NR	Air film					0.17	
	Stucco	0.400	0.4167	116	0.2	0.08	
	Gypsum board	0.625	0.0930	50	0.2	0.56	
	Cavity/steel framing					0.79	
	Gypsum board	0.625	0.0930	50	0.2	0.56	
	Interior air film					0.68	
	Total for assembly					2.84	0.352

Existing walls shall follow the same requirement as defined for baseline buildings.

### 3.5.6 Exterior Floors

#### ***Floor Name***

<i>Applicability</i>	All floor surfaces
<i>Definition</i>	A unique name or code that relates the exposed floor to the design documents. Exposed floors include floors exposed to the outdoors and floors over unconditioned spaces, but do not include slab-on-grade floors, below-grade floors, or interior floors.
<i>Units</i>	
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	None

#### ***Floor Type***

<i>Applicability</i>	All exterior floor surfaces, optional
<i>Definition</i>	The category that defines the baseline building prescriptive floor requirements
<i>Units</i>	
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	The baseline building floors shall be of type “steel-joint”

#### ***Floor Geometry***

<i>Applicability</i>	All exterior floors, required input
<i>Definition</i>	Floor geometry defines the position, orientation, azimuth, and tilt of the floor surface. The details of how the coordinate system is implemented may vary among software programs. The data structure for surfaces is described in the reference section of this chapter.
<i>Units</i>	
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Baseline building floor geometry is identical to the proposed design

**Floor Construction**

<i>Applicability</i>	All floors, required input
<i>Definition</i>	A specification containing a series of layers that result in a construction assembly for the proposed design. The first layer in the series represents the outside (or exterior) layer and the last layer represents the inside (or interior) layer. See the building descriptors above for floor construction type.
<i>Units</i>	
<i>Input Restrictions</i>	As designed, with the construction assembly defined by a series of layers. Each layer specified, must consist of materials as described in Section 3.5.2.  <b>NOTE:</b> Standard 90.1-2019, Table A9.2-1 in Appendix A specifies the effective insulation/framing layer R-values for roof and floor insulation installed between metal framing 4' OC. These values are intended to be used for all other framing, 16", 2', and 3'.
<i>Baseline Building</i>	The exterior floor type for the baseline building is steel joist. The baseline building wall construction shall be modeled as layers. The U-factor required for baseline wall construction is defined in Table 25. The layer by layer construction corresponding to each U-factor shall be modeled as shown in Table 26. For existing buildings, the baseline walls shall follow the same rules as new buildings.

Table 25. Standard 90.1-2019 Requirements for Baseline Steel Joist Floors for Non-Residential Space Conditioning Categories

	U-factor (Btu/ft <sup>2</sup> · °F · h)		
	Nonresidential	Residential	Semiheated
Climate Zone 0 and 1	U-0.35	U-0.35	U-0.35
Climate Zone 2	U-0.052	U-0.052	U-0.35
Climate Zone 3	U-0.052	U-0.052	U-0.069
Climate Zone 4	U-0.052	U-0.038	U-0.069
Climate Zone 5	U-0.052	U-0.038	U-0.069
Climate Zone 6	U-0.038	U-0.038	U-0.069
Climate Zone 7	U-0.038	U-0.038	U-0.052
Climate Zone 8	U-0.038	U-0.032	U-0.052

Table 26. Baseline Building Exterior Floor Construction Assemblies

Construction Layer	Thickness (inch)	Conductivity (Btu/h ft °F)	Density (lb/ft <sup>3</sup> )	Specific Heat (Btu/lb °F)	R-value (ft <sup>2</sup> ·°F·h/Btu)	U-value (Btu /ft <sup>2</sup> ·°F·h)	
Floor R-38	Interior air film (flow down)					0.92	
	Carpet and pad					1.23	
	4" concrete	4	1.3333	140	0.2	0.25	
	R-38 insulation between joists					28	
	Metal deck	0.06	26	480	0.1	0.00	
	Semi-exterior air film					0.46	
	Total for assembly					30.86	0.032
Floor R-30	Interior air film (flow down)					0.92	
	Carpet and pad					1.23	
	4" concrete	4	1.3333	140	0.2	0.25	
	R-30 insulation between joists					23.5	
	Metal deck	0.06	26	480	0.1	0.00	
	Semi-exterior air film					0.46	
	Total for assembly					26.36	0.038
Floor R-19	Interior air film (flow down)					0.92	
	Carpet and pad					1.23	
	4" concrete	4	1.3333	140	0.2	0.25	
	R-19 insulation between joists					16.37	
	Metal deck	0.06	26	480	0.1	0.00	
	Semi-exterior air film					0.46	
	Total for Assembly					19.23	0.052
Floor R-13	Interior air film (flow down)					0.92	
	Carpet and pad					1.23	
	4" concrete	4	1.3333	140	0.2	0.25	
	R-13 insulation between joists					11.63	
	Metal deck	0.06	26	480	0.1	0.00	
	Semi-exterior air film					0.46	
	Total for assembly					14.49	0.069
NR	Interior air film (flow down)					0.92	
	Carpet and pad					1.23	
	4" concrete	4	1.3333	140	0.2	0.25	
	Metal deck	0.06	26	480	0.1	0.00	
	Semi-exterior air film					0.46	
	Total for assembly					2.86	0.35

### 3.5.7 Doors

#### Door Name

<i>Applicability</i>	All exterior doors, optional input
<i>Definition</i>	A unique name or code that relates the door to the design documents submitted. Doors that are more than 50% glass are treated as windows and must be determined and entered by using the fenestration building descriptors.
<i>Units</i>	
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	None

#### Door Type

<i>Applicability</i>	All exterior doors, required input
<i>Definition</i>	For the purposes of determining building envelope requirements, the classifications are defined as follows: <ol style="list-style-type: none"> <li>1. Non-swinging: roll-up, metal coiling, sliding, and all other doors that are not swinging doors.</li> <li>2. Swinging: all operable opaque panels with hinges on one side and opaque revolving doors. The prescriptive U-factor requirements depend on door type and climate. This building descriptor may be derived from other building descriptors, in which case a specific input is not necessary.</li> </ol>
<i>Units</i>	
<i>Input Restrictions</i>	The door type shall be consistent with the type of door represented on the construction documents or as-built drawings
<i>Baseline Building</i>	The baseline building door type shall be the same as the proposed design

#### Door Geometry

<i>Applicability</i>	All exterior doors
<i>Definition</i>	Door geometry defines the position and dimensions of the door surface relative to its parent wall surface. The azimuth and tilt (if any) of the door are inherited from the parent surface. The position of the door within the parent surface is specified through X,Y coordinates. The size is specified as a height and width (all doors are generally assumed to be rectangular). The details of how the geometry of doors is specified may vary for each energy simulation program.
<i>Units</i>	
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Door geometry in the baseline building is identical to the proposed design

**Door U-factor**

<i>Applicability</i>	All exterior doors
<i>Definition</i>	The thermal transmittance of the door, including the frame
<i>Units</i>	Btu/h·ft <sup>2</sup> ·°F
<i>Input Restrictions</i>	Door U-factors shall be taken from the default values in Appendix A of Standard 90.1-2019 or shall be obtained from National Fenestration Rating Council (NFRC) test procedures
<i>Baseline Building</i>	For new construction, the U-factor required for door construction is defined in Table 27

Table 27. Standard 90.1-2019 Requirements for Doors for Baseline Building

Swinging or Non-swinging	Climate Zone	Space Conditioning Category		
		Nonresidential U-Value	Residential U-Value	Semi-Heated U-Value
Swinging	Climate Zone 0 and 1	0.7	0.7	0.7
	Climate Zone 2	0.7	0.7	0.7
	Climate Zone 3	0.7	0.7	0.7
	Climate Zone 4	0.7	0.7	0.7
	Climate Zone 5	0.7	0.7	0.7
	Climate Zone 6	0.7	0.5	0.7
	Climate Zone 7	0.7	0.5	0.7
	Climate Zone 8	0.5	0.5	0.7
Non-swinging	Climate Zone 0 and 1	1.45	1.45	1.45
	Climate Zone 2	1.45	1.45	1.45
	Climate Zone 3	1.45	0.5	1.45
	Climate Zone 4	1.45	0.5	1.45
	Climate Zone 5	1.45	0.5	1.45
	Climate Zone 6	0.5	0.5	1.45
	Climate Zone 7	0.5	0.5	1.45
	Climate Zone 8	0.5	0.5	1.45

**3.5.8 Fenestration**

Note that fenestration includes windows, doors that have more than 50% glazed area, and skylights. A skylight is a fenestration that has a tilt of less than 60° from horizontal.

**Fenestration Name**

<i>Applicability</i>	All fenestration, optional input
<i>Definition</i>	A unique name or code that relates the fenestration to the design documents and a parent surface
<i>Units</i>	Text: unique
<i>Input Restrictions</i>	Not restrictions
<i>Baseline Building</i>	Not applicable

**Vertical Fenestration Geometry and Area**

<i>Applicability</i>	All fenestration
<i>Definition</i>	Fenestration geometry defines the position and dimensions of the fenestration surface within its parent surface and the identification of the parent surface. The orientation and tilt are inherited from the parent surface. The details of how the coordinate system is implemented may vary between software programs.
<i>Units</i>	Data structure: opening
<i>Input Restrictions</i>	<p>As designed. The defined fenestration should match with the construction drawings or as-built drawings. Specification of the fenestration position within its parent surface is required for the following conditions:</p> <ul style="list-style-type: none"> <li>• Exterior shading is modeled from buildings, vegetation, and other objects. All elements whose effective height is greater than their distance from a proposed building and whose width facing the proposed building is greater than one-third that of the proposed building shall be accounted for in the analysis</li> <li>• If daylighting is modeled within the adjacent space.</li> </ul>
<i>Baseline Building</i>	<p>The geometry of the vertical fenestration shall be similar to the proposed design but each fenestration shall be increased or reduced in size in proportion to the proposed design size such that the overall fenestration area as a percentage of the above-grade exterior wall area is equal to the values in Table 28. For building areas not shown in Table 28, vertical fenestration areas shall equal that in the proposed design or 40% of gross above-grade wall area, whichever is smaller, and shall be distributed on each face of the building in the same proportions in the proposed design.</p> <p>If the gross area of all windows (including framing) in each space conditioning category in the building exceeds the value specified in Table 28 of the gross above-grade exterior wall area for that building area type, the dimensions of each window shall be reduced such that the window to wall ration is equal to the value specified in Table 28. This reduction needs to be done by increasing the sill height until the limit is reached for each building area type.</p> <p>If the WWR of the proposed building design is less than the value specified in Table 28, the dimensions of each window shall be increased equally from the center of the window until a wall or partition is reached. If window area needs to be increased further, then the sill height will be reduced will the maximum WWR limit is reached. The fenestration area for an existing building shall equal the existing fenestration area prior to the proposed work and shall be distributed on each face of the building in the same proportions as the existing building.</p>

Table 28. Baseline Building Vertical Fenestration Area

Building Area Types <sup>(a)</sup>	Baseline Building Gross Above-Grade-Wall Area
Grocery Store	7%
Healthcare (outpatient)	21%
Hospital	27%
Hotel/motel (≤75 rooms)	24%
Hotel/motel (>75 rooms)	34%
Office (≤5000 ft <sup>2</sup> )	19%
Office (5000 to 50,000 ft <sup>2</sup> )	31%
Office (>50,000 ft <sup>2</sup> )	40%
Restaurant (quick service)	34%
Restaurant (full service)	24%
Retail (standalone)	11%
Retail (strip mall)	20%
School (primary)	22%
School (secondary and university)	22%
Warehouse (non-refrigerated)	6%



### **Horizontal Fenestration (Skylight) Geometry and Area**

<i>Applicability</i>	All horizontal fenestration (skylights)
<i>Definition</i>	Fenestration geometry defines the position and dimensions of the fenestration surface within its parent surface and the identification of the parent surface. The orientation and tilt is inherited from the parent surface. The details of how the coordinate system is implemented may vary between rating software programs.
<i>Units</i>	Data structure: opening
<i>Input Restrictions</i>	There are no restrictions, other than a match with the construction drawings or as-built drawings. Specification of the fenestration position within its parent surface is required for the following conditions: <ul style="list-style-type: none"> <li>• exterior shading is modeled from buildings, vegetation, other objects</li> <li>• if daylighting is modeled within the adjacent space.</li> </ul>
<i>Baseline Building</i>	The geometry of the horizontal fenestration shall be equal to the proposed design or 3% of gross roof area, whichever is smaller.  If the skylight area of the proposed design exceeds 3%, the baseline skylight area shall be decreased by an identical percentage in all roof components in which skylights are located to reach 3%. Skylight orientation as tilt shall be the same as the proposed design.

### **Fenestration Construction**

<i>Applicability</i>	All fenestration
<i>Definition</i>	A collection of values that together describe the performance of a fenestration system. The values that are used to specify the criteria are U-factor, solar heat gain coefficient (SHGC), and visible light transmittance (VT). U-factor and SHGC inputs are whole-window values.
<i>Units</i>	<ul style="list-style-type: none"> <li>•</li> <li>•</li> <li>•</li> </ul>
<i>Input Restrictions</i>	The U-factor, SHGC, and VT for fenestration shall be modeled as certified and labeled in accordance with NFRC 100, 200, and 300, respectively. Unlabeled skylights shall be assigned the U-factors in Standard 90.1-2019, Normative Appendix A, Table A8.1-1 for the SHGCs and Table A8.1-2 for VTs.  Unlabeled vertical fenestration, both operable and fixed, shall be assigned the U-factors, SHGCs, and VTs in Normative Appendix A, Table A8.2.
<i>Baseline Building</i>	The requirements for vertical fenestration U factor and SHGC are specified in Table 29 and Table 30 (Standard 90.1-2019 Tables G3.4-1 to Tables G3.4-8). The visible transmittance for horizontal and vertical fenestration is specified in Table 32 and Table 33 (Standard 90.1-2019 Tables G3.4-1 to Tables G3.4-8). .

Table 29. U-factor Requirement for Vertical and Horizontal Fenestration

Climate Zone	Nonresidential		Residential		Semi-Heated	
	Vertical	Horizontal	Vertical	Horizontal	Vertical	Horizontal
0 and 1	1.22	1.36	1.22	1.36	1.22	1.36
2	1.22	1.36	1.22	1.36	1.22	1.36
3	0.57	0.69	0.57	0.69	1.22	1.36
3C	1.22	1.36	1.22	1.36	1.22	1.36
4	0.57	0.69	0.57	0.58	1.22	1.36
5	0.57	0.69	0.57	0.69	1.22	1.36
6	0.57	0.69	0.57	0.58	1.22	1.36
7	0.57	0.69	0.57	0.69	1.22	1.36
8	0.46	0.58	0.46	0.58	1.22	0.81

Table 30. SHGC Requirement for Vertical Fenestration

Climate Zone	Nonresidential				Residential				Semi-Heated
	0-10%	10.1-20%	20.1-30%	30.1-40%	0-10%	10.1-20%	20.1-30%	30.1-40%	0-10%
0 and 1	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.25	0.40
2	0.25	0.25	0.25	0.25	0.39	0.25	0.25	0.25	0.40
3	0.39	0.25	0.25	0.25	0.39	0.39	0.25	0.25	0.40
3C	0.61	0.39	0.39	0.34	0.61	0.61	0.39	0.34	0.40
4	0.39	0.39	0.39	0.39	0.39	0.39	0.39	0.39	0.40
5	0.49	0.39	0.39	0.39	0.49	0.39	0.39	0.39	0.40
6	0.49	0.39	0.39	0.39	0.49	0.39	0.39	0.39	0.40
7	0.49	0.49	0.49	0.49	0.49	0.49	0.49	0.49	0.40
8	0.40	0.40	0.40	0.40	0.40	0.40	0.40	0.40	0.40

Table 31. SHGC Requirement for Horizontal Fenestration

Climate Zone	Nonresidential		Residential		Semi-Heated	
	0-2%	2.1-5%	0-2%	2.1-5%	0-2%	2.1-5%
0 and 1	0.36	0.19	0.19	0.19	0.55	0.55
2	0.36	0.19	0.19	0.19	0.55	0.55
3	0.39	0.19	0.36	0.19	0.55	0.55
3C	0.61	0.39	0.39	0.19	0.55	0.55
4	0.49	0.39	0.36	0.19	0.55	0.55
5	0.49	0.39	0.49	0.39	0.55	0.55
6	0.49	0.49	0.49	0.39	0.55	0.55
7	0.68	0.64	0.64	0.64	0.55	0.55
8	0.55	0.55	0.55	0.55	0.55	0.55

Table 32. VT Requirement for Vertical Fenestration

Climate Zone	Nonresidential				Residential				Semi-Heated
	0-10%	10.1-20%	20.1-30%	30.1-40%	0-10%	10.1-20%	20.1-30%	30.1-40%	0-10%
0 and 1	0.28	0.28	0.28	0.28	0.28	0.28	0.28	0.28	0.44
2	0.28	0.28	0.28	0.28	0.28	0.28	0.28	0.28	0.44
3	0.43	0.28	0.28	0.28	0.43	0.43	0.28	0.28	0.44
3C	0.67	0.43	0.43	0.34	0.61	0.61	0.39	0.34	0.44
4	0.43	0.43	0.43	0.43	0.43	0.43	0.43	0.43	0.44
5	0.54	0.43	0.43	0.43	0.54	0.43	0.43	0.43	0.44
6	0.54	0.43	0.43	0.43	0.54	0.43	0.43	0.43	0.44
7	0.54	0.54	0.54	0.54	0.54	0.54	0.54	0.54	0.44
8	0.44	0.44	0.44	0.44	0.44	0.44	0.44	0.44	0.44

Table 33. VT Requirement for Horizontal Fenestration

Climate Zone	Nonresidential		Residential		Semi-Heated	
	0-2%	2.1-5%	0-2%	2.1-5%	0-2%	2.1-5%
0 and 1	0.40	0.21	0.21	0.21	0.61	0.61
2	0.40	0.21	0.21	0.21	0.61	0.61
3	0.43	0.21	0.40	0.21	0.61	0.61
3C	0.67	0.43	0.43	0.21	0.61	0.61
4	0.54	0.43	0.40	0.21	0.61	0.61
5	0.54	0.43	0.54	0.43	0.61	0.61
6	0.54	0.54	0.54	0.43	0.61	0.61
7	0.75	0.70	0.70	0.70	0.61	0.61
8	0.61	0.61	0.61	0.61	0.61	0.61

### External Shading Devices

*Applicability* All fenestration

*Definition* Devices or building features that are documented in the construction documents and shade the glazing, such as overhangs, fins, shading screens, and setbacks of windows from the exterior face of the wall. Objects that shade the building but are not part of the building and parts of the building that cause the building to shade itself are also modeled, but are not a part of this building descriptor. The software shall be capable of modeling vertical fins and overhangs. Recessed windows may also be modeled with side fins and overhangs.

*Units*

*Input Restrictions* No restrictions other than the inputs must match the construction documents

*Baseline Building* The baseline building is modeled without external shading devices and as flush with the exterior wall

**Internal Shading Devices**

<i>Applicability</i>	All fenestration
<i>Definition</i>	Curtains, blinds, louvers, or other devices that are applied on the room side of the glazing material. Glazing systems that use blinds between the glazing layers are also considered internal shading devices. Glass coatings, components, or treatments of the glazing materials are addressed through the fenestration construction building descriptor.
<i>Units</i>	
<i>Input Restrictions</i>	Manual fenestration shading devices such as blinds or shades may be modeled or not, but if they are, they are required to be modeled the same in the baseline building, so that there is no credit.  Automatically controlled fenestration shades or blinds may be modeled in the proposed design.
<i>Baseline Building</i>	Manual shades or blinds shall be modeled the same as in the proposed building.  Automatically controlled fenestration shades or blinds will not be modeled in the baseline building.

**Dynamic Glazing**

<i>Applicability</i>	Fenestration with dynamic glazing
<i>Definition</i>	Dynamic glazing can vary the SHGC and VT of the glazing in response to a signal from an energy management system, direct sunlight on the glazing, or other inputs
<i>Units</i>	
<i>Input Restrictions</i>	Dynamic glazing can be modeled for the proposed design and controlled according to sequences specified in the construction documents. If controlled manually, then the proposed model is required to use the average of the minimum and maximum SHGC and VT.
<i>Baseline Building</i>	Not applicable

**SHGC Dim Fraction**

<i>Applicability</i>	Fenestration with dynamic glazing
<i>Definition</i>	For dynamic glazing, this is the fraction of the SHGC when darkened to the SHGC during normal operation. This can be applied when the solar heat gain exceeds a specified threshold, or controlled by an electrical signal.
<i>Units</i>	
<i>Input Restrictions</i>	Between 0 and 1
<i>Baseline Building</i>	Not applicable

**VT Dim Fraction**

<i>Applicability</i>	Fenestration with dynamic glazing
<i>Definition</i>	For dynamic glazing, this is the fraction of the visible transmittance when darkened to the visible transmittance during normal operation. This can be applied when the solar heat gain exceeds a specified threshold, or controlled by an electrical signal.
<i>Units</i>	
<i>Input Restrictions</i>	Between 0 and 1
<i>Baseline Building</i>	Not applicable

**Dynamic Solar Heat Gain Threshold**

<i>Applicability</i>	Fenestration with automatically controlled dynamic glazing
<i>Definition</i>	For dynamic glazing, this is the solar heat gain threshold above which the dynamic glazing is active (darkened). When the solar heat gain drops below this threshold, the glazing is switched back to being inactive (clearest setting). Indoor and outdoor air temperatures (OATs) can also be used as setpoints for controlling the switchable solar heat gain threshold. This may be used in combination with the solar heat gain and illuminance thresholds for control. A flag may be used to indicate that this control is not used.
<i>Units</i>	Incident solar threshold (Btu/h-ft <sup>2</sup> )
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable

**Switchable Space Temperature Threshold**

<i>Applicability</i>	Fenestration with automatically controlled dynamic glazing
<i>Definition</i>	For dynamic glazing, this is the space temperature above which the dynamic glazing is active (darkened). When the space temperature drops below this threshold, the glazing is switched back to being inactive (clearest setting). Indoor and outdoor air temperatures are the setpoints required for controlling the dynamic solar heat gain threshold. This may be used in combination with the solar heat gain and illuminance thresholds for control. A flag may be used to indicate that this control is not used.
<i>Units</i>	°F
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable

**Dynamic Illuminance Threshold**

<i>Applicability</i>	Fenestration with automatically controlled dynamic glazing
<i>Definition</i>	For dynamic glazing, this is the illuminance threshold above which the dynamic glazing is regulated between active (darkened) and inactive (clearest setting). With a single illuminance setpoint, the dynamic glazing will adjust between the clearest and darkest setting to allow the desired illuminance level. A flag may be used to indicate that this control is not used.
<i>Units</i>	lux
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable

**Dynamic Glazing Schedule**

<i>Applicability</i>	Fenestration with dynamic glazing controlled by an electrical signal
<i>Definition</i>	For dynamic glazing, this is an hourly schedule for when the dynamic glazing is darkened, when controlled by an electrical signal
<i>Units</i>	Boolean: 1 if dynamic glazing is active (darkened); 0 if not active
<i>Input Restrictions</i>	0 or 1 for schedule values. As designed.
<i>Baseline Building</i>	Not applicable

### 3.5.9 Below-Grade Walls

#### ***Below-Grade Wall Name***

<i>Applicability</i>	All projects, optional input
<i>Definition</i>	A unique name that keys the below-grade wall to the construction documents
<i>Units</i>	Text: unique
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Not applicable

#### ***Below-Grade Wall Geometry***

<i>Applicability</i>	All projects
<i>Definition</i>	A geometric construct that describes the dimensions and placement of walls located below grade. Below-grade walls have soil or crushed rock on one side and interior space on the other side. Some simulation models account for the depth below grade when estimating heat transfer, so the geometry may include height and width.
<i>Units</i>	Data structure: below-grade wall geometry
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Same as proposed

#### ***Below-Grade Wall Construction***

<i>Applicability</i>	All projects, required input
<i>Definition</i>	A specification containing a series of layers that result in a construction assembly for the proposed design. The first layer in the series represents the outside (or exterior) layer and the last layer represents the inside (or interior) layer. See the building descriptors above for below-grade wall construction type.
<i>Units</i>	Data structure: construction assembly  The construction can be described as a C-factor, which is similar to a U-factor, except that the outside air film is excluded, or the construction can be represented as a series of layers, like exterior constructions.
<i>Input Restrictions</i>	As designed, with the construction assembly defined by a series of layers. Each layer specified, must consist of materials as described in Section 3.5.2.
<i>Baseline Building</i>	The baseline below grade wall construction shall be modeled as layers. The C-factor required for baseline wall construction is defined in Table 34. The layer by layer construction corresponding to each U-factor shall be modeled as shown in Table 35. For existing buildings, the baseline walls shall follow the same rules as new buildings.

Table 34. Standard 90.1-2019 Requirements for Baseline Wall Construction for Non-Residential Space Conditioning Categories

Climate Zone	Non-Residential C-factor (Minimum Insulation)	Residential C-factors (Minimum Insulation)	Semi Heated C-factors (Minimum Insulation)
Climate Zone 1	C-1.140 (NR)	C-1.140 (NR)	C-1.140 (NR)
Climate Zone 2	C-1.140 (NR)	C-1.140 (NR)	C-1.140 (NR)
Climate Zone 3	C-1.140 (NR)	C-1.140 (NR)	C-1.140 (NR)
Climate Zone 4	C-1.140 (NR)	C-1.140 (NR)	C-1.140 (NR)
Climate Zone 5	C-1.140 (NR)	C-1.140 (NR)	C-1.140 (NR)
Climate Zone 6	C-1.140 (NR)	C-0.119 (R-7.5 c.i.)	C-1.140 (NR)
Climate Zone 7	C-0.119 (R-7.5 c.i.)	C-0.119 (R-7.5 c.i.)	C-1.140 (NR)
Climate Zone 8	C-0.119 (R-7.5 c.i.)	C-0.119 (R-7.5 c.i.)	C-1.140 (NR)

Table 35. Baseline Building Below-Grade Wall Construction Assemblies

Insulation R-Value	Layer	Thickness (inch)	Conductivity (Btu/h ft °F)	Density (lb/ft <sup>2</sup> )	Specific Heat (Btu/lb °F)	R-value (ft <sup>2</sup> ·°F·h/Bt u)	C-factor (Btu/ft <sup>2</sup> ·°F ·h)
NR	115 lb/ft <sup>3</sup> CMU, solid grout	8	0.45	115	0.20	0.87	1.140
	115 lb/ft <sup>3</sup> CMU, solid grout	8	0.45	115	0.20	0.87	
R-7.5 c.i.	R-7.5 continuous insulation	1.8	0.02	1.8	0.29	7.50	0.119
	0.5 in. gypsum board	0.5				0.45	
	Total assembly					8.82	

### 3.5.10 Slab Floors in Contact with Ground

These building descriptors apply to slab-on-grade floors that are in direct contact with the ground.

***Slab Floor Name***

<i>Applicability</i>	All slab floors, optional
<i>Definition</i>	A unique name or code that relates the exposed floor to the construction documents
<i>Units</i>	Text: unique
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Not applicable

**Slab Floor Type**

<i>Applicability</i>	All slab floors, required
<i>Definition</i>	One of two classes for floors in contact with ground. The classes are: <ol style="list-style-type: none"> <li>1. Heated slab-on-grade floors</li> <li>2. Unheated slab-on-grade floors</li> </ol> <p>Heated slab-on-grade floors include all floors that are heated directly to provide heating to the space. Unheated slab-on-grade floors are all other floors in contact with the ground.</p>
<i>Units</i>	List: Heated or Unheated
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	The baseline building slab floor type is unheated

**Slab Floor Geometry**

<i>Applicability</i>	All slab floors, required
<i>Definition</i>	A geometric construct representing a slab floor in contact with the earth. The geometric representation can vary depending on how the energy simulation software models slabs-on-grade. Some models require that only the perimeter of the slab be entered. Other models divide the slab into a perimeter band within 2 ft of the edge and the interior portion or core area, such that the perimeter area and the core area sum to the total area of the slab.
<i>Units</i>	Data structure: as appropriate for the simulation tool This may include: area, perimeter exposed
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	The geometry of the slab floor in the baseline building is identical to the slab floor in the proposed design

**Slab Floor Construction**

<i>Applicability</i>	All slab floors, required input
<i>Definition</i>	A specification containing a series of layers that result in a construction assembly for the proposed design. The first layer in the series represents the outside (or exterior) layer and the last layer represents the inside (or interior) layer. See the building descriptors above for slab floor type. <p>A description of how the slab is insulated (or not). How the construction is described will depend on the energy simulation model. The construction can be represented by an F-factor that represents the entire construction (floor and insulation).</p> <p>Simple models may include just an F-factor, representing an instantaneous heat loss/gain to outside air. The F-factor could be related to the configuration of insulation in the proposed design. Other slab loss models may require that the surface area of the slab floor be divided between the perimeter and the interior. The insulation conditions then define heat transfer between both outside air and ground temperature.</p> <p>The insulation condition for slabs includes the R-value of the insulation and the distance it extends into the earth at the slab edge and how far it extends underneath the slab.</p>
<i>Units</i>	List (depends on the model that is used) For F-factor method: F-factor from Standard 90.1-2019 Normative Appendix A, Table A6.3.1; this is one selection from list 1 and one selection from list 2. Note that some



combinations from list 1 and list 2 are not allowed – see Normative Appendix A, Table A6.3.1.

List 1: None, 12 in horizontal, 24 in horizontal, 36 in horizontal, 48 in horizontal, 12 in vertical, 24 in vertical, 36 in vertical, 48 in vertical, Fully insulated slab

List 2: R-0, R-5, R-7.5, R-10, R-15, R-20, R-25, R-30, R-35, R-40, R-45, R-50, R-55

*Input Restrictions* For new construction, F-factors shall be taken from Table A6.3.1 of Standard 90.1-2019, Normative Appendix A for both heated slab floors and unheated slab floors. For all methods, inputs shall be consistent with the construction documents. For alterations the same requirements apply.

*Baseline Building* Slab loss shall be modeled in the same manner in the baseline building as in the proposed design.

Slab loss can be modeled with the simple method (F-factor) for unheated slabs. A layer-by-layer input can also be used. The base assembly is a slab floor of 6-inch concrete poured directly onto the earth (Concrete 140lb/ft<sup>3</sup> – 6 in.), the bottom of the slab is at grade line and soil conductivity is 0.75 Btu/h-ft °F.

The configuration of insulation and the F-factors for the baseline building unheated slab floors are shown in Table A6.3 in Normative Appendix A. The F-factors for the baseline building have been listed in the table below.

Table 36. Baseline Building Slab on Grade Envelope Requirements

Climate Zone	Non Residential		Residential		Semi-Heated	
	Insulation	F-Factor	Insulation	F-Factor	Insulation	F-Factor
Climate Zone 1	NR	0.73	NR	0.73	NR	0.73
Climate Zone 2	NR	0.73	NR	0.73	NR	0.73
Climate Zone 3	NR	0.73	NR	0.73	NR	0.73
Climate Zone 4	NR	0.73	NR	0.73	NR	0.73
Climate Zone 5	NR	0.73	NR	0.73	NR	0.73
Climate Zone 6	NR	0.73	NR	0.73	NR	0.73
Climate Zone 7	NR	0.73	R-10 for 24 in. vertical	0.54	NR	0.73
Climate Zone 8	R-10 for 24 in. vertical	0.54	R-15 for 24 in. vertical	0.52	NR	0.73

### 3.5.11 Heat Transfer between Thermal Zones

#### *Partition Geometry*

*Applicability* All partitions

*Definition* A geometric construct that defines the position and size of partitions that separate one thermal zone from another. The construct shall identify the thermal zones on each side of the partition. Since solar gains are not generally significant for interior partitions, the geometry of partitions is sometimes specified as just an area along with identification of the thermal zones on each side.

*Units* Data structure: surface with additional information identifying the two thermal zones that the partition separates

*Input Restrictions* No restrictions other than agreement with the construction documents

*Baseline Building* The geometry of partitions in the baseline building shall be identical to the proposed design

**Partition Construction**

<i>Applicability</i>	All partitions
<i>Definition</i>	A description of the construction assembly for the partition
<i>Units</i>	Data structure: construction assembly
<i>Input Restrictions</i>	No restrictions other than the need for agreement with the construction documents. However, “virtual” air walls may be used to separate zones, where real perimeter zones and interior zones are defined within an open space.
<i>Baseline Building</i>	Interior walls for baseline should be same as proposed. Interior floors/ceilings shall be same as proposed

**3.6 HVAC Zone Level Systems**

This group of building descriptors relates to HVAC systems at the zone level. There is not a one-to-one relationship between HVAC components in the proposed design and the baseline building since the baseline building system is determined from building type, size, and climate zone. Additions and alterations should follow the same requirements stated for new construction proposed designs and new construction baseline buildings; unless otherwise noted in the descriptor. For unenclosed spaces such as parking garages, crawlspaces and attics, refer to Section 2.4.3 of this manual for modeling requirements.

**3.6.1 Zone Temperature Control****Building Zone Thermostat Throttling Range**

<i>Applicability</i>	All HVAC zones
<i>Definition</i>	The number of degrees that the room temperature must change to cause the HVAC system to go from no heating or cooling (i.e., space temperatures floating) to full heating or cooling
<i>Units</i>	Degrees Fahrenheit (°F)
<i>Input Restrictions</i>	As designed with a default of 2°F*
<i>Baseline Building</i>	Same as the proposed design

\* For simulation using EnergyPlus, the reporting tolerances would be set as 1°F to simulate a throttling range of 2°F.

**Zone Temperature Schedule**

<i>Applicability</i>	All HVAC zones
<i>Definition</i>	An hourly space thermostat schedule
<i>Units</i>	Data structure: temperature schedule
<i>Input Restrictions</i>	Design temperature schedules are required to be used when available. When design temperature schedules are not available, the schedules specified in COMNET Appendix C (COMNET 2017) can be used as a default.
<i>Baseline Building</i>	Schedules in the baseline building shall be identical to the proposed design. However, dry bulb temperature setpoint may be allowed to differ if a user can demonstrate via the simulation program that equivalent thermal comfort is being maintained in accordance with ASHRAE Standard 55, Section 5.3.3, “Elevated Air Speed,” or Standard 55, Appendix B, “Computer Program for Calculation of PMV-PPD.”

### 3.6.2 Terminal Device Data

#### *Terminal Type*

<i>Applicability</i>	All HVAC zones
<i>Definition</i>	<p>A terminal unit includes any device serving a zone (or group of zones collected in a thermal zone) that has the ability to reheat or re-cool in response to the zone thermostat. This includes:</p> <ul style="list-style-type: none"> <li>• None (the case for single zone units)</li> <li>• VAV box</li> <li>• Series fan-powered VAV box</li> <li>• Parallel fan-powered VAV box</li> <li>• Induction-type VAV box</li> <li>• Dual-duct mixing box (constant volume and VAV)</li> <li>• Two- and three-duct mixing dampers (multi-zone systems)</li> <li>• Reheat coil (constant volume systems)</li> <li>• Perimeter induction units</li> <li>• Chilled beams</li> <li>• Radiant heating and cooling</li> <li>• Fan coil units</li> <li>• Variable refrigerant flow terminal units</li> </ul>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Table 37 specifies the HVAC terminal device for each of the baseline building systems. See Table 3 for a summary of the HVAC mapping.

Table 37. Baseline Building HVAC Terminal Devices

Baseline System HVAC Terminal Type		
	Baseline Building System	Terminal Type
System 1	PTAC	None
System 2	PTHP	None
System 3	PSZ AC	None
System 4	PSZ HP	None
System 5	PVAV reheat	VAV with hot water reheat
System 6	Packaged VAV with PFP boxes	Parallel fan-powered boxes with electric reheat
System 7	VAV with Reheat	VAV with hot water reheat
System 8	VAV with PFP boxes	Parallel fan-powered boxes with electric reheat
System 9	Heating and ventilation	None
System 10	Heating and ventilation	None
System 11	SZ-VAV	None
System 12	SZ-CV-HW	None
System 13	SZ-CV-ER	None

### 3.6.3 Terminal Heating

This group of building descriptors applies to proposed design systems that have reheat coils at the zone level. The building descriptors are applicable for baseline building systems 5, 6, 7, and 8.

#### **Terminal Heat Type**

<i>Applicability</i>	Systems that have reheat coils at the zone level
<i>Definition</i>	The heating source for the terminal unit. This includes: <ul style="list-style-type: none"> <li>• Electric resistance</li> <li>• Gas furnace</li> <li>• Oil furnace</li> <li>• Hot water</li> <li>• Steam</li> <li>• Refrigerant (for VRF)</li> </ul>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Table 38 shows the terminal heat type for each baseline building system

Table 38. Baseline Building Terminal Heat Type

Baseline Building System		Terminal Heat Type
System 1	PTAC	None
System 2	PTHP	None
System 3	PSZ AC	None
System 4	PSZ HP	None
System 5	PVAV reheat	Hot water
System 6	Packaged VAV with PFP boxes	Electric resistance
System 7	VAV with reheat	Hot water
System 8	VAV with PFP boxes	Electric resistance
System 9	Heating and ventilation	None
System 10	Heating and ventilation	None
System 11	SZ-VAV	None
System 12	SZ-CV-HW	None
System 13	SZ-CV-ER	None

#### **Terminal Heat Capacity**

<i>Applicability</i>	Systems that have reheat coils at the zone level
<i>Definition</i>	The heating capacity of the terminal heating source
<i>Units</i>	Btu/h
<i>Input Restrictions</i>	As designed. However, if the UMLH exceed 300, the energy analyst and design team may have to increase the size of the equipment so that the UMLH are less than 300. See Figure 3 and Section 2.7.1.
<i>Baseline Building</i>	Sizing would be carried out at zone level where the oversizing parameters would be applied to the zone design loads. The software shall automatically size the terminal heating capacity to be 25% greater than the design loads. Refer to Section 2.7.2 of this document for more details.

**Reheat Delta T**

<i>Applicability</i>	Systems that have reheat coils at the zone level
<i>Definition</i>	This is an alternate method to enter the terminal heat capacity. It can be calculated as follows:
	(7)
	$\Delta T_{reheat} = T_{reheat} - T_{cool\_supply}$
	$\Delta T_{reheat} = Q_{coil} / (CFM * C_p * \rho)$
	Where:
	$\Delta T_{reheat}$ = Heat rise across the terminal unit heating coil (°F)
	$T_{reheat}$ = Heating air temperature at design (°F)
	$T_{cool\_supply}$ = Supply air temperature at the heating coil (°F)
	$Q_{coil}$ = Heating coil capacity (Btu/h)
	$CFM$ = Standard airflow rate (cfm)
	$C_p$ = Specific heat of air (Btu/lb-°F)
	$\rho$ = Density of air (lb/ft <sup>3</sup> )
<i>Units</i>	Degrees Fahrenheit (°F)
<i>Input Restrictions</i>	As designed, but may need to be increased if UMLH are greater than 300
<i>Baseline Building</i>	Same as proposed. If the proposed building doesn't have a reheat system, then the reheat delta T shall be based on a supply-air-to-room-air temperature difference of 20°F and shall be no more than 40°F

**3.6.4 Baseboard Heat****Baseboard Capacity**

<i>Applicability</i>	All HVAC zones
<i>Definition</i>	The total heating capacity of the baseboard unit(s)
<i>Units</i>	Btu/h
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable to the baseline building

**Baseboard Heat Control**

<i>Applicability</i>	All HVAC zones
<i>Definition</i>	Defines the control scheme of base board heating as either: <ul style="list-style-type: none"> <li>• Controlled by a space thermostat</li> <li>• Controlled based on outdoor air temperature</li> </ul>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable for the baseline building

### 3.6.5 Zone Level Airflow

#### 3.6.5.1 VAV Airflow

This group of building descriptors applies to proposed design systems that vary the volume of air at the zone level. The building descriptors are applicable for baseline building systems 5 through 8 and system 11.

##### ***Design Airflow***

<i>Applicability</i>	Systems 5 through 8 and 11 that vary the volume of air at the zone level
<i>Definition</i>	The air delivery rate to each zone at design conditions
<i>Units</i>	cfm
<i>Input Restrictions</i>	As designed. If the UMLH in the proposed design are greater than 300, the simulation should not proceed and the user may have to modify the design airflow value.
<i>Baseline Building</i>	<p>For systems 5 through 8 and 11, the software shall automatically size the system airflow to meet the baseline building loads based on</p> <ul style="list-style-type: none"> <li>• a supply-air-to-room-air temperature difference of 17°F for systems serving laboratory spaces and 20°F for all other spaces</li> <li>• or the minimum outdoor airflow rate,</li> <li>• or the airflow rate required to comply with the applicable codes or accreditation standards, whichever is greater.</li> </ul> <p>The baseline system airflow is determined by the load to be met by the airflow and the 20°F (11°C) temperature difference. The loads to be used would be the design load as determined by the sizing runs specified in Section G3.1.2.2, not the cooling or heating capacity of the system as determined using the sizing factors, also specified in G3.1.2.2. Using the system cooling and heating capacity will result in oversized baseline system airflows and energy cost because of the oversizing factors used in G3.1.2.2.</p> <p>For zones served by baseline systems with multiple zone thermostat setpoints (systems 5 to 8), the design set points used should result in either the lowest supply air cooling setpoint or highest heating supply air heating setpoint.</p> <p>If the proposed design HVAC system airflow rate based on latent loads greater than the same based on sensible loads, then the same supply-air-to-room humidity ratio difference (gr/lb) used to calculate the proposed design airflow should be used to calculate the design airflow rates for the baseline building.</p> <p>For baseline systems 9 and 10, the design supply airflow rates shall be based on the temperature difference between a SAT setpoint of 105°F and the design space heating temperature setpoint, the minimum outdoor airflow rate or the airflow rate required to comply with applicable codes, whichever is greater.</p>

##### ***Terminal Minimum Stop***

<i>Applicability</i>	Systems that vary the volume of air at the zone level
<i>Definition</i>	The minimum airflow that will be delivered to a zone. For systems with reheat (system 5 to 8) the minimum flow before reheating occurs
<i>Units</i>	Unitless fraction of airflow (cfm) or specific airflow (cfm/ft <sup>2</sup> )
<i>Input Restrictions</i>	This input must be greater than or equal to the outside air ventilation rate

**Baseline Building** For systems 5 to 8, the minimum airflow for the VAV reheat boxes should be set to 30% of the zone peak supply air volume or the outside air ventilation rate, or the airflow rate required to comply with applicable codes or accreditation standards, whichever is larger. Refer to the section Zone Exhaust for requirements related to systems serving laboratory spaces.

For baseline system 11, minimum volume setpoint shall be 50% of the maximum design airflow rate, the minimum ventilation outdoor airflow rate, or the airflow rate required to comply with applicable codes or accreditation standards, whichever is larger. Fan volume shall be reset from 100% airflow at 100% cooling load to minimum airflow at 50% cooling load. In heating mode, supply air temperature shall be modulated to maintain space temperature and fan volume shall be fixed at the minimum airflow.

Systems serving laboratory spaces shall reduce the exhaust and makeup air volume during unoccupied periods to the largest of 50% of zone peak airflow, the minimum outdoor airflow rate, or the airflow rate required to comply with applicable codes or accreditation standards.

### Terminal Heating Control Type

**Applicability** VAV boxes with reheat

**Definition** The control strategy for the heating mode. The nomenclature in simulation programs to simulate this may differ from that provided below.

#### Single Maximum

In the single maximum control mode, the airflow is set to a minimum constant value in both the deadband and heating mode. This airflow can vary but is typically 30% to 50% of maximum. This control mode typically has a higher minimum airflow than the minimum used in the dual maximum below, resulting in more frequent reheat.

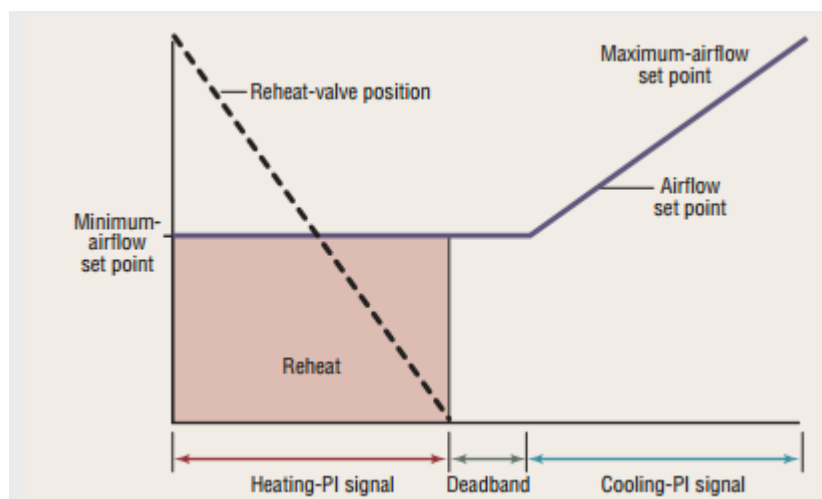


Figure 6. Single Maximum VAV Box Control (Courtesy: Taylor Engineering)

**Dual Maximum:** raises the SAT as the first stage of heating, and increases the airflow to the zone as the second stage of heating.

1. The first stage of heating consists of modulating the zone SAT setpoint up to a maximum setpoint no larger than 95°F while the airflow is maintained at the dead band flow rate.

2. The second stage of heating consists of modulating the airflow rate from the dead band flow rate up to the heating maximum flow rate (50% of design flow rate) while maintaining the maximum setpoint temperature.

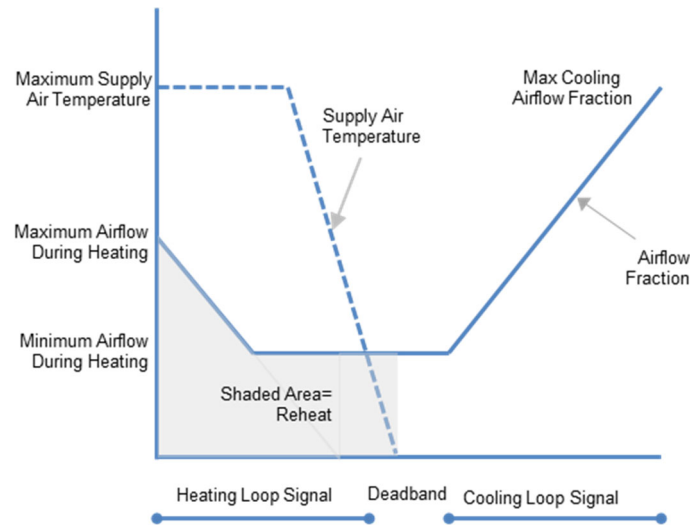


Figure 7. Dual Maximum Control Sequence

<i>Units</i>	List: Single Maximum, Dual Maximum
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	<p>Single maximum at 30% of zone peak airflow or the outside air ventilation rate, or the airflow rate required to comply with applicable codes or accreditation standards, whichever is larger. The ventilation outdoor air and exhaust/relief dampers should be shut-off during preoccupancy building warm-up, cool down and setback except for economizer operation.</p> <p>Refer to the section Zone Exhaust for requirements related to laboratory spaces.</p> <p>For baseline system 11, fan volume shall be reset from 100% airflow at 100% load to minimum airflow at 50% cooling load. The minimum airflow shall be 50% of the maximum design airflow rate, the minimum ventilation rate or the airflow required to comply with applicable codes or accreditation stations, whichever is larger.</p> <p>Systems serving laboratory spaces shall reduce the exhaust and makeup air volume during unoccupied periods to the largest of 50% of zone peak airflow, the minimum outdoor airflow rate, or the airflow rate required to comply with applicable codes or accreditation standards.</p>

### 3.6.5.2 Overhead Fan-Powered Boxes

This group of building descriptors applies to terminal equipment that includes zone fans for overhead VAV systems. The building descriptors are applicable for baseline building systems 6 and 8. When parallel fan powered boxes are required for the baseline building, terminal fans shall run as the first stage of heating before the reheat coil is energized. Fans in parallel VAV fan-powered boxes shall be sized for 50% of the peak design primary air (from the VAV air-handling unit) flow rate and shall be modeled with 0.35 W/cfm fan power. Minimum volume setpoints for fan-powered boxes shall be equal to 30% of peak design primary airflow rate or the rate required to meet the minimum outdoor air ventilation requirement, whichever is larger. The supply air temperature setpoint shall be constant at the design condition.



**Fan-Powered Box Type**

<i>Applicability</i>	HVAC zones that have fan-powered boxes
<i>Definition</i>	Defines the type of fan-powered induction box. This is either: <ul style="list-style-type: none"> <li>• Series, constant volume box fan; or</li> <li>• Parallel, constant volume box fan</li> </ul>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Applicable to baseline systems 6 and 8 and the fan-powered box type is parallel, with a constant volume fan

**Fan Power**

<i>Applicability</i>	HVAC zones that have fan-powered boxes
<i>Definition</i>	The rated power input of the fan in a fan-powered box
<i>Units</i>	W or W/cfm
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	For baseline building systems 6 and 8, power is prescribed at 0.35 W/cfm

**Parallel Fan-Powered Box-Induced Air Zone**

<i>Applicability</i>	HVAC zones that have fan-powered boxes
<i>Definition</i>	Zone from which a series or parallel fan-powered box draws its air
<i>Units</i>	List (of zones)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	If the proposed design has a plenum, then induced air will be drawn from that plenum. If the proposed design does not have a plenum, then induced air will be drawn from the space.

**Parallel Fan-Powered Box- Induction Ratio**

<i>Applicability</i>	HVAC zones that have fan-powered boxes
<i>Definition</i>	The ratio of induction-side airflow of a fan-powered box at design heating conditions to the design primary airflow
<i>Units</i>	Ratio
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	50%

**Parallel Fan Box Thermostat Setpoint**

<i>Applicability</i>	HVAC zones that have parallel fan-powered boxes
<i>Definition</i>	The temperature difference above the heating setpoint at which the parallel fan is turned on
<i>Units</i>	Degrees Fahrenheit (°F)
<i>Input Restrictions</i>	2°F above the heating setpoint schedule
<i>Baseline Building</i>	2°F above the heating setpoint schedule

**Fan-Powered Boxes: Terminal Heating Control Type**

*Applicability* HVAC zones that have parallel fan-powered boxes

*Definition* Fan Control: With parallel style fan-powered VAV boxes, the constant volume terminal unit fan is only on when the primary airflow is at design minimum and the zone temperature is less than 2°F above the heating setpoint schedule. When the system is scheduled to operate and the zone terminal fan is running, the box mixes plenum air with primary air.

Heating Operation: During heating mode, the terminal unit discharge air temperature is increased from minimum to the design heating temperature. Throughout occupied heating the cooling, primary airflow is kept at design minimum and the terminal unit fan is running.

Deadband Operation: The cooling primary airflow is kept at minimum airflow and the heating valve is closed. The terminal unit fan will energize as the first stage of heating when the zone temperature drops to 2°F. above heating setpoint.

Cooling Operation: As the space temperature increases, the cooling supply airflow is increased from minimum to design cooling maximum. Throughout cooling the box fan is off. To comply with Standard 90.1-2019 Section 6.5.2.1, Exception (1), the minimum primary airflow for this control logic must be no larger than 30% of the zone design cooling airflow or the minimum airflow for ventilation.

Night Cycle Heating Control: A call for heating during night cycle control shall be met by running the terminal fan and increasing the terminal unit discharge air temperature from minimum to the design heating temperature without the use of primary air.

Single Maximum Parallel Fan Powered VAV Box Control:

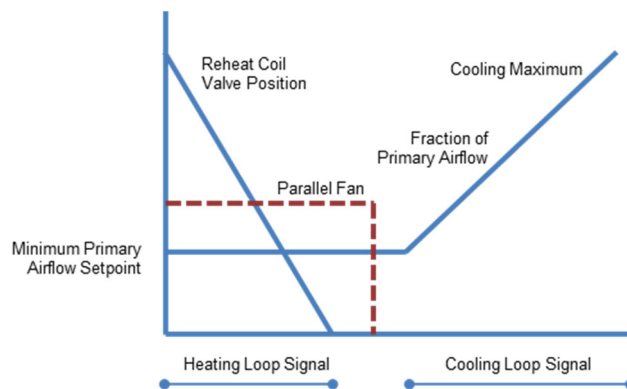


Figure 8. Single Maximum Control Sequence for Parallel Fan Powered VAV with Reheat Boxes

*Units* List: Single Maximum, Other

*Input Restrictions* As designed

*Baseline Building* Single maximum with minimum airflow rate set to 30% of peak design primary airflow rate or the outside air ventilation rate, whichever is larger

### 3.6.5.3 Zone Exhaust

This group of building descriptors describes the rate of exhaust and the schedule or control for this exhaust. An exhaust system can serve one thermal zone or multiple thermal zones. Energy is summed for the exhaust system level, not the thermal zone level.

#### ***Kitchen: Exhaust Hood Length***

<i>Applicability</i>	Exhaust fans in spaces of type kitchen
<i>Definition</i>	The exhaust hood length
<i>Units</i>	ft
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Same as the proposed design

#### ***Kitchen: Exhaust Hood Style***

<i>Applicability</i>	Exhaust fans in spaces of type kitchen
<i>Definition</i>	This input defines the style of the kitchen hood
<i>Units</i>	List: Wall-Mounted Canopy, Single Island, Double Island, Eyebrow, Backshelf/Passover
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Same as the proposed design

#### ***Kitchen: Exhaust Hood Cooking Duty***

<i>Applicability</i>	Exhaust fans in spaces of type kitchen
<i>Definition</i>	The hood cooking duty as defined in Table 6.5.7.2.2 of Standard 90.1-2019
<i>Units</i>	List: Light Duty, Medium Duty, Heavy Duty, Extra Heavy Duty
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Same as the proposed design

#### ***Kitchen: Exhaust Airflow Rate***

<i>Applicability</i>	Exhaust fans in spaces of type kitchen
<i>Definition</i>	Rate of exhaust from a thermal zone. Standard 90.1-2019, Section 6.5.7.2.2, requires each hood in a kitchen/dining facility with a total kitchen hood exhaust airflow rate greater than 5,000 cfm to have an exhaust rate that complies with Table 39. If a single hood, or hood section, is installed over appliances with different duty ratings, then the maximum allowable flow rate for the hood or hood section shall not exceed the Table 39 values for the highest appliance duty rating under the hood or hood section.

Table 39. Maximum Net Exhaust Flow Rate, cfm per Linear Foot of Hood Length

Type of Hood	Light Duty Equipment	Medium Duty Equipment	Heavy Duty Equipment	Extra Heavy Duty Equipment
Wall-mounted canopy	140	210	280	385
Single island	280	350	420	490
Double island (per side)	175	210	280	385
Eyebrow	175	175	Not allowed	Not allowed
Backshelf/passover	210	210	280	Not Allowed

<i>Units</i>	cfm
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	The exhaust air flow rate for the baseline building should be equal to the exhaust flow rate prescribed in Table 39

#### ***Kitchen: Demand Ventilation***

<i>Applicability</i>	All kitchen HVAC zones
<i>Definition</i>	A demand ventilation system uses a light beam and a photo detector to detect the presence of smoke. It also has a temperature sensor to detect heat. The exhaust fan slows down below design levels and both exhaust and replacement airflow rates are reduced when the system detects no smoke or heat.
<i>Units</i>	Unitless
<i>Input Restrictions</i>	As designed. Exhaust fans controlled with a demand ventilation system with a minimum flow no more than 50% shall be modeled as running at 75% during all exhaust fan operating hours.
<i>Baseline Building</i>	Same as proposed except fan speed would not be reduced due to demand ventilation systems

#### ***Laboratory: Exhaust Minimum Airflow Rate***

<i>Applicability</i>	All laboratory zones
<i>Definition</i>	Rate of exhaust from a zone
<i>Units</i>	cfm
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	<p>Same as proposed except for the unoccupied periods, where systems serving laboratory spaces shall reduce the exhaust and makeup air volume during unoccupied periods to the largest of 50% of zone peak airflow, the minimum outdoor airflow rate, or the airflow rate required to comply with applicable codes or accreditation standards.</p> <p>Baseline systems serving only laboratory spaces that are prohibited from recirculating return air by code or accretion standard, the baseline system shall be modeled with 100% outdoor air.</p>

**Exhaust Fan Name**

<i>Applicability</i>	All HVAC zones
<i>Definition</i>	A reference to an exhaust fan system that serves the thermal zone
<i>Units</i>	Text or other unique reference to an exhaust fan system defined in the secondary systems section
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Same as the proposed design

**Exhaust Fan Operation Schedule**

<i>Applicability</i>	All HVAC zones
<i>Definition</i>	Schedule indicating the pattern of use for exhaust air from the thermal zone. For laboratory exhaust hoods, this input should consider the position of fume hood sash opening. For toilets and other exhaust applications, the schedule may coincide with the operation of the exhaust fan system.
<i>Units</i>	Data structure: schedule, fraction
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Same as proposed except for the unoccupied periods, where systems serving laboratory spaces shall reduce the exhaust and makeup air volume during unoccupied periods to the largest of 50% of zone peak airflow, the minimum outdoor airflow rate, or the airflow rate required to comply with applicable codes or accreditation standards

**3.6.5.4 Outdoor Air Ventilation****Outdoor Air Ventilation Source**

<i>Applicability</i>	All HVAC zones
<i>Definition</i>	The source of outdoor air ventilation for an HVAC system. The choices are: <ul style="list-style-type: none"> <li>• Natural (by operable openings)</li> <li>• Mechanical (by fan)</li> </ul>
<i>Units</i>	List: Natural or mechanical
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Ventilation is set to mechanical for the baseline building

**Minimum Outdoor Air Ventilation Rate**

<i>Applicability</i>	All HVAC zones
<i>Definition</i>	The minimum quantity of outdoor ventilation air that must be provided to the space when it is occupied
<i>Units</i>	cfm or cfm/ft <sup>2</sup>
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Minimum ventilation system outdoor air intake flow shall be the same for the proposed and baseline building designs. Except in the following conditions: <ul style="list-style-type: none"> <li>• Demand control ventilation shall not be modeled in zones served by systems with outdoor air less than 3000 cfm and occupant density of 100 people per 1000 ft<sup>2</sup> or less.</li> </ul>

- If the minimum outdoor air intake flow in the proposed design is provided in excess of the amount required by the rating authority or building official, then the baseline building design shall be modeled to reflect the greater of that required by the rating authority or building official and will be less than the proposed design.
- For systems serving kitchens, the minimum outside air ventilation rate is the exhaust air ventilation rate minus available transfer air. Refer to building descriptor Kitchen Exhaust.
- For systems serving laboratories, refer to building descriptor Laboratory Exhaust, Section 3.6.5.3.
- When designing systems in accordance to Standard 62.1, Section 6.2, “Ventilation Rate Procedure”. Refer to Section 3.6.5.5 of this document for requirements.

*Example*

Example 1: Should DCV be required in the following case? Can a savings credit be taken?

- Proposed Design: Every other floor DOAS air handlers with 8,000cfm of OSA controlled by demand controlled ventilation.
- Baseline: System 7 VAV, floor by floor with 4,000cfm of OSA

Answer: No the design does not meet the exceptions listed above, therefore both designs should be modeled with DCV. If the design airflow of the system in question was less than 3000 CFM then DCV would only be modeled in the proposed case and credit could be taken.

**Design Outdoor Air Ventilation Rate and Schedule**

*Applicability*

All HVAC zones

*Definition*

The quantity of outdoor air ventilation that is provided to the space for the specified thermal zone at maximum occupancy

*Units*

cfm or cfm/occupant

*Input Restrictions*

The outdoor air ventilation rate would be as designed.

Outdoor air ventilation schedule for proposed building can be either of the two:

- As designed
- The outdoor air ventilation schedule follows the HVAC availability schedule. In this case outdoor air isn't supplied during unoccupied times or during night cycling operation.

Some proposed building designs might bring in ventilation air during unoccupied hours for night flush or economizer operation. Due to these reasons, an option for user input of schedule for outdoor air availability is provided.

*Baseline Building*

Same as proposed, except:

- When designing systems in accordance with ASHRAE Standard 62.1, Section 6.2, Ventilation Rate Procedure, where the proposed design has a zone air distribution effectiveness greater than 1.0, the baseline ventilation shall be calculated using the proposed design ventilation rate procedure calculation with the zone air distribution effectiveness changed to 1.0. Refer to Section 3.6.5.5 for details on the ventilation rate procedure.
- If the proposed design ventilation rate exceeds that required by the rating authority or building official, then the baseline design ventilation rate shall be only what is required by the rating authority or building official, whichever is greater.

### Ventilation Control Method

<i>Applicability</i>	All HVAC zones
<i>Definition</i>	<p>The method used to determine outside air ventilation needed for each hour in the simulation. This information is reported to the system serving the zone. The method of controlling outside air at the system level in response to this information is discussed under secondary systems. Options at the zone level are:</p> <ul style="list-style-type: none"> <li>• Occupant sensors: When the space is occupied, the outside air requirement is equal to the <i>design ventilation rate</i>; otherwise, the outside air requirement is the <i>minimum ventilation rate</i>.</li> <li>• CO<sub>2</sub> sensors in the space: The outside air is varied to maintain a maximum CO<sub>2</sub> concentration in the space. This shall be approximated by multiplying the ventilation rate per occupant by the number of occupants for that hour. (When turnstile counts are used to automatically adjust ventilation levels based on occupancy, this method may also be used.)</li> <li>• Fixed ventilation rate: Outside air is delivered to the zone at a constant rate and is equal to the design ventilation rate (see above).</li> </ul>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	<p>Baseline building shall be modeled with a fixed ventilation rate which would be equal to the design ventilation rate (see above). No ventilation control methods shall be modeled for the baseline building design except for the following:</p> <ul style="list-style-type: none"> <li>• Demand control ventilation shall be modeled in zones served by systems with outdoor air greater than or equal to 3000 cfm and occupant density of 100 people per 1000 ft<sup>2</sup> or less.</li> </ul>

### Design Ventilation Rate: Demand Control Ventilation

<i>Applicability</i>	All HVAC zones
<i>Definition</i>	<p>Demand control ventilation is required for spaces larger than 500 ft<sup>2</sup> and with a design occupancy for ventilation of greater than or equal to 25 people per 1000 ft<sup>2</sup> of floor area and served by systems with one or more of the following:</p> <ol style="list-style-type: none"> <li>An air-side economizer</li> <li>Automatic modulating control of the outdoor air damper</li> <li>A design outdoor airflow greater than 3000 cfm</li> </ol> <p><b>Exceptions:</b></p> <ol style="list-style-type: none"> <li>Systems with the exhaust air energy recovery complying with Standard 90.1-2019, Section 6.5.6.1</li> <li>Multiple-zone systems without dynamic demand control (DDC) of individual zones communicating with a central control panel</li> <li>Systems with a design outdoor airflow less than 750 cfm</li> <li>Spaces where &gt;75% of the space design outdoor airflow is required for makeup air that is exhausted from the space or transfer air that is required for makeup air that is exhausted from other spaces.</li> <li>Spaces with one of the following occupancy categories as defined in ASHRAE Standard 62.1: correctional cells, daycare sickrooms, science labs, barbers, beauty and nail salons, and bowling alley seating.</li> </ol>

<i>Units</i>	cfm or cfm/occupant
<i>Input Restrictions</i>	As designed. DCV is a mandatory requirement for spaces larger than 500 ft <sup>2</sup> , with design occupancy of more than 25 people per 1000 ft <sup>2</sup> unless any of the exceptions specified above apply.
<i>Baseline Building</i>	DCV is not modeled for the baseline building except for zones served by systems with outdoor air greater than or equal to 3000 cfm and occupant density of 100 people per 1000 ft <sup>2</sup> or less

### 3.6.5.5 Ventilation Rate Procedure

#### ***Ventilation Standard***

<i>Applicability</i>	All projects
<i>Definition</i>	The ventilation standard used for the calculation of minimum ventilation rate required. The ventilation rates are defined based on the ventilation standard selected. This should be specified at the project level.
<i>Units</i>	List. ASHRAE Standard 62.1, IMC-2012, Title-24-2013, ASHRAE 170, Other
<i>Input Restrictions</i>	No restrictions. Any of the defined standards can be selected.
<i>Baseline Building</i>	Same as proposed  The baseline rules for determining the use of DCV are defined according to Standard 90.1-2019, for any specified standard, including ‘Other’.

#### ***Ventilation Specification Method***

<i>Applicability</i>	All HVAC zones
<i>Definition</i>	The method used to calculate total ventilation rates to a zone. The input must be either “Sum,” “Maximum,” or “No Ventilation.” <ul style="list-style-type: none"> <li>• Sum means that the flows calculated from the fields Outdoor Airflow per Person and Outdoor Airflow per Area will be added to obtain the zone outdoor airflow rate.</li> <li>• Maximum means that the maximum flow derived from Outdoor Airflow per Person, Outdoor Airflow per Area, and Air Changes per Hour (using the associated conversions to cfm for each field) will be used as the zone outdoor airflow rate.</li> <li>• No ventilation indicates that the zone doesn’t receive any outdoor air.</li> </ul>
<i>Units</i>	List: Sum, Maximum, No Ventilation
<i>Input Restrictions</i>	As designed.  For ventilation standard specified as = “62.1” and “IMC-2012,” the only available specification method would be “Sum.” For “T24-2013,” the only available specification method is “Maximum.” For ventilation standard specified as “Other,” the specification method can be specified as either Sum or Maximum, and includes all components.
<i>Baseline Building</i>	Same as proposed



**Zone Air Distribution Effectiveness**

<i>Applicability</i>	All HVAC zones and spaces
<i>Definition</i>	The zone air distribution effectiveness ( $E_z$ ) shall be no greater than the default value determined using Table 40.

Table 40. Air Distribution Effectiveness (ASHRAE Standard 62.1-2010)

Air Distribution Configuration	$E_z$
Ceiling supply of cool air	1.0
Ceiling supply of warm air and floor return	1.0
Ceiling supply of warm air 15°F (8°C) or more above space temperature and ceiling return	0.8
Ceiling supply of warm air less than 15°F (8°C) above space temperature and ceiling return provided that the 150 fpm (0.8 m/s) supply air jet reaches to within 4.5 ft (1.4 m) of floor level. Note: For lower velocity supply air.	1.0
Floor supply of cool air and ceiling return provided that the 150 fpm (0.8 m/s) supply jet reaches 4.5 ft (1.4 m) or more above the floor. Note: Most underfloor air distribution systems (UFADs) comply with this provision.	1.0
Floor supply of cool air and ceiling return, provided low-velocity displacement ventilation (DV) achieves unidirectional flow and thermal stratification	1.2
Floor supply of warm air and floor return	1.0
Floor supply of warm air and ceiling return	0.7
Makeup supply drawn in on the opposite side of the room from the exhaust and/or return	0.8
Makeup supply drawn in near to the exhaust and/or return location	0.5

<i>Units</i>	None
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Same as proposed

**Ventilation Multiplier**

<i>Applicability</i>	All projects
<i>Definition</i>	The ventilation multiplier is defined at the project level. This multiplier is applied to the user's design component ventilation rates ( $R_a$ and $R_p$ ) to uniformly increase the component ventilation rates entered. The principal purpose of the multiplier is to facilitate simulating a uniform increase in proposed design ventilation rates, such as for buildings pursuing the LEED credit for 30% increased ventilation.
<i>Units</i>	No units
<i>Input Restrictions</i>	As designed. The default value is 1.
<i>Baseline Building</i>	The ventilation multiplier is always 1 for the baseline building

## Ventilation Rates

<i>Applicability</i>	All HVAC zones
<i>Definition</i>	<p>The method used to calculate total ventilation rates to a zone. The input must be either flow/person, flow/area, flow/zone, air changes/hour, sum, or maximum.</p> <ul style="list-style-type: none"> <li>• Flow/Person (Rp) means the program will use the input from the field Outdoor Airflow per Person and the actual zone occupancy to calculate a zone outdoor airflow rate.</li> <li>• Flow/Area (Ra) means that the program will use the input from the field Outdoor Airflow per Zone Floor Area and the actual zone floor area as the zone outdoor airflow rate. Flow/Zone means that the program will use the input of the field Outdoor Airflow per Zone as the zone outdoor airflow rate.</li> <li>• Air changes per hour (ACH) means that the program will use the input from the field Air Changes per Hour and the actual zone volume (divided by 3600 seconds per hour) as the zone outdoor airflow rate.</li> <li>• For non-occupied spaces, the values for Ra, Rp and ACH can be zero for the proposed and baseline building. Software tools can allow a check-box for indicating spaces that would be non-occupied and hence are permitted to have a value for zero for Ra and Rp.</li> </ul>
<i>Units</i>	List: Flow/Person, Flow/Area, Air Changes per Hour
<i>Input Restrictions</i>	<p>As designed.</p> <p>If the user specifies ventilation standard as 'Other' and DCV is used, a non-zero value for Rp must be specified for the ventilation air flow to vary with occupancy.</p>
<i>Baseline Building</i>	<p>The ventilation rates for the baseline building are determined by the ventilation standard and the space function.</p> <p>For zones/spaces with ventilation standard specified as 'Other'</p> <ul style="list-style-type: none"> <li>• The code minimum ventilation rates are required to be specified by the user.</li> <li>• If DCV controls are not specified for the proposed but are required for the baseline, the ventilation rate for the area component is determined based on Standard 62.1 and the balance of the user's total design air flow is allocated to the Rp component for the baseline.</li> </ul>

### Total Design Zone Ventilation Airflow

*Applicability* All HVAC zones

*Definition* The total design outdoor air supplied to a zone ( $V_{z\text{-design}}$ ).

Minimum outdoor air supplied to a zone ( $V_{bz\text{-min}}$ ) is calculated based on the user input values of the ventilation multiplier ( $V_m$ ),  $E_z$ ,  $R_a$  and  $R_p$ . The method used to calculate total minimum ventilation airflow to a zone is specified below-

$$V_{bz\text{-min}} = V_m \times [(R_p \times P_z + R_a \times A_z)/E_z] \quad (8)$$

Where,

$V_{bz\text{-min}}$  = Total Breathing Zone Outdoor Airflow (CFM)

$V_m$  = Ventilation Multiplier

$R_p$  = Outdoor Airflow Rate per Person (CFM/person)

$R_a$  = Outdoor Airflow Rate per unit Area (CFM/ft<sup>2</sup>)

$P_z$  = Zone Population: The number of people in the zone during typical occupancy

$A_z$  = Zone Floor Area (ft<sup>2</sup>): the net occupiable floor area of the zone.

*Units* List: CFM

*Input Restrictions* As designed. The total design ventilation airflows should also include the impact of  $E_z$  and the ventilation multiplier. The user entered value for space/zone design ventilation airflow is required to be within 3% of the value calculated from the user entered  $R_a$ ,  $R_p$ ,  $E_z$  and  $V_m$  values. The user is required to modify the values for  $R_a$ ,  $R_p$  or  $E_z$  such that the total airflow calculated from the components and the user defined airflow is within the tolerance limit. Similarly, if DCV controls are used in the proposed building design, the user entered value for  $V_{z\text{-design}}$  should be within 3% tolerance of the value calculated by the design area rate component ( $R_a$ ) and  $E_z$ .

Exhaust airflows are checked at the building story level. If the sum of proposed total design ventilation airflows for all spaces on a building story level (excluding spaces with ventilation standard specified as 'Other') is not within 10% of the calculated total code minimum ventilation airflow. To proceed, either the ventilation airflows for spaces that are under-ventilated, need to be increased or alternatively, the ventilation standard should be specified as 'Other' for spaces that are under-ventilated. For zones/spaces with DCV controls, the minimum ventilation airflow is the airflow when the space is unoccupied, calculated using the area component and  $E_z$ .

*Baseline Building* The baseline *design* ventilation airflow rates for all spaces/thermal zones equal the proposed with the exception of the following:

- a. The zone distribution effectiveness for the proposed building ( $E_z$ ) > 1. In this case,  $E_z = 1$  for the baseline building.
- b. The proposed design ventilation airflow, on a building story basis, exceeds the code minimum ventilation airflow for the building story. In this case, the baseline ventilation rates will be calculated by uniformly reducing the proposed rates such that the total ventilation airflow to spaces on the building story equals the code minimum flow. This maintains a proportional distribution of ventilation air to spaces/zones on the building story between the proposed and baseline designs. Spaces with ventilation standard specified as "Other" are excluded from adjustments, and the baseline design ventilation rate equals the proposed.
- c. The proposed design ventilation multiplier is greater than 1. In this case, the baseline design ventilation airflow is not increased by the multiplier. Instead, the

total baseline design ventilation airflow is adjusted, as described in exception b, to be equal to the code minimum ventilation airflow.

- d. The total proposed design ventilation airflow (excluding spaces with ventilation standard specified as “Other”), on a building story basis, is greater than 110% of the total building story exhaust airflow. In this case, the baseline design ventilation airflows will be calculated by uniformly reducing the proposed inputs (excluding spaces with ventilation standard specified as “Other”) such that the total ventilation airflow on the building story equals 110% of the total building story exhaust airflow. This maintains a proportional distribution of ventilation air (at design conditions) to spaces on the building story, while allowing sufficient additional ventilation air for pressurization.

<b>Total System Design Ventilation Airflow</b>	
<i>Applicability</i>	All HVAC systems.
<i>Definition</i>	The design outdoor air intake at the system level ( $V_{s\text{-design}}$ )
<i>Units</i>	CFM
<i>Input Restrictions</i>	As designed  Software tools are required to verify the input value for $V_{s\text{-design}}$ . For all the zones served by the system, software tools are required to sum the zone level ventilation ( $V_{bz\text{-min}}$ ) to calculate the minimum ventilation at the system level ( $V_{s\text{-min}}$ ). If the design outdoor air intake ( $V_{s\text{-design}}$ ) is less than the minimum ventilation airflow ( $V_{s\text{-min}}$ ), the input should be flagged and the user should be required to increase the value for $V_{s\text{-design}}$ until it is equal to or greater than $V_{s\text{-min}}$ .
<i>Baseline Building</i>	The total system ventilation airflow for the baseline building is the sum of the zone level ventilation for the baseline building

<b>System Ventilation Efficiency</b>	
<i>Applicability</i>	All HVAC systems
<i>Definition</i>	The efficiency of the ventilation system ( $E_v$ ). This is the ratio of the design ventilation airflow to the minimum system ventilation airflow.  $E_v = V_{s\text{-min}} / V_{s\text{-design}} \tag{9}$
<i>Units</i>	Ratio (unitless)
<i>Input Restrictions</i>	Calculated by software tool  Software tools are required to calculate and verify the input value for $E_v$ . The maximum value of $E_v=1$ (for single zone systems). If $E_v$ is greater than 1, an error should be displayed to the user and the user is required to increase the value of $V_{s\text{-design}}$ until the value of $E_v$ is less than or equal to 1.
<i>Baseline Building</i>	Same as proposed for all zones served by the proposed system. In the scenario where the building has a multizone system in the proposed case, but single zone system in the baseline case, all the zones served by the Multizone system in the proposed case have $E_v$ same as the proposed system.  Similarly, if the proposed system is single zone and the baseline building has multizone systems, then the corresponding zones would have $E_v$ specified as 1, same as the proposed building.  This approach ensures that the ventilation rates are the same between the baseline and the proposed building.

### 3.7 HVAC Secondary Systems

This group of building descriptors relate to the secondary HVAC systems. There is not a one-to-one relationship between secondary HVAC system components in the proposed design and the baseline building since the baseline building system is determined from building type, size, and heating source. Depending on the nature of the proposed design, any of the building descriptors could apply. The HVAC baseline systems are described in the summary tables below for reference. The details of individual building descriptor definitions can be found in Sections 3.8 and 3.9.

Table 41. System 1 and System 2 Descriptions

System Description	Packaged terminal air conditioner (#1) or packaged terminal heat pump (#2)
Supply Fan Power	Fan power integral to unit efficiency. Fan power = $0.3 \times \text{cfm}_s$ . Refer to building descriptor Fan Systems. Ventilation is provided through the system.
Supply Fan Control	Constant volume
Min Supply Temp	20°F below occupied space cooling setpoint
Cooling System	DX
Cooling Efficiency	Minimum seasonal energy efficiency ratio (SEER) or EER based on equipment type and output capacity of proposed unit(s). Adjusted EER is calculated to account for supply fan energy.
Maximum Supply Temp	20°F above occupied space heating setpoint
Heating System	Hot water boiler (#1) or heat pump (#2)
Heating Efficiency	Minimum annual fuel utilization efficiency (AFUE), thermal efficiency, COP, or heating seasonal performance factor (HSPF) based on equipment type and output capacity of baseline unit(s)
Economizer	None
Ducts	N/A (not ducted)

Table 42. System 3 and System 4 Descriptions

System Description	Packaged single zone with gas furnace/electric air conditioning (#3) or heat pump (#4)
Supply Fan Power	See building descriptor Fan Systems, Section 3.7.3 of this document
Supply Fan Control	Constant volume
Min Supply Temp	20°F below occupied space cooling setpoint
Cooling System	DX
Cooling Efficiency	Minimum SEER or EER based on equipment type and output capacity of baseline unit(s). Adjusted EER is calculated to account for supply fan energy.
Maximum Supply Temp	20°F above occupied space heating setpoint
Heating System	Fossil fuel furnace (#3) or heat pump (#4)
Heating Efficiency	Minimum AFUE, thermal efficiency, COP, or HSPF based on equipment type and output capacity of baseline unit(s)
Economizer	Integrated economizer with dry-bulb high limit by climate zone. Refer to building descriptor Outside Air Controls and Economizer, Section 3.7.4, for details.

Table 43. System 5 Description

System Description	Packaged VAV with DX cooling, fossil fuel boiler and hot-water reheat
Supply Fan Power	See building descriptor Fan Systems, Section 3.7.3 of this document
Supply Fan Control	<ul style="list-style-type: none"> <li>• Variable speed controlled by variable speed drives</li> <li>• The part load performance of VAV fans is required to be modeled in accordance to section Fan Part Load Curve in Fan Systems, Section 3.7.3 of this document</li> </ul>
Return Fan Control	Same as supply fan
Minimum Supply Temp	20°F below occupied space cooling setpoint
Supply Temp Control	The air temperature for cooling shall be reset higher by 5°F under minimum cooling load conditions. This strategy is described in Section 3.7.2.2 of this document.
Cooling System	DX
Cooling Efficiency	Minimum efficiency based on average output capacity of equipment unit(s)
Maximum Supply Temp	20°F above occupied space heating setpoint
Heating System	Hot water boiler, with hot water (HW) reheat
Reheat Terminal Airflow	System 5: Minimum volume setpoint for reheat is highest of 30% of zone peak flow, minimum outdoor airflow rate or airflow rate required by applicable rating authority. See Section 3.7.5 for details.
Hot Water Pumping System	The pumping system shall be modeled as primary-only with continuous variable flow and a minimum of 25% of the design flow rate. Hot-water systems serving 120,000 ft <sup>2</sup> or more shall be modeled with variable-speed drives, and systems serving less than 120,000 ft <sup>2</sup> shall be modeled as riding the pump curve. See Section 3.8.5 of this document for details.
Heating Efficiency	Minimum efficiency based on average output capacity of baseline equipment unit(s)
Economizer	Integrated economizer with dry-bulb high limit by climate zone. Refer to building descriptor Outside Air Controls and Economizer, Section 3.7.4, for details.

Table 44. System 6 Description

System Description	Packaged VAV, with DX cooling, electric heating and parallel fan-powered boxes with electric heat
Supply Fan Power	See building descriptor Fan Systems, Section 3.7.3 of this document
Supply Fan Control	<ul style="list-style-type: none"> <li>• Variable speed controlled by variable speed drives</li> <li>• The part load performance of VAV fans is required to be modeled in accordance to section Fan Part Load Curve in Fan Systems</li> <li>• Power induction unit (PIU) fan would be constant volume</li> </ul>
Return Fan Control	Same as supply fan
Minimum Supply Temp:	20°F below occupied space cooling setpoint
Supply Temp Control	The air temperature for cooling shall be reset higher by 5°F under minimum cooling load conditions. This strategy is described in Section 3.7.2.2 of this document.
Cooling System	DX cooling
Cooling Efficiency	Minimum efficiency based on average output capacity of equipment unit(s)
Maximum Supply Temp	20°F above occupied space heating setpoint
Heating System	Electric resistance, electric reheat terminals
Heating Efficiency	NA
Reheat Terminal Airflow	Fans for PIU units are sized for 50% of peak design primary air. Minimum volume setpoint for reheat is highest of 30% of peak design primary airflow rate, minimum outdoor airflow rate or airflow rate required by applicable rating authority. See Section 3.7.5 for details.
Economizer	Integrated economizer with dry-bulb high limit by climate zone. Refer to building descriptor Outside Air Controls and Economizer, Section 3.7.4, for details.

Table 45. System 7 Description

System Description	VAV system with HW boiler, HW reheat and chilled water (CHW) cooling
Supply Fan Power	See building descriptor Fan Systems, Section 3.7.3 of this document.
Supply Fan Control	Variable speed controlled by variable speed drives. The part load performance of VAV fans is required to be modeled in accordance with Fan Part Load Curve in Fan Systems.
Minimum Supply Temp	20°F below occupied space cooling setpoint
Supply Temp Control	The air temperature for cooling shall be reset higher by 5°F under minimum cooling load conditions. This strategy is described in Section 3.7.2.2 of this document.
Cooling System	Chiller
Cooling Efficiency	Minimum efficiency based on the output capacity of specific equipment unit(s)
Chilled Water Pumping System	The baseline building design pump power shall be 22 W/gpm. Chilled-water systems with a cooling capacity of 300 tons or more shall be modeled as primary/secondary systems with variable-speed drives on the secondary pumping loop and a minimum flow of 25% of the design flow rate. Chilled-water pumps in systems serving less than 300 tons cooling capacity shall be modeled as a primary/ secondary system with secondary pump riding the pump curve. See Section 3.8.5 of this document for details.
Chiller Type and Number	Electric chillers shall be used in the baseline building design. The baseline building design's chiller plant shall be modeled with chillers having the number and type as indicated in Standard 90.1-2019, Table G3.1.3.7, as a function of building peak cooling load.
Maximum Supply Temp	20°F above occupied space heating setpoint
Reheat Terminal Flow	System 5: Minimum volume setpoint for reheat is highest of 30% of zone peak flow, minimum outdoor airflow rate or airflow rate required by applicable rating authority. See Section 3.7.5 for details.
Heating System	Hot water boiler (system 8), hot water reheat
Hot Water Pumping System	The pumping system shall be modeled as primary-only with continuous variable flow and a minimum flow of 25% of the design flow rate. Hot-water systems serving 120,000 ft <sup>2</sup> or more shall be modeled with variable-speed drives, and systems serving less than 120,000 ft <sup>2</sup> shall be modeled as riding the pump curve.
Heating Efficiency	Minimum efficiency based on the output capacity of specific baseline equipment unit(s)
Economizer	Integrated economizer with dry-bulb high limit by climate zone. Refer to building descriptor 'Outside Air Controls and Economizer', Section 3.7.4, for details.



Table 46. System 8 Description

System Description	VAV with CHW cooling, electric resistance heating, and PFP boxes with electric heat
Supply Fan Power	See building descriptor Fan Systems, Section 3.7.3 of this document
Supply Fan Control	Variable speed controlled by variable speed drives. The part load performance of VAV fans is required to be modeled in accordance with section Fan Part Load Curve in Fan Systems.
Minimum Supply Temp	20°F below occupied space cooling setpoint
Supply Temp Control	The air temperature for cooling shall be reset higher by 5°F under minimum cooling load conditions. This strategy is described in Section 3.7.2.2 of this document.
Cooling System	Chiller
Cooling Efficiency	Minimum efficiency based on the proposed output capacity of specific equipment unit(s)
Chilled Water Pumping System	The baseline building design pump power shall be 22 W/gpm. Chilled-water systems with a cooling capacity of 300 tons or more shall be modeled as primary/secondary systems with variable-speed drives on the secondary pumping loop and a minimum flow of 25% of the design flow rate. Chilled-water pumps in systems serving less than 300 tons cooling capacity shall be modeled as a primary/secondary system with secondary pump riding the pump curve. See Section 3.8.5 of this document for details.
Chiller Type and Number	Electric chillers shall be used in the baseline building design. The baseline building design's chiller plant shall be modeled with chillers having the number and type as indicated in Standard 90.1-2019, Table G3.1.3.7, as a function of building peak cooling load.
Maximum Supply Temp	20°F above occupied space heating setpoint
Heating System	Electric resistance, electric resistance reheat
Reheat Terminal Airflow	Fans for PIU units are sized for 50% of peak design primary air. Minimum volume setpoint for reheat is highest of 30% of peak design primary airflow rate, minimum outdoor airflow rate or airflow rate required by applicable rating authority. See Section 3.7.5 for details.
Hot Water Pumping System	N/A
Heating Efficiency	N/A
Economizer	Integrated dry bulb economizer with dry-bulb high limit based on climate zone. Refer to building descriptor Outside Air Controls and Economizer, Section 3.7.4, for details.

Table 47. System 9 and System 10 Description

System 9 Description	Heating and ventilation only system
Supply Fan Power	See building descriptor Fan Systems, Section 3.7.3 of this document
Supply Fan Control	Constant volume
Minimum Supply Temp	N/A
Cooling System	None
Cooling Efficiency	N/A
Maximum Supply Temp	20°F above occupied space heating setpoint
Heating System	Gas furnace
Hot Water Pumping System	N/A
Heating Efficiency	Minimum efficiency based on the baseline output capacity of specific equipment unit(s)
Economizer	Not required for system 9
System 10 Description	Heating and ventilation only system
Supply Fan Power	See building descriptor 'Fan Systems'
Supply Fan Control	Constant volume
Minimum Supply Temp:	N/A
Cooling System	None
Cooling Efficiency	N/A
Maximum Supply Temp	20°F above occupied space heating setpoint
Heating System	Electric resistance
Hot Water Pumping System	N/A
Heating Efficiency	N/A
Economizer	Not required for system 10

Table 48. System 11 Description

System 11 Description	Single zone variable air volume system
Supply Fan Power	See building descriptor Fan Systems, Section 3.7.3 of this document
Supply Fan Control	Variable speed controlled by variable speed drives. The part load performance of VAV fans is required to be modeled in accordance with section Fan Part Load Curve in Fan Systems
Minimum Supply Temp	20°F below occupied space cooling setpoint
Cooling System	Chiller
Cooling Efficiency	Minimum efficiency based on the proposed output capacity of specific equipment unit(s)
Chilled Water Pumping System	The baseline building design pump power shall be 22 W/gpm. Chilled-water systems with a cooling capacity of 300 tons or more shall be modeled as primary/secondary systems with variable-speed drives on the secondary pumping loop and a minimum flow of 25% of the design flow rate. Chilled-water pumps in systems serving less than 300 tons cooling capacity shall be modeled as a primary/secondary system with secondary pump riding the pump curve. See Section 3.8.5 of this document for details.
Chiller Type and Number	Electric chillers shall be used in the baseline building design. The baseline building design's chiller plant shall be modeled with chillers having the number and type as indicated in Standard 90.1-2019, Table G3.1.3.7, as a function of building peak cooling load.
Maximum Supply Temp	20°F above occupied space heating setpoint
Heating System	For climate zones 0 to 3A, the baseline system shall be modeled with electric resistance heating. For all other climate zones, the heating system shall be hot-water fossil-fuel boiler.
Hot Water Pumping System	When boilers are required, the pumping system shall be modeled as primary-only with continuous variable flow and a minimum flow of 25% of the design flow rate. Hot-water systems serving 120,000 ft <sup>2</sup> or more shall be modeled with variable-speed drives, and systems serving less than 120,000 ft <sup>2</sup> shall be modeled as riding the pump curve.
Heating Efficiency	NA for electric resistance heating. For hot-water boilers, the minimum efficiency based on the output capacity of specific baseline equipment unit(s)
Reheat Terminal Flow	N/A
Economizer	Integrated dry bulb economizer with dry-bulb high limit based on climate zone. Refer to building descriptor Outside Air Controls and Economizer, Section 3.7.4, for details.

Table 49. System 12 and 13 Description

System 12, 13 Description	Single-zone system
Supply Fan Power	See building descriptor Fan Systems, Section 3.7.3 of this document
Supply Fan Control	Constant volume
Minimum Supply Temp	N/A
Cooling System	Chilled Water
Cooling Efficiency	Minimum efficiency based on the proposed output capacity of specific equipment unit(s)
Chilled Water Pumping System	The baseline building design pump power shall be 22 W/gpm. Chilled-water systems with a cooling capacity of 300 tons or more shall be modeled as primary/secondary systems with variable-speed drives on the secondary pumping loop and a minimum flow of 25% of the design flow rate. Chilled-water pumps in systems serving less than 300 tons cooling capacity shall be modeled as a primary/secondary system with secondary pump riding the pump curve. See Section 3.8.5 of this document for details.
Chiller Type and Number	Electric chillers shall be used in the baseline building design. The baseline building design's chiller plant shall be modeled with chillers having the number and type as indicated in Standard 90.1-2019, Table G3.1.3.7, as a function of building peak cooling load.
Maximum Supply Temp	20°F above occupied space heating setpoint
Heating System	Hot-water fossil fuel boiler for system 12 and electric resistance heating for system 13.
Hot Water Pumping System	When boilers are required, the pumping system shall be modeled as primary-only with continuous variable flow and a minimum flow of 25% of the design flow rate. Hot-water systems serving 120,000 ft <sup>2</sup> or more shall be modeled with variable-speed drives, and systems serving less than 120,000 ft <sup>2</sup> shall be modeled as riding the pump curve.
Heating Efficiency	NA for electric resistance heating. For hot-water boilers, the minimum efficiency based on the output capacity of specific baseline equipment unit(s)
Reheat Terminal Flow	N/A
Economizer	Integrated dry bulb economizer with dry-bulb high limit based on climate zone. Refer to building descriptor 'Outside Air Controls and Economizer', Section 3.7.4, for details.

Table 50. Summary of Baseline Building Secondary HVAC System Properties

System	Fan Control	Economizer	Cooling Type	Cooling Efficiency	Minimum Supply T.	Heating Type	Heating Efficiency	Maximum Supply T.
System 1-PTAC	Constant volume	Not required	Direct Expansion	Minimum SEER EER, COP or kW/ton based on equipment type and output capacity of proposed unit(s). Adjusted EER is calculated to account for supply fan energy.	20 °F below occupied space cooling setpoint	Hot-water fossil fuel boiler	Minimum AFUE, Thermal Efficiency, COP or HSPF based on equipment type and output capacity of baseline unit(s).	20 °F above space temperature setpoint for systems 1-4 and 11-13.
System 2-PTHP						Electric heat pump		
System 3-PSZ-AC						Fossil fuel furnace		
System 4-PSZ-HP						Electric heat pump		
System 5-PVAV	Variable volume	Integrated economizer with dry-bulb high limit by climate zone.	Chilled water			Hot-water fossil fuel boiler		Same as maximum reset cooling supply air temperature for systems 5-8 and 105 °F for systems 9 and 10
System 6-PVAV / PFP						Electric resistance		
System 7-VAV						Hot-water fossil fuel boiler		
System 8-VAV / PFP	Constant volume	Not required	None	None		Fossil fuel furnace		
System 9/10-HV Furnace						Electric resistance		
HV Electric	Variable volume	Integrated economizer with dry-bulb high limit by climate zone.	Chilled water	See 6.8 Primary Systems		See note.		
System 11-SZ-VAV						Hot-water fossil fuel boiler		
System 12-SZ-CV-HW						Electric resistance		
System 13-SZ-CV-ER	Constant Volume							

### 3.7.1 Basic System Information

#### *HVAC System Name*

<i>Applicability</i>	All system types
<i>Definition</i>	A unique descriptor for each HVAC system
<i>Units</i>	Text, unique
<i>Input Restrictions</i>	When applicable, this input should match the tags that are used on the plans
<i>Baseline Building</i>	None

#### *System Type*

<i>Applicability</i>	All system types
<i>Definition</i>	A unique descriptor that identifies the following attributes of an HVAC system: <ul style="list-style-type: none"> <li>• Number of air decks (one to three);</li> <li>• Constant or variable airflow;</li> <li>• Type of terminal device; and</li> <li>• Fan configuration for multiple deck systems.</li> </ul>
<i>Units</i>	List: <ul style="list-style-type: none"> <li>• PTAC – Packaged Terminal Air Conditioner</li> <li>• PTHP – Packaged Terminal Heat Pump</li> </ul>

- PSZ-AC – Packaged Single Zone Air Conditioner
- PSZ-HP – Packaged Single Zone Heat Pump
- PVAV – Packaged VAV with Reheat
- VAV – VAV with Reheat
- PSZVAV – Packaged Single Zone VAV
- PSZVAVHP – Packaged Single Zone VAV Heat Pump
- HV – Heating and Ventilation Only
- CRAC – Computer Room Air Conditioner
- CRAH – Computer Room Air Handler
- FPFC – Four-Pipe Fan Coil
- TPFC- Two Pipe Fan Coil
- SFDD – Single Fan Dual Duct
- DFDD – Dual-Fan Dual Duct
- RADFLR – Radiant Floor Heating And Cooling
- WSHP – Water-Source Heat Pump
- ACB- Active Chilled Beams
- PCB- Passive chilled Beams
- Other

*Input Restrictions* As designed

*Baseline Building* Based on the prescribed system type in the HVAC system map. The baseline system types are shown in the table below.

Table 51. Baseline Building System Type

System Number	System Type
1	PTAC
2	PTHP
3	PSZ AC
4	PSZ HP
5	PVAV reheat
6	Packaged VAV with PFP boxes
7	VAV with reheat
8	VAV with PFP boxes
9	Heating and ventilation
10	Heating and ventilation
11	SZ VAV
12	SZ-CV-HW
13	SZ-CV-ER

### **Total Cooling Capacity**

<i>Applicability</i>	All system types
<i>Definition</i>	The installed cooling capacity of the project. This includes all: <ul style="list-style-type: none"> <li>• Chillers,</li> <li>• Built-up DX, and</li> <li>• Packaged cooling units.</li> </ul>
<i>Units</i>	Cooling tons
<i>Input Restrictions</i>	As designed. This could be calculated by the simulation program from the proposed design building description or a separate load calculation may be used. Unmet load hours for the simulation shall not exceed 300 annually. Weather conditions used in sizing runs shall be based on 1% dry-bulb and 1% wet-bulb cooling design temperatures.
<i>Baseline Building</i>	Autosize. The cooling capacity shall be oversized by 15%. Refer to Section 2.7.2 for baseline equipment sizing procedure. If the number of UMLH exceeds 300, increase the cooling capacity according to the procedures in Chapter 2, Section 2.5.

### **Total Heating Capacity**

<i>Applicability</i>	All system types
<i>Definition</i>	The installed cooling capacity of the project. This includes all: <ul style="list-style-type: none"> <li>• Boilers,</li> <li>• Electric Resistance,</li> <li>• Heat Pumps,</li> <li>• Gas Furnaces.</li> </ul>
<i>Units</i>	Btu/hr
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Autosize. The heating capacity shall be oversized by 25%. Refer to Section 2.7.2 for baseline equipment sizing procedure. If the number of UMLH exceeds 300, increase the heating capacity according to the procedures in Chapter 2, Section 2.5.

## 3.7.2 System Controls

### 3.7.2.1 Schedules

#### *Cooling Schedule*

<i>Applicability</i>	All cooling systems
<i>Definition</i>	A schedule that represents the availability of cooling
<i>Units</i>	Data structure: schedule, on/off
<i>Input Restrictions</i>	Schedules should be typical of the proposed building type or as assumed for the building design. The cooling availability schedule shall be consistent with the supply fan schedule and thermostat schedules to reduce the likelihood of UMLH. This schedule is not needed for all simulation tools. Other methods (outdoor conditions, zone conditions) may be used to control cooling availability in most systems. If cooling is truly not available during certain times (school vacations, weekends) the zone thermostat cooling setpoints need to be modified to reflect this and the HVAC availability schedule (see below), which defines fan operation based on occupancy, needs to be set to zero.
<i>Baseline Building</i>	Same as the proposed design. However, setpoints and schedules can differ between proposed and baseline design: <ul style="list-style-type: none"> <li>For HVAC systems that automatically provide occupant thermal comfort via means other than directly controlling the air dry-bulb and wet-bulb temperature, provided that equivalent levels of occupant thermal comfort are demonstrated via the methodology in ASHRAE Standard 55, Section 5.3.3, “Elevated Air Speed,” or Standard 55, Appendix B, “Computer Program for Calculation of PMV-PPD.”</li> <li>When necessary to model nonstandard efficiency measures, provided that the revised schedules have been approved by the rating authority.</li> </ul>

#### *Heating Schedule*

<i>Applicability</i>	All systems
<i>Definition</i>	A schedule that represents the availability of heating
<i>Units</i>	Data structure: schedule, on/off
<i>Input Restrictions</i>	Schedules should be typical of the proposed building type or assumed for the building design. COMNET Appendix C (COMNET 2017) can be used as a default. The heating availability schedule shall be consistent with the supply fan schedule.
<i>Baseline Building</i>	Same as the proposed design However, setpoints and schedules can differ between proposed and baseline design: <ul style="list-style-type: none"> <li>For HVAC systems that automatically provide occupant thermal comfort via means other than directly controlling the air dry-bulb and wet-bulb temperature, provided that equivalent levels of occupant thermal comfort are demonstrated via the methodology in ASHRAE Standard 55, Section 5.3.3, “Elevated Air Speed,” or Standard 55, Appendix B, “Computer Program for Calculation of PMV-PPD.”</li> <li>When necessary to model nonstandard efficiency measures, provided that the revised schedules have been approved by the rating authority.</li> </ul>



***HVAC Availability Schedule***

<i>Applicability</i>	All systems
<i>Definition</i>	A schedule that indicates when the air handler operates continuously
<i>Units</i>	Data structure: schedule, on/off
<i>Input Restrictions</i>	Schedules should be typical of the proposed building type or assumed for the building design. The fan schedule can be defaulted to the applicable schedule from COMNET Appendix C (COMNET 2017). Other schedules may be used when detailed information is known about the proposed design.
<i>Baseline Building</i>	Same as the proposed design unless one baseline HVAC system serves a combination of systems in the proposed design with varying HVAC availability schedules. For those systems the HVAC availability schedule is determined by the most inclusive schedule represented in the proposed building design. If the most inclusive schedule does not cover the full range of availability, a hybrid schedule that does shall be created.

***Air Handler Fan Cycling***

<i>Applicability</i>	All fan systems
<i>Definition</i>	This building descriptor indicates whether the system supply fan operates continuously or cycles with building loads. The fan systems in most commercial buildings operate continuously during occupied hours.
<i>Units</i>	List: Continuous or Cycles with Loads
<i>Input Restrictions</i>	<p>Schedules for HVAC fans shall run continuously whenever HVAC zones are occupied and shall be cycled on and off to meet heating and cooling loads during unoccupied hours. Hours with occupancy &gt;5% are considered to be occupied hours and require continuously operated fans.</p> <p>Exceptions:</p> <ul style="list-style-type: none"> <li>• HVAC fans that do not provide outdoor air for ventilation shall cycle on and off to meet heating and/or cooling loads. This requires that outdoor air is introduced through some other approved means such as natural ventilation or another fan system.</li> <li>• Where no heating and/or cooling system is to be installed and a heating or cooling system is being simulated only to meet the requirements described in Standard 90.1-2019 PRM, heating and/or cooling system fans shall not be simulated as running continuously during occupied hours but shall be cycled on and off to meet heating and cooling loads during all hours.</li> <li>• HVAC fans shall remain on during occupied and unoccupied hours in HVAC zones that have health and safety mandated minimum ventilation requirements during unoccupied hours.</li> <li>• HVAC fans shall remain on during occupied and unoccupied hours in systems primarily serving computer rooms</li> <li>• For hotel guest rooms and high-rise residential, continuous operation is the default, however, the option to let the fan cycle with loads may be used when the following conditions are met and documented: <ul style="list-style-type: none"> <li>– The spaces served by the system are located within 25 ft of an operable window.</li> <li>– The operable window area is at least 4% of the floor space.</li> <li>– Other requirements for natural ventilation specified in ASHRAE Standard 62.1-2016 are satisfied.</li> </ul> </li> </ul>

- Baseline Building*
- HVAC fans shall run continuously whenever HVAC zones are occupied and shall be cycled on and off to meet heating and cooling loads during unoccupied hours.
- Except:
- HVAC fans shall remain on during occupied and unoccupied hours in systems primarily serving computer rooms
  - HVAC fans shall remain on during occupied and unoccupied hours in HVAC Zones that have health and safety mandated minimum ventilation requirements during unoccupied hours.
  - Fan schedules may be allowed to differ when Standard 90.1-2019 Section G3.1.1(c) applies.

#### ***Optimal Start Control***

<i>Applicability</i>	Systems with the control capability for flexible scheduling of system start time based on building loads
<i>Definition</i>	Optimal start control adjusts the start time of the HVAC unit such that the space is brought to setpoint just prior to occupancy. This control strategy modifies the heating, cooling, and fan schedules.
<i>Units</i>	Boolean (Yes/No)
<i>Input Restrictions</i>	As designed  Heating and cooling systems with design air capacities greater than 10,000 cfm served by one or more supply fans are required to have optimum start controls.
<i>Baseline Building</i>	Heating and cooling systems with design air capacity greater than 10,000 cfm served by one or more supply fans are required to have optimum start controls.

#### ***Optimal Start Control: Control Zone***

<i>Applicability</i>	Systems with optimal start controls that serve multiple zones
<i>Definition</i>	The zone that governs the start time for applying optimal start controls
<i>Units</i>	Boolean (Yes/No)
<i>Input Restrictions</i>	List: “Any Zone,” all zones served by the system
<i>Baseline Building</i>	Same as proposed  If optimal start controls are not required by the proposed design, but required in the baseline building, then this input will be set to “Any Zone”

### **3.7.2.2 Cooling Control**

#### ***Cooling Supply Air Temperature***

<i>Applicability</i>	Applicable to all systems
<i>Definition</i>	The SAT setpoint at design cooling conditions
<i>Units</i>	Degrees Fahrenheit (°F)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	20°F below the zone temperature setpoint, except in laboratories, where it is to be set at 17°F below the zone temperature

### ***Cooling Supply Air Temperature Control***

<i>Applicability</i>	Any cooling system
<i>Definition</i>	<p>The method of controlling the SAT. Choices are:</p> <ul style="list-style-type: none"> <li>• No control – for this scheme the cooling coils are energized whenever there is a call for cooling</li> <li>• Fixed (constant)</li> <li>• Reset by warmest zone, airflow first</li> </ul> <p>This control strategy resets the cooling SAT of a central forced air HVAC system according to the cooling demand of the warmest zone. The airflow first control approach tries to find the lowest supply airflow rate that will satisfy all the zone cooling loads at the maximum setpoint temperature. If this flow is greater than the maximum, the flow is set to the maximum and the setpoint temperature is reduced to satisfy the cooling loads. The airflow first strategy minimizes zone reheat coil energy (or overcooling) and central chiller energy consumption at the cost of possible increased fan energy.</p> <ul style="list-style-type: none"> <li>• Reset by warmest zone, temperature first</li> </ul> <p>This control strategy resets the cooling SAT of a central forced air HVAC system according to the cooling demand of the warmest zone. The temperature first control approach tries to find the highest setpoint temperature that will satisfy all the zone cooling loads at the minimum supply airflow rate. If this setpoint temperature is less than the minimum, the setpoint temperature is set to the minimum, and the supply airflow rate is increased to meet the loads.</p> <p>The temperature first strategy minimizes fan energy consumption at the cost of possible increased zone reheat coil energy (or overcooling) and central chiller energy consumption.</p> <ul style="list-style-type: none"> <li>• Reset by outside air dry-bulb temperature</li> <li>• Scheduled setpoint</li> <li>• Staged setpoint (for single zone VAV and DX with multiple stages)</li> </ul>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	<p>For baseline building systems 1 through 4, there is no SAT control. The cooling coil modulates based on the zone thermostat setpoint.</p> <p>For systems 5 through 8, the air temperature for cooling shall be reset higher by 5°F under the minimum cooling load conditions using a reset by warmest zone, airflow first strategy.</p> <p>For system 11, the supply air temperature setpoint shall be reset from minimum supply air temperature at 50% cooling load to space temperature at 0% cooling load.</p> <p>For systems 9, 10, 12, and 13 (heating and ventilation and single zone systems), this input is not applicable.</p>

**Cooling Reset Schedule by Outside Air Temperature**

- Applicability* When the proposed design resets SAT by outside air dry-bulb temperature
- Definition* A linear reset schedule that represents the SAT setpoint as a function of outdoor air dry-bulb temperature. This schedule is defined by the following data points (see Figure 9):
- The coldest cooling SAT
  - The corresponding (hot) outdoor air dry-bulb setpoint
  - The warmest cooling SAT
  - The corresponding (cool) outdoor air dry-bulb setpoint

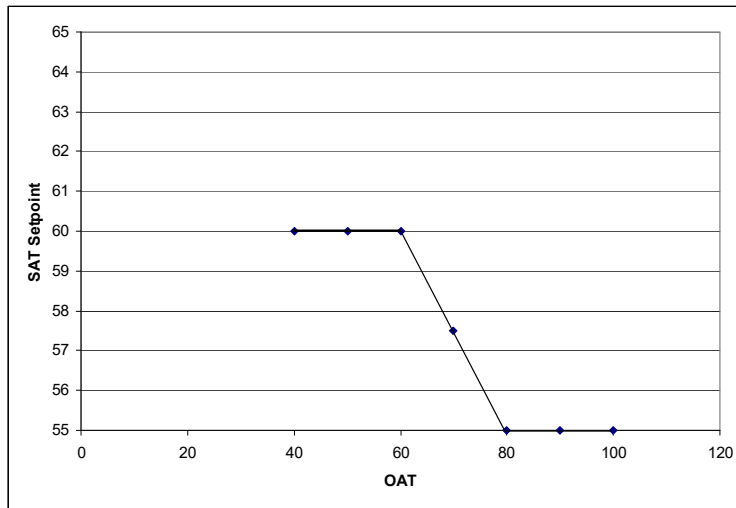


Figure 9. SAT Cooling Setpoint Reset based on Outdoor Air Temperature (OAT)

- Units* Data structure (two matched pairs of SAT and OAT, see above)
- Input Restrictions* As designed
- Baseline Building* Not applicable

**3.7.2.3 Heating Control**

This section addresses building descriptors related to heating and preheating control. Section 3.7.6 addresses all other details related to heating systems.

**Preheat Setpoint**

- Applicability* Systems 5 through 8
- Definition* The control temperature leaving the preheat coil
- Units* Degrees Fahrenheit (°F)
- Input Restrictions* As designed
- Baseline Building* The baseline will be modeled with preheat coil in the mixed air stream controlled to a fixed setpoint 20°F less than the design room heating temperature setpoint

**Heating Supply Air Temperature**

<i>Applicability</i>	All systems
<i>Definition</i>	The SAT leaving the air handler when the system is in design heating mode (not the air temperature leaving the reheat coils in VAV boxes)
<i>Units</i>	Degrees Fahrenheit (°F)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	20°F above zone temperature setpoint for systems 1 through 4 and 12 through 13. Same as maximum reset cooling SAT for systems 5 through 8 and 105°F for systems 9 and 10.  For baseline system 11, the heating supply air temperature shall be modulated to maintain space temperature and fan volume shall be fixed at minimum airflow.

**Heating Supply Air Temperature Controls**

<i>Applicability</i>	Systems with the capability to vary heating SAT setpoint
<i>Definition</i>	The method of controlling heating SAT. Choices are: <ul style="list-style-type: none"> <li>• No control – the heating coil is energized on a call for heating, and the SAT is not directly controlled, but instead is dependent on the entering air temperature, the heating capacity and the airflow rate</li> <li>• Fixed (constant)</li> <li>• Reset by coldest zone, airflow first</li> <li>• Reset by coldest zone, temperature first</li> <li>• Reset by outside air dry-bulb temperature</li> <li>• Staged setpoint</li> <li>• Scheduled setpoint</li> </ul>
<i>Units</i>	Degrees Fahrenheit (°F)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	No control is specified for heating SAT for systems 1 through 4, 9, 10, and 11 through 13. For systems 5 through 8, the heating SAT is fixed to the maximum reset cooling SAT.

**Heating Reset Schedule by Outside Air**

<i>Applicability</i>	Systems that reset the heating SAT by outside dry-bulb temperature (this typically applies to dual-duct systems or to single zone systems with hydronic heating coils)
<i>Definition</i>	A linear reset schedule that represents the heating SAT or hot deck SAT (for dual duct systems) as a function of outdoor air dry-bulb temperature. This schedule is defined by the following data points (see Figure 10): <ul style="list-style-type: none"> <li>• The hottest heating SAT</li> <li>• The corresponding (cold) outdoor air dry-bulb threshold</li> <li>• The coolest heating SAT</li> <li>• The corresponding (mild) outdoor air dry-bulb threshold</li> </ul>

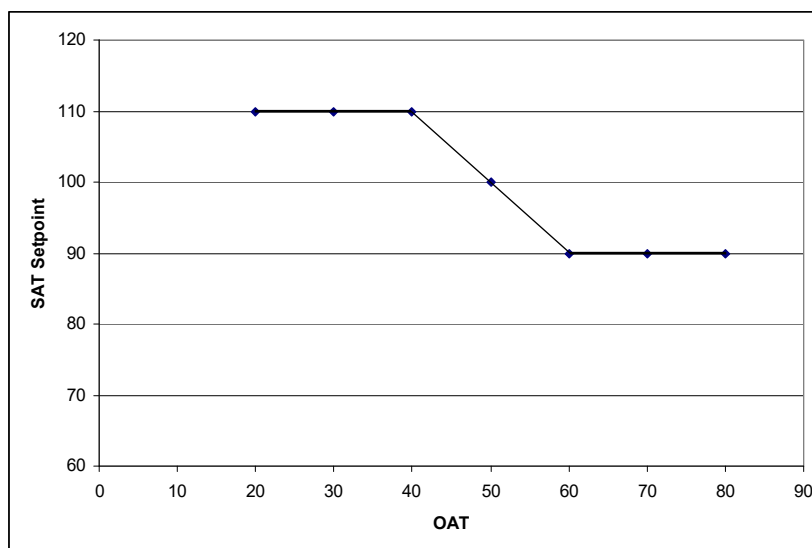


Figure 10. Example of SAT Heating Setpoint Reset based on Outdoor Air Temperature.

*Units* Data structure (°F)

*Input Restrictions* As designed

*Baseline Building* Not applicable

### 3.7.2.4 Night Purge

The baseline building does not have night purge controls. If the software supports it and the proposed design has the features, the following keywords may be used to model night purge. Note that night purge is coupled with thermal mass in the building, which is specified by other building descriptors.

#### ***Night Purge Availability Schedule***

*Applicability* Systems that operate the fans for nighttime purge of heat gains

*Definition* A schedule that represents the availability of night purge controls

*Units* Data structure: schedule, on/off

*Input Restrictions* As designed. The default is no night purge control.

*Baseline Building* Not applicable

#### ***Night Purge Control***

*Applicability* Systems that operate the fans for nighttime purge of heat gains

*Definition* The control strategy for operation of nighttime purge. The control strategy may account for indoor temperature, season, and other factors.

*Units* Data structure

*Input Restrictions* As designed

*Baseline Building* Not applicable

**Night Purge Fan Ratio**

<i>Applicability</i>	Systems that operate the fans for nighttime purge of heat gains
<i>Definition</i>	The ratio of fan speed for a night purge cycle
<i>Units</i>	Fraction (0 to 1)
<i>Input Restrictions</i>	As designed. The default is 100% (or fans available at full speed).
<i>Baseline Building</i>	Not applicable

**3.7.3 Fan Systems****3.7.3.1 Baseline Building Fan System Summary**

The baseline building fan system is summarized in this section. See Table 3 for the HVAC baseline building system mapping.

Total baseline building fan system power for the baseline building fan systems is given in the following sections as well as Table 53 and Table 54. Table 52 summarizes all descriptors for fan systems and their applicability to supply, return/relief, and exhaust fans.

Table 4 summarizes inputs for each of the three approaches for imputing system fan power (fan power method, brake horsepower method, and design pressure drop method).

- In these tables, CFM<sub>s</sub> is the baseline fan supply fan airflow at peak design conditions.
- The fan system power includes the supply fan, the return fan, and exhaust fans.
- Exhaust fans include kitchen hoods, toilets, fume hoods, and other miscellaneous fans that operate at design conditions.

When the proposed design has return fans, exhaust fans (toilets or kitchens), or fume hood exhaust systems, the baseline building has the same systems. Fan power will be allocated to the baseline supply, return, and exhaust fans based on the Fan System Power described below and the ratio of each fans power in the proposed design to the proposed design fan system power.

Table 52. Building Descriptor Applicability for Fan Systems

Inputs	Supply Fan	Return/Relief Fan	Exhaust Fans (Hoods)
Modeling Method	✓	Same as supply	✓
Air Rated Capacity	✓	✓	✓
Plenum Zone	X	✓	X
Return Air Path	X	✓	X
Fan Control Method	✓	Same as supply	✓
Brake Horsepower	✓	✓	✓
Static Pressure	✓	✓	✓
Fan Efficiency	✓	✓	✓
Motor Efficiency	✓	✓	✓
Fan Position	✓	X	X
Motor Position	✓	✓	X
Part-Load Power Curve	✓	✓	✓
Fan KW	✓	✓	✓



Table 53. Baseline Fan System Details for Fan System Power

System	Fan Power Method (W/cfm)	Brake Horsepower Method (bhp/cfm)	Design Pressure Drop (DPD) Method	Fan Motor Efficiency $\eta_m$	Fan Mech Efficiency	DPD (If no additional pressure drop credits) <sup>(a)</sup>
1 & 2	0.3	$W/cfm \times \eta_m \times 0.00134$	$bhp/cfm \times fan\ mech\ efficiency \times 6356$	80%	65%	1.33 in. w.g.
3, 4, 12. & 13	$(bhp \times 746)/\eta_m$	$0.00094 \times CFMs + A$	$bhp/cfm \times fan\ mech\ efficiency \times 6356$	Standard 90.1-2019, Table G3.9.1 <sup>(a)</sup>	65%	3.88 in. w.g.
5 through 8	$(bhp \times 746)/\eta_m$	$0.0013 \times CFMs + A$	$bhp/cfm \times fan\ mech\ efficiency \times 6356$	Standard 90.1-2019, Table G3.9.1 <sup>(a)</sup>	65%	5.37 in. w.g.
9 & 10 supply fan	0.3	$W/cfm \times \eta_m \times 0.00134$	$bhp/cfm \times fan\ mech\ efficiency \times 6356$	Standard 90.1-2019, Table G3.9.1 <sup>(a)</sup>	65%	1.33 in. w.g.
9 & 10 non-mechanical cooling fan <sup>(b)</sup>	0.054	$W/cfm \times \eta_m \times 0.00134$	$bhp/cfm \times fan\ mech\ efficiency \times 6356$	80%	65%	0.24 in. w.g.
11	$(bhp \times 746)/\eta_m$	$0.00062 \times CFMs + A$	$bhp/cfm \times fan\ mech\ efficiency \times 6356$	Standard 90.1-2019, Table G3.9.1 <sup>(a)</sup>	65%	2.56 in. w.g.

The term “A” for system types 3 through 8 is calculated based on equipment included in the proposed design using the procedure in Table 6.5.3.1.1 of ASHRAE Standard 90.1-2019 and the airflows from the baseline design. This accounts for various additional fan pressure drops associated with special conditions.

- (a) Fan motor efficiency is the efficiency from Table G3.9.1 of Standard 90.1-2019 for the next motor size greater than the bhp.
- (b) This alternate equation is only used if there is a non-mechanical cooling fan in place in the proposed design.
- (c) If system qualified for additional pressure drop credits DPD should be calculated based on adjusted bhp.

**Pressure Drop Adjustment**

<i>Applicability</i>	Any system serving zones served by systems in the proposed design which qualify for pressure drop adjustments in Table 54
<i>Definition</i>	Adjustments to fan power limitations related to application-specific requirements as allowed by Standard 90.1-2019 Table 6.5.3.1-1
<i>Units</i>	List
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Calculated from Section 6.5.3.1-1 of Standard 90.1-2019 for baseline system fans. Pressure drop adjustment is based on the device from Table 54 being present in the proposed design.

Table 54. Baseline Building: Fan Power Limitation Pressure Drop Adjustment

Device	Adjustment
<b>Credits</b>	
Return or exhaust <i>systems</i> required by code or accreditation standards to be fully ducted, or <i>systems</i> required to maintain air pressure differentials between adjacent rooms.	0.5 in. w.c. (2.15 in. w.c. for laboratory and vivarium systems)
Return and/or exhaust airflow control devices	0.5 in. w.c.
Exhaust filters, scrubbers, or other exhaust treatment	The pressure drop of device calculated at fan system design condition
Particulate filtration credit: MERV 9 through 12	0.5 in. w.c.
Particulate filtration credit: MERV 13 through 15	0.9 in. w.c.
Particulate filtration credit: MERV 16 and greater and electronically enhanced filters	Pressure drop calculated at 2x clean filter pressure drop at fan system design condition
Carbon and other gas-phase air cleaners	Clean filter pressure drop at fan system design condition
Biosafety cabinet	Pressure drop of device at fan system design condition
Energy recovery device and other coil runaround loop	(2.2 × Energy Recovery Effectiveness)—0.5 in w.c. for each airstream
Coil runaround loop	0.6 in. w.c. for each airstream
Evaporative humidifier/cooler in series with another cooling coil	Pressure drop of device at fan system design condition
Sound attenuation section	0.15 in. w.c.
Exhaust systems serving fume hoods	0.35 in. w.c.
Laboratory and vivarium exhaust systems in high-rise buildings	0.25 in. w.c./100 ft of vertical duct exceeding 75 ft.
<b>Deductions</b>	
Systems without central cooling device	-0.6 in. w.c.
Systems without central heating device	-0.3 in. w.c.
Systems with central electric resistance heat	-0.2 in. w.c.

**Fan Power Adjustment**

- Applicability* All fan systems qualifying for pressure drop adjustments as described above.
- Definition* Standard 90.1-2019 specifies a “pressure drop adjustment” for fan systems with requirements for filtration or other process requirements.
- Units* List
- Input Restrictions* Derived from other building descriptors
- Baseline Building* Pressure drop adjustment is calculated separately for each applicable device. Credit for each device is specified in the section above.

$$A = \text{sum of zones } (PD\_sum \times CFM_d\_{baseline}/4131)$$

Where:

- PD* = Each applicable pressure drop adjustment from the proposed design
- CFM<sub>d</sub>* = The design airflow through each applicable device in cfm from the baseline building

Note: In scenarios where the proposed and baseline building have varying zone to system assignment, the pressure drop credit ‘A’ shall be calculated for each thermal zone in the proposed building, using the design flow rates in the proposed building design. For multi-zone systems in the proposed building, the pressure drop adjustment will be split for each zone based on the zone to system airflow ratio. The pressure drop adjustment for the baseline building will then be calculated by adjusting the calculated PDA by the ratio of baseline building design airflow rate to proposed building design air flow rate for each zone. The baseline system pressure drop adjustment will be a sum of the individual pressure drop adjustments of the applicable zones.

**Supply Fan Ratio**

<i>Applicability</i>	Systems that serve thermal blocks that have exhaust, fume hoods, kitchen exhaust, or return fans
<i>Definition</i>	The ratio of supply fan brake horsepower in the proposed design to total fan system brake horsepower for the proposed design at design conditions.
<i>Units</i>	Unitless fraction (0 to 1)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Same as proposed

**Return Fan Ratio**

<i>Applicability</i>	Systems that serve thermal blocks that have exhaust, fume hoods, kitchen exhaust, or return fans
<i>Definition</i>	The ratio of return fan brake horsepower in the proposed design to total fan system brake horsepower for the proposed design at design conditions
<i>Units</i>	Unitless fraction (0 to 1)
<i>Input Restrictions</i>	Derived from other building descriptors
<i>Baseline Building</i>	Same as proposed

**Exhaust Fan Ratio**

<i>Applicability</i>	Systems that serve thermal blocks that have exhaust, fume hoods, kitchen exhaust, or return fans
<i>Definition</i>	The ratio of exhaust fan brake horsepower in the proposed design to total fan system brake hp for the proposed design at design conditions. Exhaust fans include toilet exhaust, kitchen hoods, and other miscellaneous exhaust.  For fan systems with multiple exhaust fans, the exhaust fan ratios shall be calculated separately for each exhaust fan.
<i>Units</i>	Unitless ratio
<i>Input Restrictions</i>	Derived from other building descriptors. In the event that a common exhaust system serves thermal blocks that are served by different HVAC systems, the brake horsepower shall be divided in proportion to design cfm.
<i>Baseline Building</i>	Same as proposed

### 3.7.3.2 Supply Fans

#### ***Fan System Modeling Method***

<i>Applicability</i>	All fan systems
<i>Definition</i>	Software commonly models fans in three ways. The simple method is for the user to enter the electric power per unit of flow (W/cfm). This method is commonly used for unitary equipment and other small fan systems. A more detailed method is to model the fan as a system whereby the static pressure, fan efficiency, and motor efficiency are specified at design conditions. A third method is to specify brake horsepower at design conditions instead of fan efficiency and static pressure. This is a variation of the second method whereby brake horsepower is specified in lieu of static pressure and fan efficiency.
<i>Units</i>	List: Power-Per-Unit-Flow, Design Pressure Drop, or Brake Horsepower
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Systems 1, 2, 9, and 10 should use power per unit flow if allowed by the software. If not allowed used one of the other methods as described in Table 54. All other baseline system shall use the brake horsepower method. If that method is not available, static pressure method should be used.

#### ***Supply Fan Design Air Rated Capacity***

<i>Applicability</i>	All fan systems
<i>Definition</i>	The design airflow rate of the supply fan(s) at design conditions. This building descriptor sets the 100% point for the fan part-load curve.
<i>Units</i>	cfm
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	<p>The software shall automatically size the system airflow to meet the baseline building loads based on</p> <ul style="list-style-type: none"> <li>• a supply-air-to-room-air temperature difference of 20°F,</li> <li>• or the minimum outdoor airflow rate,</li> <li>• or the airflow rate required to comply with the applicable codes or accreditation standards, whichever is greater.</li> </ul> <p>The baseline system airflow is determined by the load to be met by the airflow and the 20°F (11°C) temperature difference. The loads to be used would be the design load as determined by the sizing runs specified in Section G3.1.2.2, not the cooling or heating capacity of the system as determined using the sizing factors, also specified in G3.1.2.2. Using the system cooling and heating capacity will result in oversized baseline system airflows and energy cost because of the oversizing factors used in G3.1.2.2.</p> <p>See additional discussion in Section 3.6.5.1 for VAV systems. spaces with special process requirements.) The supply fan design airflow rate shall be the sum of the calculated design airflow for the thermal zones served by the fan system.</p> <p>For laboratory spaces, the design airflow rate calculation shall be based on a 17°F temperature differential rather than 20°F.</p> <p>For baseline systems 9 and 10, the design supply airflow rates shall be based on the temperature difference between a SAT setpoint of 105°F and the design space heating</p>

temperature setpoint, the minimum outdoor airflow rate or the airflow rate required to comply with applicable codes, whichever is greater.

If the proposed design HVAC system airflow rate based on latent loads greater than the same based on sensible loads, then the same supply-air-to-room humidity ratio difference (gr/lb) used to calculate the proposed design airflow should be used to calculate the design airflow rates for the baseline building.

### ***Fan Control Method***

<i>Applicability</i>	All fan systems
<i>Definition</i>	A description of how the supply (and return/relief) fan(s) is controlled. The options include: <ul style="list-style-type: none"> <li>• Constant volume</li> <li>• Variable-flow, inlet or discharge dampers</li> <li>• Variable-flow, inlet guide vanes</li> <li>• Variable-flow, variable speed drive (VSD)</li> <li>• Variable-flow, variable pitch blades</li> <li>• Variable-flow, other</li> <li>• Two-speed</li> <li>• Constant volume, cycling (fan cycles with heating and cooling)</li> </ul>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Based on the baseline system type, summarized in Table 55

Table 55. Baseline Building Fan Control Method

System No.	System Type	Fan Control
System 1	Package terminal air conditioner	Constant volume
System 2	Packaged terminal heat pump	Constant volume
System 3	Packaged roof top air conditioner	Constant volume
System 4	Packaged roof top heat pump	Constant volume
System 5	Packaged rooftop VAV with reheat	Variable volume, variable speed drive (VSD)
System 6	Packaged rooftop VAV with PFP boxes and reheat	Variable volume, VSD
System 7	Packaged rooftop VAV with reheat	Variable volume, VSD
System 8	VAV with parallel fan-powered boxes and reheat	Variable volume, VSD
System 9	Warm air furnace, gas fired	Constant volume
System 10	Warm air furnace, electric	Constant volume
System 11	Single zone VAV	Variable volume, VSD
System 12	Single zone system (CHW and HW boiler)	Constant volume
System 13	Single zone system (CHW and electric resistance)	Constant volume

**Supply Fan Brake Horsepower**

<i>Applicability</i>	All fan systems, except those specified using the power-per-unit-flow method
<i>Definition</i>	The design shaft brake horsepower of the supply fan(s). This input does not need to be supplied if the supply fan kW is supplied.
<i>Units</i>	Horsepower (hp)
<i>Input Restrictions</i>	As designed. If this building descriptor is specified for the proposed design, then the <i>static pressure</i> and <i>fan efficiency</i> are not required.
<i>Baseline Building</i>	Fans for parallel fan-powered boxes are not included in fan power calculations.  Table 53 of this document gives the baseline building fan system brake horsepower. The brake horsepower for the supply fan is this value times the supply fan ratio (see above).

**Supply Fan Static Pressure**

<i>Applicability</i>	All fan systems, except those specified using the power-per-unit-flow method
<i>Definition</i>	The design static pressure for the supply fan. This is important for both fan electric energy usage and duct heat gain calculations.
<i>Units</i>	Inches of water column (in. H <sub>2</sub> O)
<i>Input Restrictions</i>	As designed. The design static pressure for the supply fan does not need to be specified if the supply fan brake horsepower (bhp) is specified.
<i>Baseline Building</i>	The baseline building is defined by Table 53. This approach only works if the system has only a supply fan. If return/exhaust fans are also present in the system, then the supply fan bhp needs to be calculated and divided amongst the supply, return, and exhaust fans.

**Supply Fan Efficiency**

<i>Applicability</i>	All fan systems, except those specified using the power-per-unit-flow method
<i>Definition</i>	The efficiency of the fan at design conditions; this is the static efficiency and does not include motor losses
<i>Units</i>	Unitless
<i>Input Restrictions</i>	As designed. The supply fan efficiency does not need to be specified if the supply fan brake horsepower (bhp) is specified.
<i>Baseline Building</i>	The baseline supply fan efficiency shall be 65%.

**Supply Motor Efficiency**

<i>Applicability</i>	All supply fans, except those specified using the power-per-unit-flow method
<i>Definition</i>	The full-load efficiency of the motor serving the supply fan
<i>Units</i>	Unitless
<i>Input Restrictions</i>	As designed. Not applicable when the power-per-unit-flow method is used.
<i>Baseline Building</i>	For systems 1, 2, 9, and 10, motor efficiency is assumed to be 80%. The motor efficiency for systems 3 through 8 is determined from Table G3.9.1 of ASHRAE Standard 90.1-2019 (Table 56 below).

Table 56. Minimum Nominal Efficiency for Electric Motors (%)

Shaft Input Power	Full-Load Motor Efficiency, %
1	82.5
1.5	84
2	84
3	87.5
5	87.5
7.5	89.5
10	89.5
15	91
20	91
25	92.4
30	92.4
40	93
50	93
60	93.6
75	94.1
100	94.5
125	94.5
150	95
200	95

**Fan Position**

<i>Applicability</i>	All supply fans
<i>Definition</i>	The position of the supply fan relative to the cooling coil. The configuration is either draw through (fan is downstream of the coil) or blow through (fan is upstream of the coil).
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Draw through

**Motor Position**

<i>Applicability</i>	All supply fans
<i>Definition</i>	The position of the supply fan motor relative to the cooling air stream. The choices are: in the air stream or out of the air stream.
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	In the air stream

**Fan Part-Flow Power Curve**

- Applicability* All variable flow fan systems
- Definition* A part-load power curve that represents the percentage full-load power draw of the supply fan as a function of the percentage full-load airflow. The curve is typically represented as a cubic equation with an absolute minimum power draw specified.
- Units* Unitless ratio
- Input Restrictions* The fan curve shall be selected from Equation (10) and Table 57 for the type of fan specified in the proposed design.

$$\begin{aligned}
 & \text{Greater of} \\
 & PLR = a + b \cdot FanRatio + c \cdot FanRatio^2 + d \cdot FanRatio^3 \\
 & PLR = PowerMin
 \end{aligned}
 \tag{10}$$

Where:

- PLR* = Ratio of fan power at part load conditions to full load fan power
- PowerMin* = Minimum fan power ratio
- FanRatio* = Ratio of cfm at part-load to full-load cfm
- a, b, c and d* = Constants from Table 57

Table 57. Fan Curve Default Values

Fan Type - Control Type	A	B	c	d	%PowerMin
Multi Zone VAV with Airfoil (AF) or Backward Incline (BI) riding the curve <sup>(a)</sup>	0.1631	1.5901	-0.8817	0.1281	70%
Multi Zone VAV with AF or BI with inlet vanes <sup>(a)</sup>	0.9977	-0.659	0.9547	-0.2936	50%
Multi Zone VAV with Forward Curved (FC) fans riding the curve <sup>(a)</sup>	0.1224	0.612	0.5983	-0.3334	30%
Multi Zone VAV with FC with inlet vanes <sup>(a)</sup>	0.3038	-0.7608	2.2729	-0.8169	30%
Multi Zone VAV with vane-axial with variable pitch blades <sup>(a)</sup>	0.1639	-0.4016	1.9909	-0.7541	20%
Multi Zone VAV with VSD and fixed SP setpoint <sup>(b)</sup>	0.0013	0.1470	0.9506	-0.0998	20%
Multi zone VAV with static pressure reset <sup>(c)</sup>	0.04076	0.0881	-0.0729	0.9437	10%
Single zone VAV fan <sup>(d)</sup>	0.027828	0.026583	-0.087069	1.030920	10%

Data Sources:

- (a) ECB Compliance Supplement, public review draft, Version 1.2, March 1996, but adjusted to be relatively consistent with the curve specified in the PRM.
- (b) The fan curve for VSD is specified in Table G3.1.3.15.
- (c) This is the good SP reset VSD fan curve from the advanced VAV design guide used for MZVAV systems.
- (d) This is the perfect SP reset VSD fan curve from the advanced VAV design guide used for SZVAV systems.

<http://www.energy.ca.gov/2003publications/CEC-500-2003-082/CEC-500-2003-082-A-11.PDF>

*Baseline Building* Not applicable for baseline building systems 1 through 4. Baseline systems 5 through 8 will use the curve for “Multi zone VAV with fixed static pressure setpoint” curve. System 11 shall use the “Single zone VAV fan” curve. Constant volume fans are used for systems 9, 10, 12, and 13 and hence the descriptor is not applicable.



**Supply Fan Power Index (kW/cfm)**

<i>Applicability</i>	Fan systems that use the power-per-unit-flow method
<i>Definition</i>	The supply fan power per unit of flow
<i>Units</i>	kW/cfm
<i>Input Restrictions</i>	As designed or specified in the manufacturers' literature
<i>Baseline Building</i>	Applicable when the baseline building uses the power-per-unit-flow method. Fan power is determined using Table 53 of this document. This power is then multiplied by the supply fan ratio.

**Static Pressure Reset Controls**

<i>Applicability</i>	All VAV fan systems. Baseline systems 5 through 8.
<i>Definition</i>	Static pressure reset controls, reset the fan static pressure for VAV systems-based zone damper position. For systems with DDC of individual zone boxes reporting to the central control panel, static pressure setpoint shall be reset based on the zone requiring the most pressure.
<i>Units</i>	Unitless
<i>Input Restrictions</i>	As designed. If static pressure reset is implemented in the proposed system, the curve for "Multi zone VAV with static pressure reset curve" shall be used.
<i>Baseline Building</i>	Not applicable for baseline building systems 1 through 4 or 9, 10, 11, 12, and 13. The curve for "Multi Zone VAV with VSD and fixed SP setpoint" shall be used for baseline building systems 5 through 8.

**3.7.3.3 Return/Relief Fans**

System design supply airflow rates for the baseline building design shall be based on a supply-air-to-room-air temperature difference of 20°F or the minimum outdoor airflow rate, or the airflow rate required to comply with applicable codes or accreditation standards, whichever is greater. For systems 3, 4, and 11 through 13, if return or relief fans are specified for systems serving the corresponding zones in the proposed design, the baseline building design shall also be modeled with fans serving the same functions. For systems 5 through 8, if return or relief fans are specified in the proposed building, then the baseline systems serving the corresponding zones will be modeled with a return/relief fan.

**Plenum Zone**

<i>Applicability</i>	Any system with return ducts or return air plenum
<i>Definition</i>	A reference to the thermal zone that serves as return plenum or where the return ducts are located
<i>Units</i>	Text, unique
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Applicable when the baseline building has a return fan. Same as the proposed design when the proposed design has a plenum; otherwise, the return air ducts are assumed to be located in the space.

**Return Air Path**

<i>Applicability</i>	Any system with return ducts or return air plenum
<i>Definition</i>	Describes the return path for air. This can be one of the following: ducted return; plenum return; or direct-to-unit.
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	For baseline building systems 1 and 2, the return air path shall be direct-to-unit. For baseline building systems 3 through 8 and 11 through 13 and when the proposed design is direct-to-unit, the baseline building shall be ducted return, otherwise the baseline building return air path shall be the same as proposed design.

**Return/Relief Air Rated Capacity**

<i>Applicability</i>	All systems with a return or relief fan
<i>Definition</i>	The design airflow fan capacity of the return or relief fan(s). This sets the 100% fan flow point for the part-load curve (see below).
<i>Units</i>	cfm
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Applicable when the baseline building has a return fan. Return or relief fans shall be sized for the baseline system supply fan air quantity less the minimum outdoor air, or 90% of the supply fan air quantity, whichever is larger.

**Return/Relief Fan Brake Horsepower**

<i>Applicability</i>	Any system with return or relief fans that uses the brake horsepower method
<i>Definition</i>	The design shaft brake horsepower of the return/relief fan(s)
<i>Units</i>	Brake horsepower (bhp)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Applicable when the baseline building has a return fan. The bhp of the return fan shall be the system fan brake horsepower multiplied by the return fan ratio. In other words, brake horsepower is allocated in proportion to the proposed design.

**Return/Relief Design Static Pressure**

<i>Applicability</i>	Any system with return or relief fans that uses the static pressure method
<i>Definition</i>	The design static pressure for return fan system. This is important for both fan electric energy usage and duct heat gain calculations.
<i>Units</i>	Inches of water column (in. H <sub>2</sub> O gauge)
<i>Input Restrictions</i>	As designed. The design static pressure for the return fan does not need to be specified if the return fan brake horsepower (bhp) is specified.
<i>Baseline Building</i>	Return fan static pressure = (Return fan BHP × 6356 × 0.65)/cfm return

**Return/Relief Fan Efficiency**

<i>Applicability</i>	Any system with return or relief fans that uses the static pressure method
<i>Definition</i>	The efficiency of the fan at design conditions; this is the static efficiency and does not include the efficiency loss of the motor
<i>Units</i>	Unitless
<i>Input Restrictions</i>	As designed. The return/relief fan efficiency does not need to be specified if the return fan brake horsepower (bhp) is specified.
<i>Baseline Building</i>	65%

**Return/Relief Motor Efficiency**

<i>Applicability</i>	All return fans, except those specified using the power-per-unit-flow method
<i>Definition</i>	The full-load efficiency of the motor serving the supply fan
<i>Units</i>	Unitless
<i>Input Restrictions</i>	As designed. Not applicable when the power-per-unit-flow method is used.
<i>Baseline Building</i>	For baseline systems 1, 2, 9, 10, 12, and 13 is 80%. For baseline systems 3 through 8 and 11, fan motor efficiency is determined from Table G3.9.1 of Standard 90.1-2019 for the next motor size greater than the bhp calculated, through the process described above, using a totally enclosed fan motor at 1800 rpm.

**Motor Position**

<i>Applicability</i>	All return fans
<i>Definition</i>	The position of the supply fan motor relative to the cooling air stream. The choices are in the air stream or out of the air stream.
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	In the air stream

**Fan Part-Flow Power Curve**

<i>Applicability</i>	All return fans for variable flow fan systems
<i>Definition</i>	A part-load power curve that represents the percentage full-load power draw of the return fan as a function of the percentage full-load airflow
<i>Units</i>	Unitless ratio
<i>Input Restrictions</i>	As designed. The default fan curve shall be selected from Equation (10) and Table 57 for the type of fan specified in the proposed design.
<i>Baseline Building</i>	Not applicable for baseline building systems 1 through 4. The curve for “Multi zone VAV with static pressure reset curve” shall be used for baseline building systems 5 through 8 and system 11.

**Return/Relief Fan Power Index**

<i>Applicability</i>	Any system with a return fan
<i>Definition</i>	The return fan power per unit of flow
<i>Units</i>	kW/cfm
<i>Input Restrictions</i>	As specified in the manufacturers' literature
<i>Baseline Building</i>	Applicable when the baseline building uses the power-per-unit-flow method. Fan power is determined using Table 53. This power is then multiplied by the return fan ratio.

**3.7.3.4 Exhaust Fan Systems**

Exhaust fans include toilet, kitchen and laboratory exhaust. Some systems typically operate at constant flow, while flow varies for other systems depending on, for instance, the position of the sash for fume hoods. Exhaust fan flow is specified and scheduled for each thermal zone. An exhaust fan system may serve multiple thermal zones. The baseline building has exhaust fans when the proposed design has exhaust fans. The design exhaust airflow is the same for the baseline building and the proposed building.

**Exhaust Fan Name**

<i>Applicability</i>	All exhaust systems serving multiple thermal zones
<i>Definition</i>	A unique descriptor for each exhaust fan. This should be keyed to the construction documents, if possible, to facilitate plan checking. Exhaust rates and schedules at the thermal zone level refer to this name.
<i>Units</i>	Text, unique
<i>Input Restrictions</i>	Where applicable, this should match the tags that are used on the plans
<i>Baseline Building</i>	The baseline building will have an exhaust system that corresponds to the proposed design. The name can be identical to that used for the proposed design or some other appropriate name may be used.

**Exhaust Fan System Modeling Method**

<i>Applicability</i>	All exhaust fan systems
<i>Definition</i>	Software commonly models fans in three ways. See definition for supply system modeling method.
<i>Units</i>	List: Power-Per-Unit-Flow, Static Pressure, or Brake Horsepower
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	If the proposed design uses the power-per-unit-flow method, the baseline building shall also use this method, otherwise the baseline building shall use the static pressure method

**Exhaust Fan Rated Capacity**

<i>Applicability</i>	All exhaust systems
<i>Definition</i>	The rated design airflow rate of the exhaust fan system. This building descriptor defines the 100% flow case for the part-flow curve. Actual airflow is the sum of the flow specified for each thermal zone, as modified by the schedule for each thermal zone.
<i>Units</i>	cfm
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Same as the proposed design except that baseline building kitchen exhaust rate may not exceed the maximum levels defined by Section 3.6.5.3 of this document

**Fan Control Method**

<i>Applicability</i>	All exhaust fan systems
<i>Definition</i>	A description of how the exhaust fan(s) are controlled. The options include: <ul style="list-style-type: none"> <li>• Constant volume</li> <li>• Two-speed</li> <li>• Variable-flow, inlet or discharge dampers</li> <li>• Variable-flow, inlet guide vanes</li> <li>• Variable-flow, VSD</li> <li>• Variable-flow, variable pitch blades</li> </ul>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed, however, when exhaust fan flow at the thermal zone level is varied through a schedule, one of the variable-flow options shall be specified
<i>Baseline Building</i>	The baseline building exhaust fan control shall generally be the same as the proposed design. Exceptions: Exhaust fans serving laboratory spaces shall reduce the exhaust air volume during unoccupied periods to the largest of 50% of zone peak airflow, the minimum outdoor airflow rate, or the airflow rate required to comply with applicable codes or accreditation standards as described in Section 3.6.5.3 under descriptor <i>Laboratory: Exhaust Minimum Airflow Rate</i> .

**Exhaust Fan Schedule**

<i>Applicability</i>	All exhaust fan systems
<i>Definition</i>	A schedule that indicates when the exhaust fan system is available for operation. Exhaust fan flow is specified at the thermal zone level.
<i>Units</i>	Data structure: schedule, on/off
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Same as the proposed design for exhaust fans not serving kitchen or laboratory spaces For kitchen and laboratory zone exhaust, refer to Section 3.6.5.3 of this document

**Exhaust Fan Brake Horsepower**

<i>Applicability</i>	All exhaust fan systems
<i>Definition</i>	The design shaft brake horsepower of the exhaust fan(s)
<i>Units</i>	Brake horsepower (bhp)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	The bhp for the baseline building is the total system fan horsepower from Table 53 of this document multiplied by the exhaust fan ratio

**Exhaust Fan Design Static Pressure**

<i>Applicability</i>	Any system with return or relief fans that uses the static pressure method
<i>Definition</i>	The design static pressure for exhaust fan system. This is important for both fan electric energy usage and duct heat gain calculations.
<i>Units</i>	Inches of water column (in. H <sub>2</sub> O)
<i>Input Restrictions</i>	As designed for exhaust fans not serving kitchens. The design static pressure for the exhaust fan does not need to be specified if the exhaust fan bhp is specified.
<i>Baseline Building</i>	The exhaust fan static pressure for the baseline building would be equal to the total fan system static pressure (specified in section Supply Fan Static Pressure) multiplied by the exhaust fan ratio  Exhaust Fan Static Pressure = (Exhaust Fan BHP × 6356 × 0.65)/cfm exhaust

**Exhaust Fan Efficiency**

<i>Applicability</i>	Any exhaust fan system that uses the static pressure method
<i>Definition</i>	The efficiency of the exhaust fan at rated capacity; this is the static efficiency and does not include losses through the motor
<i>Units</i>	Unitless
<i>Input Restrictions</i>	As designed. The exhaust fan efficiency does not need to be specified if the return fan bhp is specified.
<i>Baseline Building</i>	For baseline system, fan efficiency is 65%

**Exhaust Fan Motor Efficiency**

<i>Applicability</i>	All exhaust fan systems
<i>Definition</i>	The full-load efficiency of the motor serving the exhaust fan
<i>Units</i>	Unitless
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	From Table G3.9.1 of Standard 90.1-2019 for the next motor size greater than the bhp calculated, through the process described above, using a totally enclosed fan motor at 1800 rpm

**Fan Part-Flow Power Curve**

<i>Applicability</i>	All variable flow exhaust fan systems
<i>Definition</i>	A part-load power curve that represents the power draw of the exhaust fan as a function of the airflow
<i>Units</i>	Unitless ratio
<i>Input Restrictions</i>	As designed. The default fan curve shall be selected from Equation (10) and Table 57 for the type of fan specified in the proposed design.
<i>Baseline Building</i>	Same as proposed

**Exhaust Fan Power Index**

<i>Applicability</i>	All exhaust systems
<i>Definition</i>	The fan power of the exhaust fan per unit of flow. This building descriptor is applicable only with the power-per-unit-flow method.
<i>Units</i>	kW/cfm
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	The fan system power from Table 53 multiplied by the exhaust fan ratio

**3.7.4 Outdoor Air Controls and Economizers****3.7.4.1 Outside Air Controls****Maximum Outside Air Ratio**

<i>Applicability</i>	All systems with modulating outside air dampers
<i>Definition</i>	The descriptor is used to limit the maximum amount of outside air that a system can provide as a percentage of the design supply air. It is used where the installation has a restricted intake capacity.
<i>Units</i>	Ratio
<i>Input Restrictions</i>	As designed. Maximum of 1.0.
<i>Baseline Building</i>	1.0 for all systems with economizers. For others, equal to the ratio of required outdoor air to the peak supply airflow at design conditions.

**Design Outside Airflow**

<i>Applicability</i>	All systems with outside air dampers
<i>Definition</i>	The rate of outside air that needs to be delivered by the system at design conditions. This input may be derived from the sum of the design outside airflow for each of the zones served by the system.
<i>Units</i>	cfm
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Same as proposed. This input along with occupant density determines if the zones served by this system are required to have demand control ventilation. This value might also be different for buildings using the ASHRAE 62.1 Ventilation Rate Procedure as described in Section 3.6.5.5 of this document.  See Section 3.6.5.4 of this document for ventilation control method at the zone level.

### **Outdoor Air Control Method**

<i>Applicability</i>	All HVAC systems that deliver outside air to multiple zones. (These requirements don't apply to systems supplying air to single zones.)
<i>Definition</i>	<p>The method of determining the amount of outside air that needs to be delivered by the system. Each of the zones served by the system reports its outside air requirements hourly. The options for determining the outside air at the zone level are discussed above. This control method addresses how the system responds to this information hourly. Options include:</p> <ul style="list-style-type: none"> <li>• Average flow: The outside air delivered by the system is the sum of the outside air requirement for each zone, without taking into account the position of the VAV damper in each zone. The assumption is that there is mixing between zones through the return air stream.</li> <li>• Critical zone: The critical zone is the zone with the highest ratio of outside air to supply air. The assumption is that there is no mixing between zones. This method will provide greater outside air than the average flow method because when the critical zone sets the outside air fraction at the system, the other zones are getting more outside air than required.</li> </ul> <p>The quantity of outside air can be controlled in a number of ways, but a common method is to install a flow station at the outside air supply that modulates the position of the outside air and return dampers to maintain the desired outside airflow. With the average flow, a CO<sub>2</sub> sensor in the return air duct is another way to control the position of the outside air and return dampers.</p>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Same as proposed. See Section 3.6.5.5 for details.

### **Outdoor Air Minimum Flow Schedule**

<i>Applicability</i>	All HVAC systems that deliver outside air
<i>Definition</i>	<p>The schedule shall allow the system to provide the minimum system outdoor air requirements based on a time of day schedule. This input is specifically helpful when ventilation intake needs to be modified for fan cycling operation during unoccupied hours.</p> <p>This schedule would be an "on/off" schedule that determines when the design outside air is supplied by the system.</p>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	<p>In the following cases minimum design ventilation will be provided based on the HVAC availability schedule and outside air dampers shall be closed during night cycle and morning warm-up:</p> <ul style="list-style-type: none"> <li>• All systems in buildings three stories or more in climate zones 4 through 8</li> <li>• All systems required to have an economizer</li> <li>• Systems required to include demand controlled ventilation</li> </ul> <p>In all other cases outside air shall be provided anytime the system operates.</p>



### 3.7.4.2 Air Side Economizers

#### *Economizer Control Type*

<i>Applicability</i>	All systems with an air-side economizer
<i>Definition</i>	<p>An air-side economizer increases outside air ventilation during periods when cooling loads can be reduced from increased outside airflow. The control types include:</p> <ul style="list-style-type: none"> <li>• No economizer.</li> <li>• Fixed dry-bulb. The economizer is enabled when the temperature of the outside air is lower than a fixed setpoint.</li> <li>• Differential dry-bulb. The economizer is enabled when the temperature of the outside air is lower than the return air temperature.</li> <li>• Fixed enthalpy. The economizer is enabled when the enthalpy of the outside air is lower than a fixed setpoint</li> <li>• Differential enthalpy. The economizer is enabled when the enthalpy of the outside air is lower than the return air enthalpy.</li> <li>• Differential dry-bulb and enthalpy. The economizer is enabled when the outside air dry-bulb is less than the return air dry-bulb AND the outside air enthalpy is less than the return air enthalpy.</li> <li>• Fixed dewpoint and dry-bulb. The economizer is enabled when the dewpoint and dry-bulb temperature of the outside air are below the specified setpoints.</li> </ul>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	<p>Outdoor air economizers shall not be included in baseline HVAC systems 1, 2, 9, and 10. Outside air economizers shall be included in baseline HVAC systems 3 through 8, 11, 12, and 13, in climate zones 2B, 3B, 3C, 4C, 5B, 5C, 6B, 7, and 8. Economizers are not required in other climate zones. Economizer control shall be fixed dry bulb with a temperature setpoint as indicated under <i>Economizer High-Temperature Lockout</i> below.</p> <p>Exceptions: Economizers shall not be included for systems meeting one or more of the exceptions listed below.</p> <ol style="list-style-type: none"> <li>Systems that include gas-phase air cleaning to meet the requirements of Section 6.1.2 in Standard 62.1. In the scenario, where there isn't a one-to-one mapping between the systems in the proposed and baseline building, all systems serving the zones that qualify for the exception in the proposed building will not have economizers.</li> <li>Where the use of outdoor air for cooling will affect supermarket open refrigerated casework systems. This exception shall only be used if the system in the proposed design does not use an economizer.</li> <li>Systems serving computer rooms which are baseline systems 3-4 shall not have an economizer. Systems that server computer rooms that are baseline system 11 shall include an integrated fluid economizer meeting the requirements of Standard 90.1-2019 Section 6.5.1.2, also summarized below and in Section 3.8.4 of this manual.</li> </ol> <p>Fluid Economizers</p> <p>Fluid economizer systems shall be capable of providing up to 100% of the expected system cooling load at outdoor air temperatures of 50°F dry bulb/45°F wet bulb and below. Exceptions:</p>

- Systems primarily serving computer rooms in which 100% of the expected system cooling load at the dry-bulb and wet-bulb temperatures listed in Table 6.5.1.2.1 of Standard 90.1-2019 is met with water-cooled fluid economizers..
- Systems primarily serving computer rooms in which 100% of the expected system cooling load at the dry-bulb temperatures listed in Table 6.5.1.2.1 of Standard 90.1-2019 is met with air-cooled fluid economizers.
- Systems where dehumidification requirements cannot be met using outdoor air temperatures of 50°F dry-bulb/45°F wet-bulb and where 100% of the expected system cooling load at 45°F dry-bulb/40°F wet-bulb is met with water-cooled fluid economizers.

**Economizer Integration**

<i>Applicability</i>	Airside economizers
<i>Definition</i>	This input specifies whether or not the economizer is integrated with mechanical cooling. It is up to the modeling software to translate this into software-specific inputs to model this feature. The input could take the following values: <ul style="list-style-type: none"> <li>• Non-integrated: The system runs the economizer as the first stage of cooling. When the economizer is unable to meet the load, the economizer returns the outside air damper to the minimum position and the compressor turns on as the second stage of cooling.</li> <li>• Integrated: The system can operate with the economizer fully open to outside air and mechanical cooling active (compressor running) simultaneously, even on the lowest cooling stage.</li> </ul>
<i>Units</i>	List: Non-integrated, Integrated
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Integrated

**Economizer High-Temperature Lockout**

<i>Applicability</i>	Systems with fixed dry-bulb economizer
<i>Definition</i>	The outside air setpoint temperature above which the economizer will return to minimum position
<i>Units</i>	Degrees Fahrenheit (°F)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Economizer control shall be fixed dry bulb with a temperature setpoint of 70°F in climate zones 5A and 6A and 75°F in all other climate zones where economizers are required

**Economizer Low-Temperature Lockout**

<i>Applicability</i>	Systems with air-side economizers
<i>Definition</i>	A feature that permits the lockout of economizer operation (return to minimum outside air position) when the outside air temperature is below the lockout setpoint
<i>Units</i>	Degrees Fahrenheit (°F)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	

***Economizer High Enthalpy Lockout***

<i>Applicability</i>	Systems with fixed enthalpy or differential enthalpy economizers
<i>Definition</i>	The outside air enthalpy above which the economizer will return to minimum position
<i>Units</i>	Btu/lb
<i>Input Restrictions</i>	As designed. The default is 28 Btu/lb. (High altitude locations may require different setpoints.) The software shall apply a fixed offset and add 2 Btu/lb to the user-entered value.

*Baseline Building*

**3.7.5 Cooling Systems****3.7.5.1 General**

This group of building descriptors applies to all cooling systems.

***Cooling Source***

<i>Applicability</i>	All systems
<i>Definition</i>	The source of cooling for the system. The choices are: <ul style="list-style-type: none"> <li>• Chilled water</li> <li>• DX</li> <li>• Other</li> </ul>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	The baseline building cooling source is shown in Table 58. See Section 3.1.2 of this document for HVAC system mapping.

Table 58. Cooling Source for Baseline Building System

Baseline Building System	Cooling Type
1 – PTAC	Direct expansion
2 – PTHP	Direct expansion
3 – PSZ AC	Direct expansion
4 – PSZ HP	Direct expansion
5 – Packaged VAV with Reheat	Direct expansion
6 – Packaged VAV with PFP Boxes	Direct expansion
7 – VAV with Reheat	Chilled water
8 – VAV with PFP Boxes	Chilled water
9 – Heating and Ventilation	None
10 – Heating and Ventilation	None
11- Single Zone VAV	Chilled Water
12- Single Zone CAV HW	Chilled Water
13- Single Zone CAV ER	Chilled Water

### Total Cooling Capacity

**Applicability** All cooling systems

**Definition** The total cooling capacity (both sensible and latent) of a cooling coil or packaged DX system at Air-Conditioning, Heating and Refrigeration Institute (AHRI) conditions. The building descriptors defined in this chapter assume that the fan is modeled separately, including any heat it adds to the air stream. The cooling capacity specified by this building descriptor should not consider the heat of the fan.

Note that most CHW coils, and coils in custom DX equipment, particularly those serving high outside air fractions, will have capacities provided in HVAC schedules and submittals at entering air conditions very different from AHRI conditions. For these units, when entered in software using the following simulation methods, custom performance curves will generally be needed, or the capacities and efficiencies recalculated at the AHRI conditions.

**Units** kBtu/h

**Input Restrictions** As designed. For packaged equipment that has the fan motor in the air stream such that it adds heat to the cooled air, the software shall adjust the *total cooling capacity* as follows:

$$Q_{t,net,rated} = Q_{t,gross,rated} - Q_{fan,rated} \quad (11)$$

Where:

$Q_{t,net,rated}$  = The net total cooling capacity of a packaged unit as rated by AHRI (Btu/h)

$Q_{t,gross,rated}$  = The AHRI rated total cooling capacity of a packaged unit (Btu/h)

$Q_{t,fan,rated}$  = The heat generated by the fan and fan motor (if fan motor is in airstream) at AHRI rated conditions

If the gross and net total cooling capacities at AHRI conditions are known, the fan heat at rated conditions is the difference between the two values. If either the gross or net total cooling capacity is unknown, the fan heat at rated conditions shall be accounted for by using equation below :

$$W_{fan} = \frac{Q_{t,gross,rated} - Q_{t,net,rated}}{3.412 \left[ \frac{Btu}{h} \right] / W}$$

Source: Standard 90.1-2019 User's Manual (unpublished)

**Baseline Building** The total cooling capacity of the systems in the baseline building is oversized by 15%. Sizing calculations shall be based on the heating design day and cooling design day conditions, as defined in Section 3.2.3 of this document. Oversizing would be carried out at zone level where the sizing parameters would be applied to the zone design cooling coil loads, but not the airflow rates.

**Sensible Cooling Capacity**

<i>Applicability</i>	All cooling systems
<i>Definition</i>	<p>The sensible cooling capacity of the coil or packaged equipment at Air-conditioning and Refrigeration Institute (ARI) conditions. The building descriptors defined in this chapter assume that the fan is modeled separately, including any heat it adds to the air stream. The cooling capacity specified by this building descriptor should not consider the heat of the fan.</p> <p>Note that the sensible heat ratio (SHR) used by some energy simulation tools can be calculated from the sensible cooling capacity and total cooling capacity:</p> $\text{SHR} = \text{Sensible Cooling Capacity} / \text{Total Cooling Capacity}$
<i>Units</i>	kBtu/h
<i>Input Restrictions</i>	<p>As designed. For packaged equipment that has the fan motor located in the air stream such that it adds heat to the cooled air, the software shall adjust the <i>sensible cooling capacity</i> as follows:</p> $Q_{s,adj} = Q_{s,rated} + BHP_{supply} \times 2.545 \quad (12)$ <p>Where:</p> <ul style="list-style-type: none"> <li><math>Q_{s,adj}</math> = The adjusted sensible cooling capacity of a packaged unit (kBtu/h)</li> <li><math>Q_{s,rated}</math> = The ARI rated sensible cooling capacity of a packaged unit (kBtu/h)</li> <li><math>BHP_{supply}</math> = The supply fan brake horsepower (bhp) in the proposed building design.</li> </ul> <p>If the number of UMLH in the proposed design exceeds 300, the software shall warn the user to resize the equipment.</p>
<i>Baseline Building</i>	The sensible cooling capacity of the systems serving baseline building is oversized by 15%. Sizing calculations shall be based on the heating design day and cooling design day conditions, as defined in Section 3.2.3 of this document

**Cooling Capacity Adjustment Curves**

<i>Applicability</i>	All cooling systems
<i>Definition</i>	<p>The sensible cooling capacity of the coil or packaged equipment at ARI conditions. The building descriptors defined in this chapter assume that the fan is modeled separately, including any heat it adds to the air stream. The cooling capacity specified by this building descriptor should not consider the heat of the fan.</p> <p>Note that the SHR used by some energy simulation tools can be calculated from the sensible cooling capacity and total cooling capacity:</p> $\text{SHR} = \text{Sensible Cooling Capacity} / \text{Total Cooling Capacity}$ <p>A curve that represents the available total cooling capacity as a function of rated cooling coil capacity and/or condenser conditions. The common form of these curves is given as follows:</p>

$$Q_{t,available} = CAP\_FT \times Q_{t,adj} \tag{13}$$

For air-cooled DX

$$CAP\_FT = a + b \times t_{wb} + c \times t_{wb}^2 + d \times t_{odb} + e \times t_{odb}^2 + f \times t_{wb} \times t_{odb} \tag{14}$$

For water-cooled DX

$$CAP\_FT = a + b \times t_{wb} + c \times t_{wb}^2 + d \times t_{wt} + e \times t_{wt}^2 + f \times t_{wb} \times t_{wt} \tag{15}$$

For chilled water coils

$$CAP\_FT = a + b \times t_{wb} + c \times t_{wb}^2 + d \times t_{db} + e \times t_{db}^2 + f \times t_{wb} \times t_{db} \tag{16}$$

Where:

*Q<sub>t,available</sub>* = Available cooling capacity at specified evaporator and/or condenser conditions (thousand British thermal units per hour [MBH])

*Q<sub>t,adj</sub>* = Adjusted capacity at ARI conditions (Btu/h) (see Equation 5)

*CAP\_FT* = A multiplier to adjust *Q<sub>t,adj</sub>*

*t<sub>wb</sub>* = The entering coil wet-bulb temperature (°F)

*t<sub>db</sub>* = The entering coil dry-bulb temperature (°F)

*t<sub>wt</sub>* = The water supply temperature (°F)

*t<sub>odb</sub>* = The outside-air dry-bulb temperature (°F)

Note: If an air-cooled unit employs an evaporative condenser, *t<sub>odb</sub>* is the effective dry-bulb temperature of the air leaving the evaporative cooling unit.

Software may represent the relationship between cooling capacity and temperature in ways other than the equations given above.

Table 59. Cooling Capacity Curve Coefficients

Coefficient	Air Cooled DX		Water Cooled DX		Chilled Water Coils	
	Air-Source (PTAC)	Air-Source (Other DX)	Water-Source (Heat Pump)	Water-Source (Other DX)	Fan-Coil	Other Chilled Water
a	1.1839345	0.8740302	-0.2780377	0.9452633	0.5038866	2.5882585
b	-0.0081087	-0.0011416	0.0248307	-0.0094199	-0.0869176	-0.2305879
c	0.0002110	0.0001711	-0.0000095	0.0002270	0.0016847	0.0038359
d	-0.0061435	-0.0029570	-0.0032731	0.0004805	0.0336304	0.1025812
e	0.0000016	0.0000102	0.0000070	-0.0000045	0.0002478	0.0005984
f	-0.0000030	-0.0000592	-0.0000272	-0.0000599	-0.0010297	-0.0028721

Note: These curves are the DOE-2.1E defaults, except for Water-Source (Other DX), which is taken from the ECB Compliance Supplement, public review draft prepared by the SSPC 90.1 ECB Panel, Version 1.2, March 1996.

*Units* Data structure

*Input Restrictions* As designed. The equations and coefficients given above are the defaults.

*Baseline Building* Default curves will be used for baseline building

**Coil Latent Modeling Method**

<i>Applicability</i>	All DX cooling systems
<i>Definition</i>	The method of modeling coil latent performance at part-load conditions
<i>Units</i>	List
<i>Input Restrictions</i>	One of the following values: Bypass factor – used by DOE-2 based programs NTU-effectiveness – used by EnergyPlus
<i>Baseline Building</i>	Same as proposed

**Coil Bypass Factor**

<i>Applicability</i>	All DX cooling systems (optional input)
<i>Definition</i>	The ratio of air that bypasses the cooling coil at design conditions to the total system airflow
<i>Units</i>	Ratio
<i>Input Restrictions</i>	Prescribed values as shown in Table 60

Table 60. Default Coil Bypass Factors

System Type	Default Bypass Factor
Packaged Terminal Air-conditioners and Heat Pumps	0.241
Other Packaged Equipment	0.190
Multi-Zone Systems	0.078
All Other	0.037

*Baseline Building* Defaults

**Coil Bypass Factor Adjustment Curve**

<i>Applicability</i>	All DX cooling systems (optional input)
<i>Definition</i>	Adjustments for the amount of coil bypass due to the following factors: <ul style="list-style-type: none"> <li>• Coil airflow rate as a percentage of rated system airflow</li> <li>• Entering air wet-bulb temperature</li> <li>• Entering air dry-bulb temperature</li> <li>• Part load ratio</li> </ul>
<i>Units</i>	Data structure
<i>Input Restrictions</i>	Where applicable, prescribed (fixed) simulation engine defaults based on HVAC system type. The following default values shall be used for the adjustment curves:

$$CBF_{adj} = CBF_{rated} \times COIL - BF - FFLOW \times COIL - BF - FT \times COIL - BF - FPLR \tag{17}$$

$$COIL-BF-FFLOW = a + b \times CFMR + c \times CFMR^2 + d \times CFMR^3 \tag{18}$$

$$\text{COIL-BF-FT} = a + b \times T_{wb} + c \times T_{wb}^2 + d \times T_{db} + e \times T_{db}^2 + f \times T_{wb} \times T_{db} \tag{19}$$

$$\text{COIL} - \text{BF} - \text{FPLR} = a + b \times \text{PLR} \tag{20}$$

Where:

- $CBF_{rated}$  = The coil bypass factor at ARI rating conditions
- $CBF_{adj}$  = The coil bypass factor adjusted for airflow and coil conditions
- $CFMR$  = The ratio of airflow to design airflow
- $COIL-BF-FFLOW$  = A multiplier on the rated coil bypass factor to account for variation in airflow across the coil (take coefficients from Table 61)

$COIL-BF-FT$  = A multiplier on the rated coil bypass factor to account for a variation in coil entering conditions (take coefficients from Table 62)

$COIL-BF-FPLR$  = A multiplier on the rated coil bypass factor to account for the part load ratio (take coefficients from Table 63)

$T_{wb}$  = The entering coil wet-bulb temperature (°F)

$T_{db}$  = The entering coil dry-bulb temperature (°F)

$PLR$  = Part load ratio

And the coefficients are listed in the tables below.

Table 61. Coil Bypass Factor Airflow Adjustment Factor

Coefficient	COIL-BF-FFLOW (PTAC)	COIL-BF-FFLOW (HP)	COIL-BF-FFLOW (PSZ/other)
a	-2.277	-0.8281602	-0.2542341
b	5.21140	14.3179150	1.2182558
c	-1.93440	-21.8894405	0.0359784
d		9.3996897	

Table 62. Coil Bypass Factor Temperature Adjustment Factor

Coefficient	COIL-BF-FT (PTAC)	COIL-BF-FT (HP)	COIL-BF-FT (PSZ, other)
a	-1.5713691	-29.9391098	1.0660053
b	0.0469633	0.8753455	-0.0005170
c	0.0003125	-0.0057055	0.0000567
d	-0.0065347	0.1614450	-0.0129181
e	0.0001105	0.0002907	-0.0000017
f	-0.0003719	-0.0031523	0.0001503

Table 63. Coil Bypass Factor Part Load Adjustment Factor

Coefficient	COIL-BF-FPLR (All Systems)
a	0.00
b	1.00

Source: (CEC 2013)

*Baseline Building* Use defaults as described above



### 3.7.5.2 Direct Expansion

#### Direct Expansion Cooling Efficiency

*Applicability* Packaged DX equipment

*Definition* The cooling efficiency of a DX cooling system at ARI rated conditions as a dimensionless ratio of output over input, excluding fan energy. The abbreviation used for this full-load efficiency is  $COP_{nf,cooling}$ .

Fan energy shall be modeled separately according to Section 3.7.3 of this document.

*Units* Unitless

*Input* As designed. Calculated as follows:

*Restrictions*

$$COP_{nf,cooling} = \frac{Q_{t,gross,rated}}{(Total\ Input\ Power[W] - W_{fan}) \times 3.412 [(Btu/h)/W]} \quad (21)$$

Where:

$Q_{t,gross,rated}$  = The AHRI rated total cooling capacity of a packaged unit

*Baseline Building* For Baseline Systems 1, 2, 3, 4, 5 and 6:

Use the  $COP_{nf,cooling}$  from Table 64 (Standard 90.1-2019, Table G3.5.4) packaged terminal air conditioners for System 1 or packaged terminal heat pumps for System 2. Where multiple HVAC zones or residential spaces are combined into a single thermal block, the efficiencies for baseline HVAC Systems shall be taken from Standard 90.1-2019 Tables G3.5.1, G3.5.2, and G3.5.4, and shall be based on the equipment capacity of the thermal block divided by the number of HVAC zones or residential spaces.

Table 64. Efficiency Requirements For Baseline Systems with PTAC and PTHPs (efficiency ratings excluding supply fan power)

Equipment Capacity	Rated Efficiency (EER cooling, COP heating)
PTAC All Capacities (cooling mode)	3.2 $COP_{nf,cooling}$
PTHP All Capacities (cooling mode)	3.1 $COP_{nf,cooling}$
PTHP All Capacities (heating mode)	3.1 $COP_{nf,heating}$

For Baseline Systems 3, 4, 5, 6:

Equipment cooling efficiencies for DX coils shall be modeled in accordance to Table 65 and Table 66 (Standard 90.1-2019 Table G3.5.2 for System 4 and Table G3.5.1 for Systems 3, 5 and 6), which specify  $COP_{nf,cooling}$  for packaged air conditioners. Baseline HVAC system types 5 or 6 efficiencies taken from Table 65 shall be based on the cooling equipment capacity of a single floor when grouping identical floors.

Table 65. Performance Rating Method Air Conditioners: System 3 (efficiency ratings excluding supply fan power)

Equipment Type	Size Category	Heating Section Type	Subcategory or Rating Condition	Minimum Efficiency
Air conditioners, air cooled	<65,000 Btu/h	All	Single Package	3.0 $COP_{nf,cooling}$
	≥65,000 Btu/h and <135,000 Btu/h			3.5 $COP_{nf,cooling}$
	≥135,000 Btu/h and <240,000 Btu/h		Split-system and single-package	3.4 $COP_{nf,cooling}$
	≥240,000 Btu/h and <760,000 Btu/h			3.5 $COP_{nf,cooling}$
	≥760,000 Btu/h			3.6 $COP_{nf,cooling}$

Table 66. Performance Rating Method Electrically Operated Unitary and Applied Heat Pumps: System 4

Equipment Type	Size Category	Heating Section Type	Subcategory or Rating Condition	Minimum Efficiency
Air-cooled, (cooling mode)	<65,000 Btu/h	All	Single-package	3.0 $COP_{nf,cooling}$
	≥65,000 Btu/h and <135,000 Btu/h			3.4 $COP_{nf,cooling}$
	≥135,000 Btu/h and <240,000 Btu/h		Split-system and single-package	3.2 $COP_{nf,cooling}$
	≥240,000 Btu/h			3.1 $COP_{nf,cooling}$
Air-Cooled (heating-mode)	<65,000 Btu/h (cooling capacity)	All	Single-package	3.4 $COP_{nf,heating}$
	≥65,000 Btu/h and <135,000 Btu/h (cooling capacity)		47°F db/43°F wb outdoor air	3.4 $COP_{nf,heating}$
			17°F db/15°F wb outdoor air	2.3 $COP_{nf,heating}$
	≥135,000 Btu/h (cooling capacity)		47°F db/43°F wb outdoor air	3.4 $COP_{nf,heating}$
			17°F db/15°F wb outdoor air	2.1 $COP_{nf,heating}$

**Direct Expansion Cooling Efficiency Temperature Adjustment Curve**

*Applicability* Packaged DX equipment

*Definition* A curve that varies the cooling efficiency of a DX coil as a function of evaporator conditions, condenser conditions. For air cooled DX systems:

$$EIR_{FT} = a + b \times t_{wb} + c \times t_{wb}^2 + d \times t_{odb} + e \times t_{odb}^2 + f \times t_{wb} \times t_{odb} \tag{22}$$

For water cooled DX systems:

$$EIR_{FT} = a + b \times t_{wb} + c \times t_{wb}^2 + d \times t_{wt} + e \times t_{wt}^2 + f \times t_{wb} \times t_{wt} \tag{23}$$

$$P_{operating} = P_{rated} \times EIR_{FPLR} \times EIR_{FT} \times CAP_{FT} \quad (24)$$

Where:

- $PLR$  = Part load ratio based on available capacity (not rated capacity)
- $EIR_{FT}$  = A multiplier on the EIR to account for the wet-bulb temperature entering the coil and the outdoor dry-bulb temperature
- $Q_{operating}$  = Present load on heat pump (Btu/h)
- $Q_{available}$  = Heat pump available capacity at present evaporator and condenser conditions (in Btu/h)
- $t_{wb}$  = The entering coil wet-bulb temperature (°F)
- $t_{wt}$  = The water supply temperature (°F)
- $t_{odb}$  = The outside-air dry-bulb temperature (°F)
- $P_{rated}$  = Rated power draw at ARI conditions (kW)
- $P_{operating}$  = Power draw at specified operating conditions (kW)

Note: If an air cooled unit employs an evaporative condenser,  $t_{odb}$  is the effective dry-bulb temperature of the air leaving the evaporative cooling unit.

Table 67. Cooling System Coefficients for EIR-FT

Coefficient	Water-Source (Heat Pump)	Water-Source (Other)	Air-Source (PTAC)	Air-Source (Other)
a	2.0280385	-1.8394760	-0.6550461	-1.0639310
b	-0.0423091	0.0751363	0.0388910	0.0306584
c	0.0003054	-0.0005686	-0.0001925	-0.0001269
d	0.0149672	0.0047090	0.0013046	0.0154213
e	0.0000244	0.0000901	0.0001352	0.0000497
f	-0.0001640	-0.0001218	-0.0002247	-0.0002096
Rated $c_{WT}$	Max 85°F, Min 60°F	Max 85°F, Min 60°F	NA	NA
Rated $e_{WBt}$	Max 57°F, Min 77°F	Max 57°F, Min 77°F	Max 77°F, Min 57°F	Max 77°F, Min 57°F
Rated $o_{ADBT}$	NA	NA	Max 115°F, Min 75°F	Max 115°F, Min 75°F

Source: (CEC 2013)

*Units*

Data structure

*Input*

User may input curves or use default curves. If defaults are overridden, the software must indicate that supporting documentation is required on the output forms.

*Restrictions*

*Baseline  
Building*

Use default curves specified above, also documented in COMNET Appendix H (COMNET 2017)

**Direct Expansion Part-Load Efficiency Adjustment Curve**

*Applicability* Packaged systems with DX cooling

*Definition* A normalized performance adjustment curve to the rated efficiency (energy input ratio [EIR]) that describes how the efficiency varies at part-load conditions. At a value of 1 (full load), the normalized efficiency is 1.

The default curves are given as follows as adjustments to the EIR<sup>1</sup>:

$$PLR = \frac{Q_{operating}}{Q_{available}(t_{wb}, t_{odb/wt})} \tag{25}$$

$$EIR_{FPLR} = a + b \times PLR + c \times PLR^2 + d \times PLR^3 \tag{26}$$

$$PLF_{FPLR} = a + b \times PLR + c \times PLR^2 + d \times PLR^3$$

Where:

*PLR* = Part load ratio based on available capacity (not rated capacity)

*EIR-FPLR* = A multiplier on the EIR to account for the part load ratio

*Q<sub>operating</sub>* = Present load on heat pump (Btu/h)

*Q<sub>available</sub>* = Heat pump available capacity at present evaporator and condenser conditions (in Btu/h)

*t<sub>wb</sub>* = The entering coil wet-bulb temperature (°F)

*t<sub>wt</sub>* = The water supply temperature (°F)

*t<sub>odb</sub>* = The outside-air dry-bulb temperature (°F)

This curve may take the form of a part-load factor (PLF) or EIR-FLPR, which is the fraction of time the unit must run to meet the part-load for that hour. For example, at 40% of full load, the equipment might need to run 50% of the hour (for cycling losses).

Note that for small packaged equipment with SEER ratings <65,000 Btu/h, the part-load efficiency curve is set to no degradation, since the part-load degradation is built-into the DX cooling efficiency temperature adjustment curve (Air Source, other)

Default curves are provided for the different major classes of equipment.

*Units* Coefficients

*Input Restrictions* The coefficients should sum to 1 (within a small tolerance). This corresponds to a curve output of 1 for an input of 1. User may input curves or use default curves. If defaults are overridden, the software must indicate that supporting documentation is required on the output forms.

<sup>1</sup> The EIR is the ratio of energy used by the system to cooling capacity in the same units. It is the reciprocal of the coefficient of performance (COP). EnergyPlus uses a part-load factor correlation for PLF as a function of PLR. The EnergyPlus PLF is related to the DOE-2 EIR(PLR) by the following: EIR-FPLR = PLR / PLF.

*Baseline Building*

The baseline part-load efficiency adjustment curves are shown in the tables below:

Table 68. Cooling System Coefficients for EIR-FPLR

Coefficient	Water-Source (Heat Pump)	Water-Source (Other)	Air-Source (PTAC)	Air-Source (PSZ with Cap<65,000 Btu/h)	Air-Source (Other)
a	0.1250000	0.2012301	0.1250000	0	0.2012301
b	0.8750000	-0.0312175	0.8750000	1	-0.0312175
c	0.0000000	1.9504979	0.0000000	0	1.9504979
d	0.0000000	-1.1205105	0.0000000	0	-1.1205105

Table 69. Cooling System Coefficients for Part-Load Factor (PLF) Correlation (EnergyPlus)

Coefficient	Water-Source (Heat Pump)	Water-Source (Other)	Air-Source (PTAC)	Air-Source (PSZ with Cap<65,000 Btu/h)	Air-Source (Other)
a	0.85	0	0.85	1	0
b	0.15	5.1091	0.15	0	5.1091
c	0	-8.5515	0	0	-8.5515
d	0	4.4744	0	0	4.4744

Source: (CEC 2013)

**Direct Expansion Number of Cooling Stages**

<i>Applicability</i>	DX systems with multiple stages
<i>Definition</i>	This applies to systems with multiple compressors or multiple discrete stages of cooling. This system is a packaged unit with multiple stages of cooling. Systems with unequally sized compressors may have additional cooling stages.
<i>Units</i>	None (integer)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	All baseline DX systems are single stage

**Total Cooling Capacity by Stage**

<i>Applicability</i>	DX systems with multiple stages
<i>Definition</i>	This provides the total cooling capacity of each cooling stage, at ARI rated conditions. The capacity is expressed as an array, with each entry a fraction of the total rated cooling capacity for the unit. For example, if the stage cooling capacity is 4 tons (48,000 Btu/h) and the total cooling capacity is 8 tons (96,000 Btu/h), the capacity is expressed as “0.5” for that stage.
<i>Units</i>	Array of fractions
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable for baseline systems

**Sensible Cooling Capacity by Stage**

<i>Applicability</i>	DX systems with multiple stages
<i>Definition</i>	Provides the sensible cooling capacity of each cooling stage, at ARI rated conditions. The capacity is expressed as an array, with each entry a fraction of the total rated sensible cooling capacity for the unit. For example, if the stage sensible cooling capacity is 3.5 tons (42,000 Btu/h) and the total sensible cooling capacity is 7 tons (72,000 Btu/h), the capacity is expressed as “0.5” for that stage.
<i>Units</i>	Array of fractions
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Applicable baseline systems 1 through 6. The sensible cooling capacity of the baseline building is oversized by 15%. Sizing calculations shall be based on 1% dry-bulb and 1% wet-bulb design conditions.

**Supply Fan Low Speed Ratio**

<i>Applicability</i>	Single zone DX systems with multiple stages and two-speed fans or VAV fans
<i>Definition</i>	Specifies the low fan speed setting on a single zone VAV system or DX system with multiple cooling stages
<i>Units</i>	None (fraction)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable

**Supply Fan Low Power Ratio**

<i>Applicability</i>	Single zone DX systems with multiple stages and two-speed fans or VAV fans
<i>Definition</i>	Specifies the fraction of full load fan power corresponding to low fan speed operation on a single zone VAV system or DX system with multiple cooling stages
<i>Units</i>	None (fraction)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable

**Piping Insulation**

<i>Applicability</i>	All projects
<i>Definition</i>	Thermal insulation on piping systems for service hot water, steam piping, chilled water for cooling, and hot water for space heating
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	Not modeled
<i>Baseline Building</i>	Not modeled

**Minimum Unloading Ratio**

<i>Applicability</i>	Packaged systems that use hot-gas bypass during low load conditions
<i>Definition</i>	<p>The minimum unloading ratio is where the equipment capacity can no longer be reduced by unloading and must be false loaded to meet smaller cooling loads. A typical false loading strategy is hot-gas bypass.</p> <p>The minimum unloading ratio is the upper end of the hot-gas bypass operating range. This is the percentage of peak cooling capacity below the range in which hot-gas bypass will operate.</p> <p>The actual unloading ratio shall be set to 50% of the user-entered minimum unloading ratio, with hot-gas-bypass operating below this level.</p>
<i>Units</i>	Ratio
<i>Input Restrictions</i>	As designed. The user must enter this descriptor for each DX cooling system. If hot-gas bypass is not employed, a value of 0 may be entered.
<i>Baseline Building</i>	Not applicable

**Minimum HGB Ratio**

<i>Applicability</i>	Packaged systems that use hot-gas bypass during low load conditions
<i>Definition</i>	The lower end of the hot-gas bypass operating range. The percentage of peak cooling capacity below which hot-gas bypass will no longer operate (i.e., the compressor will cycle).
<i>Units</i>	Fraction (between 0 and 1)
<i>Input Restrictions</i>	As designed. The user must enter this descriptor for each DX cooling system. If hot-gas bypass is not employed, a value of 0 may be entered.
<i>Baseline Building</i>	Not applicable

**Condenser Type**

<i>Applicability</i>	All DX systems including heat pumps
<i>Definition</i>	The type of condenser for a DX cooling system. The choices are: <ul style="list-style-type: none"> <li>• Air-cooled</li> <li>• Water-cooled</li> <li>• Air-cooled with evaporative pre-cooler</li> </ul>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Based on prescribed system type

Table 70. Baseline Building Condenser Type

Baseline Building System	Condenser Type
1 – PTAC	Air cooled
2 – PTHP	Air cooled
3 – PSZ AC	Air cooled
4 – PSZ HP	Air cooled
5 – PVAV reheat	Air cooled
6 – Packaged VAV with PFP Boxes	Air cooled
7 – VAV with Reheat	N/A
8 – VAV with PFP Boxes	N/A
9 – Heating and Ventilation	N/A
10 – Heating and Ventilation	N/A
11 – Single Zone VAV	N/A
12- Single Zone CAV HW	N/A
13- Single Zone- CAV ER	N/A

**Condenser Flow Type**

<i>Applicability</i>	All DX systems including heat pumps
<i>Definition</i>	Describes water flow control for a water cooled condenser. The choices are: <ul style="list-style-type: none"> <li>• Fixed flow</li> <li>• Two-position</li> <li>• Variable flow</li> </ul>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed. For variable or staged capacity equipment, the minimum-unload ratio must be set properly for the simulation program. <b>NOTE:</b> If the variable-flow is selected, the software must indicate that supporting documentation is required on the output forms.
<i>Baseline Building</i>	Not applicable

**3.7.5.3 Evaporative Cooler**

This is equipment that pre-cools the outside air that is brought into the building. It may be used with any type of cooling system that brings in outside air. This equipment is not applicable for the baseline building. The analyst must be careful to input evaporative cooler and outside air controls, as allowed by the software that reasonably reflect anticipated operation as indicated in sequences of operation, and



review the simulation outputs, particularly zone or return air relative humidity, to ensure that the simulated sensible cooling from the evaporative cooler is realistic.

#### **Evaporative Cooling Type**

<i>Applicability</i>	Systems with evaporative pre-cooling
<i>Definition</i>	<p>The type of evaporative pre-cooler, including:</p> <ul style="list-style-type: none"> <li>• None</li> <li>• Non-integrated indirect</li> <li>• Non-integrated direct/indirect</li> <li>• Integrated indirect</li> <li>• Integrated direct/indirect</li> </ul> <p>An integrated pre-cooler can operate together with the compression or CHW cooling. A non-integrated pre-cooler will shut down the evaporative cooling whenever it is unable to provide 100% of the cooling required.</p> <p>In all cases, the evaporative pre-cooler must be modeled with 100% of the outside air routed through the pre-cooler.</p>
<i>Units</i>	None
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable

#### **Evaporative Cooling System Capacity**

<i>Applicability</i>	Systems with evaporative cooling
<i>Definition</i>	The total sensible cooling capacity of the evaporative cooling system at design outdoor dry-bulb conditions. This value may be derived from other inputs of supply fan design air rated capacity (5.7.3), direct stage effectiveness, indirect stage effectiveness, and design outdoor conditions.
<i>Units</i>	None
<i>Input Restrictions</i>	Not applicable. This is a derived input. If there are excessive UMLH in any zone served by the evaporative cooling system, a supplementary DX cooling unit must be defined by the user. See Section 3.7.5.2 of this document for descriptors related to DX cooling units.
<i>Baseline Building</i>	Not applicable

**Direct Stage Effectiveness**

<i>Applicability</i>	Systems with evaporative pre-cooling
<i>Definition</i>	The effectiveness of the direct stage of an evaporative cooling system. Effectiveness is defined as follows:

$$DirectEFF = \frac{T_{db} - T_{direct}}{T_{db} - T_{wb}} \quad (27)$$

Where:

$DirectEFF$  = The direct stage effectiveness

$T_{db}$  = The entering air dry-bulb temperature

$T_{wb}$  = The entering air wet-bulb temperature

$T_{direct}$  = The direct stage leaving dry-bulb temperature

*Units* Numeric (0 <= eff <=1)

*Input Restrictions* As designed

*Baseline Building* Not applicable

**Indirect Stage Effectiveness**

<i>Applicability</i>	Systems with evaporative pre-cooling
<i>Definition</i>	The effectiveness of the indirect stage of an evaporative cooling system. Effectiveness is defined as follows:

$$IndEFF = \frac{T_{db} - T_{ind}}{T_{db} - T_{wb}} \quad (28)$$

Where:

$IndEFF$  = The indirect stage effectiveness

$T_{db}$  = The entering air dry-bulb temperature of the supply air

$T_{wb}$  = The entering air wet-bulb temperature of the “scavenger air”

$T_{ind}$  = The supply air leaving dry-bulb temperature

*Units* Numeric (0 <= eff <=1)

*Input Restrictions* As designed

*Baseline Building* Not applicable

**Evaporative Cooling Performance Curves**

*Applicability* Systems with evaporative cooling  
*Definition* A curve that varies the evaporative cooling effectiveness as a function of primary air stream airflow. The default curves are given as follows:

$$PLR = \frac{CFM_{operating}}{CFM_{design}} \tag{29}$$

$$EFF\_FFLOW = a + b \times PLR + c \times PLR^2$$

Where:

- PLR* = Part load ratio of airflow based on design airflow
- EFF-FFLOW* = A multiplier on the evaporative cooler effectiveness to account for variations in part load
- CFM<sub>operating</sub>* = Operating primary air stream airflow (cfm)
- CFM<sub>design</sub>* = Design primary air stream airflow (cfm)

Table 71. Part Load Curve Coefficients – Evaporative Cooler Effectiveness

Coefficient	Direct	Indirect
a	1.1833000	1.0970000
b	-0.2575300	-0.1650600
c	0.0742450	0.0680690

Source: COMNET 2017

*Units* Data structure  
*Input Restrictions* User may input curves or use default curves. If defaults are overridden, the software must indicate that supporting documentation is required on the output forms.  
*Baseline Building* Not used

**Auxiliary Evaporative Cooling Power**

*Applicability* Systems with evaporative cooling  
*Definition* The auxiliary energy of the indirect evaporative cooler fan, and the pumps for both direct and indirect stages  
*Units* Watts  
*Input Restrictions* As designed  
*Baseline Building* Not applicable

**Evaporative Cooling Scavenger Air Source**

*Applicability* Systems with evaporative cooling  
*Definition* The source of scavenger air for an indirect section of an evaporative cooler. Options include:
 

- Return air
- Outside air

*Units* List (see above)  
*Input Restrictions* As designed  
*Baseline Building* Not applicable

### 3.7.5.4 Evaporative Condenser

#### Evaporative Condenser Power

<i>Applicability</i>	DX systems with an evaporatively cooled condenser
<i>Definition</i>	The power of the evaporative precooling unit. This includes any pump(s) and/or fans that are part of the precooling unit.
<i>Units</i>	Watts
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable

#### Evaporative Condenser Effectiveness

<i>Applicability</i>	DX systems with an evaporatively cooled condenser
<i>Definition</i>	The effectiveness of the evaporative precooling unit for a condenser. Effectiveness is defined as follows:

$$DirectEFF = \frac{T_{db} - T_{direct}}{T_{db} - T_{wb}} \quad (30)$$

Where:

<i>DirectEFF</i>	=	The direct stage effectiveness
<i>T<sub>db</sub></i>	=	The outside air dry-bulb temperature
<i>T<sub>wb</sub></i>	=	The outside air wet-bulb temperature
<i>T<sub>direct</sub></i>	=	The direct stage leaving dry-bulb temperature (at the condenser inlet)

<i>Units</i>	Ratio
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable

#### Evaporative Condenser Operation Range

<i>Applicability</i>	DX systems with an evaporatively cooled condenser						
<i>Definition</i>	The temperature range within which the evaporative condenser operates. Two values are provided: <table> <tr> <td><i>T<sub>maximum</sub></i></td> <td>=</td> <td>The threshold outside air dry-bulb temperature below which evaporative condenser operates.</td> </tr> <tr> <td><i>T<sub>minimum</sub></i></td> <td>=</td> <td>The threshold outside air dry-bulb temperature above which evaporative condenser operates.</td> </tr> </table>	<i>T<sub>maximum</sub></i>	=	The threshold outside air dry-bulb temperature below which evaporative condenser operates.	<i>T<sub>minimum</sub></i>	=	The threshold outside air dry-bulb temperature above which evaporative condenser operates.
<i>T<sub>maximum</sub></i>	=	The threshold outside air dry-bulb temperature below which evaporative condenser operates.					
<i>T<sub>minimum</sub></i>	=	The threshold outside air dry-bulb temperature above which evaporative condenser operates.					
<i>Units</i>	Degrees Fahrenheit (°F)						
<i>Input Restrictions</i>	As designed						
<i>Baseline Building</i>	Not applicable						

### 3.7.5.5 Four-Pipe Fan Coil Systems

This section contains building descriptors required to model four-pipe fan coil systems. Note that this system requires an outside air ventilation source to serve the zones and that an airside economizer is not available. Note that additional HVAC components (chiller, boiler, pumps) are needed to fully define this system.

<i>Capacity Control Method</i>	
<i>Applicability</i>	Four-pipe fan coil systems
<i>Definition</i>	<p>The control method for the fan coil unit at the zone. The following choices are available:</p> <ul style="list-style-type: none"> <li>• Constant fan variable flow: The fan speed is held constant to produce a fixed airflow rate whenever the unit is scheduled on. The hot water or chilled flow rate is varied so that the unit output matches the zone heating or cooling requirement.</li> <li>• Constant fan constant flow: The fan speed is held constant to produce a fixed flow rate whenever the unit is scheduled on. The chilled water and hot water flow rates are kept constant at full flow.</li> <li>• Cycling fan: The fan speed is chosen so that the unit capacity is greater than or equal to the heating/cooling load and the fan is cycled to match unit output with the load.</li> <li>• Variable fan constant flow: The water flow rate is at full flow and the fan speed varies to meet the load.</li> <li>• Variable fan variable flow: Both air and water flow rates are varied to match the load.</li> </ul>
<i>Units</i>	List (with choices above)
<i>Input Restrictions</i>	Not a user input – derived from building descriptors for fan control and chiller loop flow control
<i>Baseline Building</i>	Four pipe fan coil systems are applicable for proposed buildings with the system type defined in Table 72. The capacity control for the baseline building will be specified as “Constant Fan Constant Flow.”

Table 72. Baseline Systems Using Fan Coil Units

Proposed		Baseline System Type
Heating	Cooling	
Boiler/Electric Resistance or Gas Furnace	Purchased Chilled Water	Proposed buildings qualifying for System 1 and 2 will be constant volume fan coil units
Purchased Heat	Purchased Chilled Water	Proposed buildings qualifying for System 1 will be constant volume fan coil units

### 3.7.5.6 Radiant Cooling

This section describes a floor-based radiant cooling system and the inputs required for Standard 90.1-2019 evaluation.

**Hydronic Tubing Length**

<i>Applicability</i>	Floor-based radiant cooling systems
<i>Definition</i>	The length of the hydronic tubing in the slab
<i>Units</i>	ft
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable

**Hydronic Tubing Inside Diameter**

<i>Applicability</i>	Floor-based radiant cooling systems
<i>Definition</i>	The inside diameter of the hydronic tubing in the slab
<i>Units</i>	ft
<i>Input Restrictions</i>	As designed, between a minimum of 1/2 in. and a maximum of 3/4 in.
<i>Baseline Building</i>	Not applicable

**Temperature Control Type**

<i>Applicability</i>	Floor-based radiant cooling systems
<i>Definition</i>	The temperature used for control (operative temperature, mean air temperature, mean radiant temperature, T <sub>ODB</sub> , T <sub>OWB</sub> )
<i>Units</i>	None
<i>Input Restrictions</i>	Fixed at mean air temperature for calculations
<i>Baseline Building</i>	Not applicable

**Rated Flow Rate**

<i>Applicability</i>	Floor-based radiant cooling systems
<i>Definition</i>	The temperature used for control (operative temperature, mean air temperature, mean radiant temperature, ODB, OWB)
<i>Units</i>	None
<i>Input Restrictions</i>	Fixed at mean air temperature for calculations
<i>Baseline Building</i>	Not applicable

**Cooling Control Temperature**

<i>Applicability</i>	Variable flow systems
<i>Definition</i>	The temperature used for control (operative temperature, mean air temperature, mean radiant temperature, ODB, OWB)
<i>Units</i>	None
<i>Input Restrictions</i>	Fixed at mean air temperature for calculations
<i>Baseline Building</i>	Not applicable

**Condensation Control Type**

<i>Applicability</i>	Floor-based radiant cooling systems
<i>Definition</i>	The temperature used for control (operative temperature, mean air temperature, mean radiant temperature, ODB, OWB)
<i>Units</i>	None
<i>Input Restrictions</i>	Fixed at mean air temperature for calculations
<i>Baseline Building</i>	Not applicable

**Condensation Control Dewpoint Offset**

<i>Applicability</i>	Floor-based radiant cooling systems
<i>Definition</i>	The temperature difference above dewpoint that is the minimum cold water supply temperature
<i>Units</i>	None
<i>Input Restrictions</i>	Fixed at 2°F above dewpoint
<i>Baseline Building</i>	Not applicable

**Rated Pump Power Consumption**

<i>Applicability</i>	Floor-based radiant cooling systems
<i>Definition</i>	The rated pump power at design conditions
<i>Units</i>	Watts
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable

**Motor Efficiency**

<i>Applicability</i>	Floor-based radiant cooling systems
<i>Definition</i>	The pump motor efficiency
<i>Units</i>	Decimal fraction
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Default motor efficiency from Standard 90.1-2019, Table G3.9.1 based on motor nameplate hp

**Fraction of Motor Heat to Fluid**

<i>Applicability</i>	Floor-based radiant cooling systems
<i>Definition</i>	Fraction of the heat from the motor inefficiencies that enters the fluid stream
<i>Units</i>	None
<i>Input Restrictions</i>	As designed. Default is 0.
<i>Baseline Building</i>	Not applicable

**Cooling High Water Temperature**

<i>Applicability</i>	Floor-based radiant cooling systems
<i>Definition</i>	The high temperature used for control. If the water temperature is above the high temperature, the control temperature is set to the low control temperature.
<i>Units</i>	°F
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable

**Cooling Low Water Temperature**

<i>Applicability</i>	Floor-based radiant cooling systems
<i>Definition</i>	The temperature used for control of the water temperature. If the water temperature of the radiant cooling is below this temperature, cooling is disabled.
<i>Units</i>	°F
<i>Input Restrictions</i>	Fixed at 55°F
<i>Baseline Building</i>	Not applicable

**Condensation of Control Type**

<i>Applicability</i>	Floor-based radiant cooling systems
<i>Definition</i>	The simulation program may have a means of detecting when condensation is likely to occur on floor surfaces in the space. When this occurs, the simulation can shut off the system to prevent condensation from occurring.
<i>Units</i>	List: None, Simple, Variable
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable

**3.7.5.7 Chilled Beams**

Building descriptors will be added to define how chilled beams can be modeled for the proposed design. Chilled beams are not applicable to the baseline building system.

**3.7.5.8 Ground-Source Heat Pumps**

Building descriptors will be added to define how ground-source heat pumps can be modeled for the proposed design. Ground source heat pumps are not applicable to the baseline building system.

**3.7.5.9 Variable Refrigerant Flow**

Building descriptors will be added to define how VRF systems can be modeled for the proposed design. Variable refrigerant flow systems are not applicable to the baseline building system.

**3.7.5.10 Underfloor Air Distribution**

Building descriptors will be added to define how UFAD systems can be modeled for the proposed design. Underfloor air distribution systems are not applicable to the baseline building system.



## 3.7.6 Heating Systems

### 3.7.6.1 General

#### *Heating Source*

<i>Applicability</i>	All systems that provide heating
<i>Definition</i>	The source of heating for the heating and preheat coils. The choices are: <ul style="list-style-type: none"> <li>• Hot water</li> <li>• Steam</li> <li>• Electric resistance</li> <li>• Electric heat pump</li> <li>• Gas furnace</li> <li>• Gas heat pump</li> <li>• Oil furnace</li> <li>• Heat recovery</li> </ul>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Based on the prescribed system type

Table 73. Heating Source for Baseline Building

Baseline Building System	Heating Type
1 – PTAC	Hot water fossil fuel boiler
2 – PTHP	Electric heat pump
3 – PSZ AC	Fossil fuel furnace
4 – PSZ HP	Electric heat pump
5 – PVAV reheat	Hot water fossil fuel boiler
6 – Packaged VAV with PFP Boxes	Electric resistance
7 – VAV with Reheat	Hot water fossil fuel boiler
8 – VAV with PFP Boxes	Electric resistance
9– Heating and Ventilation	Fossil fuel furnace
10 – Heating and Ventilation	Electric Resistance
11- Single Zone VAV	For climate zones 0-3A, the heating system will be electric resistance. All other will be hot-water fossil fuel boilers.
12- Single Zone CAV HW	Hot water fossil fuel boiler
13- Single Zone CAV ER	Electric resistance

#### *Total Heating Coil Capacity*

<i>Applicability</i>	All systems with heating coils
<i>Definition</i>	The heating capacity of a heating coil at ARI conditions
<i>Units</i>	Btu/h
<i>Input Restrictions</i>	As designed. The capacity would need to be adjusted if the number of UMLH exceeds 300.
<i>Baseline Building</i>	Autosize with a heating oversizing factor of 25%. Sizing calculations shall be based on the heating design day and cooling design day conditions, as defined in Section 3.2.3 of this document. Oversizing would be carried out at zone level where the sizing parameters would

be applied to the zone design heating loads, but not the airflow rates. Refer to Section 2.7.2 of this document for more details.

#### ***Number of Heating Stages***

<i>Applicability</i>	Heating systems with multiple stages
<i>Definition</i>	The number of heating stages provided by the system. Multiple stages could be provided via a heat pump or via a multiple-stage gas furnace.
<i>Units</i>	Integer
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Single stage

#### ***Heating Capacity by Stage***

<i>Applicability</i>	Heating systems with multiple stages
<i>Definition</i>	Provides the total heating capacity of each heating stage, at ARI rated conditions. The capacity is expressed as an array, with each entry a fraction of the total rated cooling capacity for the unit. For example, if the stage heating capacity is 48,000 Btu/h and the heating capacity is 96,000 Btu/h, the capacity is expressed as “0.5” for that stage.
<i>Units</i>	Array of fractions
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable

### **3.7.6.2 Preheat Coil**

For systems 5 through 8, the baseline will be modeled with preheat coil in the mixed air stream controlled to a fixed setpoint 20°F less than the design zone heating temperature setpoint

#### ***Preheat Coil Capacity***

<i>Applicability</i>	Proposed buildings with preheat coils and baseline systems 5 through 8
<i>Definition</i>	The heating capacity of a preheating coil at design conditions
<i>Units</i>	Btu/h
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	For baseline systems 5 through 8, the baseline will be modeled with preheat coil controlled to a fixed setpoint 20°F less than the design zone heating temperature setpoint. If there are multiple zone heating setpoints, the preheat setpoint will be determined by the zone with the highest heating temperature setpoint.  The preheat coil capacity will be oversized by 25%. Sizing calculations shall be based on the heating design day and cooling design day conditions, as defined in Section 3.2.3 of this document. Oversizing would be carried out at zone level where the sizing parameters would be applied to the zone design’s heating coil loads.

**Preheat Coil Type**

<i>Applicability</i>	Baseline systems 5 through 8
<i>Definition</i>	The heating source of a preheating coil. The preheat coil could be electric resistance, gas fired, or a hydronic heating coil.
<i>Units</i>	List: Electric Resistance, Gas Fired, Hydronic
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	The heating source for baseline systems 5 and 7 will be hydronic. Buildings with baseline systems 6 and 8 will be modeled with electric resistance preheat coils.

**Preheat Coil Efficiency**

<i>Applicability</i>	Systems with a preheat coil with gas heating
<i>Definition</i>	The heating efficiency of a preheating coil at design conditions
<i>Units</i>	Percentage
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable. Baseline building would have preheat coils only for systems 5 through 8 that would either be electric resistance or hydronic.

**3.7.6.3 Hydronic/Steam Heating Coils**

Systems with boilers have heating coils, including baseline building systems 1, 5, 7, 11 (for climate zones 3B to 8), and system 12. Two-way valves are assumed at the baseline system heating coils with a single three-way bypass valve at the end of the loop.

**Heating Coil Capacity**

<i>Applicability</i>	All systems with a heating coil
<i>Definition</i>	The heating capacity of a heating coil at ARI conditions
<i>Units</i>	But/h
<i>Input Restrictions</i>	As designed. Adjust the capacity if the number of UMLH exceeds 300.
<i>Baseline Building</i>	Autosized, with a heating oversizing factor of 25%. Sizing calculations shall be based on the heating design day and cooling design day conditions, as defined in Section 3.2.3 of this document. Oversizing would be carried out at zone level where the sizing parameters would be applied to the zone design heating loads, but not the airflow rates. If the number of UMLH for the baseline exceeds 300, heating coil capacity may need to be increased along with system airflow as described in Section 2.7.2 of this document.

### 3.7.6.4 Furnace

#### Furnace Capacity

<i>Applicability</i>	Systems with a furnace
<i>Definition</i>	The full load heating capacity of the unit
<i>Units</i>	Btu/h
<i>Input Restrictions</i>	As designed. Adjust the capacity if the number of UMLH exceeds 300.
<i>Baseline Building</i>	Autosized, with a heating oversizing factor of 25%. Sizing calculations shall be based on the heating design day and cooling design day conditions, as defined in Section 3.2.3 of this document. Oversizing would be carried out at zone level where the sizing parameters would be applied to the zone design heating loads, but not the airflow rates.  If the number of UMLH for the baseline exceeds 300, heating coil capacity may need to be increased along with system airflow as described in Section 2.7.2 of this document.

#### Furnace Fuel Heating Efficiency

<i>Applicability</i>	Systems with a furnace
<i>Definition</i>	The full load thermal efficiency of either a gas or oil furnace at design conditions. The software must accommodate input in either <i>Thermal Efficiency</i> ( $E_t$ ) or <i>Annual Fuel Utilization Efficiency</i> (AFUE). Where AFUE is provided, $E_t$ shall be calculated as follows for both packaged and split systems:

$$E_t = ( 0.0051427 * AFUE ) + 0.3989 \tag{31}$$

Source: (CEC 2013)

For furnaces with efficiency rating prescribed as combustion efficiency, 2% jacket losses will be assumed. Hence:

$$E_t = E_c - 2\%$$

Where:

- AFUE = The annual fuel utilization efficiency (%)
- $E_t$  = The thermal efficiency (fraction)
- $E_c$  = Combustion efficiency

<i>Units</i>	Fraction
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	This is applicable to baseline systems 3 and 9. The baseline efficiency requirement is located in Table G3.5.5 of Standard 90.1-2019 and Table 74 of this manual. Where multiple HVAC zones or residential spaces are combined into a single thermal block, the efficiencies for baseline HVAC Systems shall be based on the equipment capacity of the thermal block divided by the number of HVAC zones or residential spaces.

Table 74. Efficiency Requirements for Baseline Systems with Fossil Fuel Furnace

Equipment Type	Size	Efficiency	Test Procedure
Furnace	<225,000 Btu/h	78% AFUE or 80% $E_t$	DOE 10 CFR Part 430 or ANSI Z21.47
	≥225,000 Btu/h	80% $E_c$	ANSI Z21.47
Unit Heater	All	80% $E_c$	ANSI Z83.8

**Furnace Fuel Heating Part Load Efficiency Curve**

*Applicability* Systems with furnaces  
*Definition* An adjustment factor that represents the percentage of full load fuel consumption as a function of the percentage full load capacity. This curve shall take the form of a quadratic equation as follows:

$$Fuel_{partload} = Fuel_{rated} \times FHeatPLC \tag{32}$$

$$FHeatPLC = \left( a + b \times \frac{Q_{partload}}{Q_{rated}} + c \times \left( \frac{Q_{partload}}{Q_{rated}} \right)^2 \right) \tag{33}$$

Where:

- FHeatPLC* = The fuel heating part load efficiency curve
- Fuel<sub>partload</sub>* = The fuel consumption at part load conditions (Btu/h)
- Fuel<sub>rated</sub>* = The fuel consumption at full load (Btu/h)
- Q<sub>partload</sub>* = The capacity at part load conditions (Btu/h)
- Q<sub>rated</sub>* = The capacity at rated conditions (Btu/h)

Table 75. Furnace Efficiency Curve Coefficients

Coefficient	Furnace
a	0.0186100
b	1.0942090
c	-0.1128190

Source: COMNET 2017

*Units* Data structure  
*Input Restrictions* As designed when data is available, otherwise defaults curves are required to be used  
*Baseline Building* Default curves are required to be used

**Furnace Fuel Heating Pilot**

*Applicability* Systems that use a furnace for heating  
*Definition* The fuel input for a pilot light on a furnace  
*Units* Btu/h  
*Input Restrictions* As designed  
*Baseline Building* Zero (pilotless ignition)

**Furnace Fuel Heating Fan/Auxiliary Power**

*Applicability* Systems that use a furnace for heating  
*Definition* The fan energy in forced draft furnaces and the auxiliary (pumps and outdoor fan) energy in fuel-fired heat pumps  
*Units* kilowatts (kW)  
*Input Restrictions* As designed  
*Baseline Building* Not applicable

### 3.7.6.5 Electric Heat Pump

#### *Electric Heat Pump Heating Capacity*

<i>Applicability</i>	All heat pumps
<i>Definition</i>	The full load heating capacity of the unit, excluding supplemental heating capacity at ARI rated conditions
<i>Units</i>	Btu/h
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	<p>Autosized, with a heating oversizing factor of 25%. Sizing calculations shall be based on the heating design day and cooling design day conditions, as defined in Section 3.2.3 of this document. Oversizing would be carried out at zone level where the sizing parameters would be applied to the zone design heating loads, but not the airflow rates.</p> <p>If the number of UMLH for the baseline exceeds 300, heating coil capacity may need to be increased along with system airflow as described in Section 2.7.2 of this document.</p>

#### *Electric Heat Pump Supplemental Heating Source*

<i>Applicability</i>	All heat pumps
<i>Definition</i>	<p>The auxiliary heating source for a heat pump heating system. The common control sequence is to operate the heat pump when the auxiliary heat is activated, until the low temperature limit, at which the compressor is turned off. Other building descriptors may be needed if this is not the case. Choices for supplemental heat include:</p> <ul style="list-style-type: none"> <li>• Electric resistance</li> <li>• Gas furnace</li> <li>• Oil furnace</li> <li>• Hot water</li> <li>• Other</li> </ul>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Electric resistance

**Electric Heat Pump Heating Efficiency**

<i>Applicability</i>	All heat pumps
<i>Definition</i>	The heating efficiency of a heat pump at ARI rated conditions as a dimensionless ratio of output over input. The abbreviation used for this full-load efficiency is COP <sub>nf heating</sub> . Fan energy shall be modeled separately according to Section 3.7.3 of this document.
<i>Units</i>	Unitless
<i>Input Restrictions</i>	As designed

$$COP_{nf\ heating} = \frac{Gross\ Heating(Btu/h)}{(Total\ Input\ Power[W] - W_{fan}) \times 3.412 [(Btu/h)/W]} \quad (34)$$

Where:

$Q_{t,gross, rated}$  = The AHRI rated total cooling capacity of a packaged unit (Btu/h)

*Baseline Building* For Baseline System 2:  
 The heat pump efficiency for baseline system 2 shall be determined using the heating mode COP from Table 64 (Standard 90.1-2019 Table G3.5.2 and G3.5.4). Use the total net heating capacity of the baseline design to determine the size. COP<sub>nfcooling</sub> and COP<sub>nfheating</sub> are the packaged HVAC equipment cooling and heating energy efficiency, respectively, to be used in the baseline building design, which excludes supply fan power. Fan energy shall be modeled separately according to Section 3.7.3 of this document.  
 Where multiple HVAC zones or residential spaces are combined into a single thermal block, the efficiencies for baseline HVAC Systems shall be based on the equipment capacity of the thermal block divided by the number of HVAC zones or residential spaces.

For Baseline System 4:

Equipment heating efficiencies for heat pumps shall be modeled in accordance to Table 66, which specify COP<sub>nfheating</sub> for unitary heat pumps.

**Electric Heat Pump Heating Capacity Adjustment Curve(s)**

*Applicability* All heat pumps

*Definition* A curve or group of curves that represent the available heat-pump heating capacity as a function of evaporator and condenser conditions. The default curves are given as follows:

$$Q_{available} = CAP_{FT} \times Q_{rated} \tag{35}$$

(applies to heat-pump heating efficiency only)

For air cooled heat pumps:

$$CAP_{FT} = a + b \times t_{odb} + c \times t_{odb}^2 + d \times t_{odb}^3 \tag{36}$$

For water cooled heat pumps:

$$CAP_{FT} = a + b \times t_{db} + d \times t_{wt} \tag{37}$$

Where:

*Q<sub>available</sub>* = Available heating capacity at present evaporator and condenser conditions (kBtu/h)

*t<sub>db</sub>* = The entering coil dry-bulb temperature (°F)

*t<sub>wt</sub>* = The water supply temperature (°F)

*t<sub>odb</sub>* = The outside-air dry-bulb temperature (°F)

*Q<sub>rated</sub>* = Rated capacity at ARI conditions (in kBtu/h)

Table 76. Heat Pump Capacity Adjustment Curves (CAP-FT)

Coefficient	Water-Source	Air-Source
a	0.4886534	0.2536714
b	-0.0067774	0.0104351
c	N/A	0.0001861
d	0.0140823	-0.0000015

Source: COMNET 2017

*Units* Data structure

*Input Restrictions* User may input curves or use default curves. If defaults are overridden, supporting documentation shall be provided.

*Baseline Building* Use default curves

**Electric Heat Pump Heating Efficiency Adjustment Curve(s)**

*Applicability* All heat pumps

*Definition* A curve or group of curves that varies the heat-pump heating efficiency as a function of evaporator conditions, condenser conditions and part-load ratio. The default curves are given as follows:

$$PLR = \frac{Q_{operating}}{Q_{available}(t_{db}, t_{odb}/wt)} \tag{38}$$

$$EIR_{FPLR} = a + b \times PLR + c \times PLR^2 + d \times PLR^3 \tag{39}$$



Air source heat pumps:

$$EIR_{FT} = a + b \times t_{odb} + c \times t_{odb}^2 + d \times t_{odb}^3 \tag{40}$$

Water source heat pumps:

$$P_{operating} = P_{rated} \times EIR_{FPLR} \times EIR_{FT} \times CAP_{FT} \tag{41}$$

$$EIR_{FT} = a + b \times t_{odb} + c \times t_{odb}^2 + d \times t_{odb}^3 \tag{42}$$

Source: PRM-RM 2010

Where:

- PLR* = Part load ratio based on available capacity (not rated capacity)
- EIR-FPLR* = A multiplier on the EIR of the heat pump as a function of part load ratio
- EIR-FT* = A multiplier on the EIR of the heat pump as a function of the wet-bulb temperature entering the coil and the outdoor dry-bulb temperature
- Q<sub>operating</sub>* = Present load on heat pump (Btu/h)
- Q<sub>available</sub>* = Heat pump available capacity at present evaporator and condenser conditions (Btu/h)
- t<sub>db</sub>* = The entering coil dry-bulb temperature (°F)
- t<sub>wt</sub>* = The water supply temperature (°F)
- t<sub>odb</sub>* = The outside air dry-bulb temperature (°F)
- P<sub>rated</sub>* = Rated power draw at ARI conditions (kW)
- P<sub>operating</sub>* = Power draw at specified operating conditions (kW)

Table 77. Heat Pump Heating Efficiency Adjustment Curves

Coefficient	Air-and Water-Source EIR-FPLR	Water-Source EIR-FT	Air-Source EIR-FT
a	0.0856522	1.3876102	2.4600298
b	0.9388137	0.0060479	-0.0622539
c	-0.1834361	N/A	0.0008800
d	0.1589702	-0.0115852	-0.0000046
Rated T <sub>odb</sub>			Max = 50°F, Min = -10 °F
Rated T <sub>wt</sub>			NA

Source: CEC 2013

- Units* None
- Input Restrictions* User may input curves or use default curves. If defaults are overridden, documentation shall be provided.
- Baseline Building* Use default curves

**Electric Heat Pump Supplemental Heating Capacity**

<i>Applicability</i>	All heat pumps
<i>Definition</i>	The design heating capacity of a heat pump supplemental heating coil at ARI conditions
<i>Units</i>	Btu/h
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Autosize

**Electric Supplemental Heating Control Temp**

<i>Applicability</i>	All heat pumps
<i>Definition</i>	The outside dry-bulb temperature below which the heat pump supplemental heating is allowed to operate
<i>Units</i>	Degrees Fahrenheit (°F)
<i>Input Restrictions</i>	As designed. Default to 40°F.
<i>Baseline Building</i>	The space is required to be controlled with multistage space thermostats and an outdoor air thermostat that would energize the auxiliary heat on the last thermostat stage and when the OAT is less than 40°F. The air-source heat pump shall be modeled to continue to operate when auxiliary heat is energized below 40°F.

**Heat Pump Compressor Minimum Operating Temp**

<i>Applicability</i>	All heat pumps
<i>Definition</i>	The outside dry-bulb temperature below which the heat pump compressor is disabled
<i>Units</i>	Degrees Fahrenheit (°F)
<i>Input Restrictions</i>	As designed. Default to 35°F.
<i>Baseline Building</i>	For baseline system 4, the compressor minimum operating temperature is 0°F, and for system 2 it is 35°F

**Coil Defrost**

<i>Applicability</i>	Air cooled electric heat pump
<i>Definition</i>	The defrost control mechanism for an air cooled heat pump. The choices are: <ul style="list-style-type: none"> <li>• Hot-gas defrost, on-demand</li> <li>• Hot-gas defrost, timed 3.5 minute cycle</li> <li>• Electric resistance defrost, on-demand</li> <li>• Electric resistance defrost, timed 3.5 minute cycle</li> </ul> Defrost shall be enabled whenever the outside air dry-bulb temperature drops below 40°F.
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	Default to use hot-gas defrost, timed 3.5 minute cycle. User may select any of the above.
<i>Baseline Building</i>	The baseline building uses the default

**Coil Defrost kW**

<i>Applicability</i>	Heat pumps with electric resistance defrost
<i>Definition</i>	The capacity of the electric resistance defrost heater
<i>Units</i>	kilowatts (kW)
<i>Input Restrictions</i>	As designed. This descriptor defaults to 0 if nothing is entered.
<i>Baseline Building</i>	Not applicable

**Crank Case Heater kW**

<i>Applicability</i>	All heat pumps
<i>Definition</i>	The capacity of the electric resistance heater in the crank case of a DX compressor. The crank case heater operates only when the compressor is off.
<i>Units</i>	kilowatts (kW)
<i>Input Restrictions</i>	As designed. This descriptor defaults to 0 if nothing is entered.
<i>Baseline Building</i>	Zero (0)

**Crank Case Heater Shutoff Temperature**

<i>Applicability</i>	All heat pumps
<i>Definition</i>	The outdoor air dry-bulb temperature above which the crank case heater is not permitted to operate
<i>Units</i>	Degrees Fahrenheit (°F)
<i>Input Restrictions</i>	As designed. This descriptor defaults to 50°F.
<i>Baseline Building</i>	50°F

**3.7.6.6 Energy Recovery**

For baseline systems requiring energy recovery, the heat exchanger is assumed to be integral with the AHU. The system fan power or pressure drop will be adjusted according to the methods in Section 3.7.3.1 of this document.

For proposed systems with heat recovery, the analyst must be careful to set all descriptors, particularly those for control, parasitic energy, and exhaust airflows, to realistically represent the equipment components, operation, and maintenance of building pressurization.

When exhaust air energy recovery systems are installed in cold climates, frost control may significantly affect total recovered energy during subfreezing conditions. Pumps and dedicated fans will consume parasitic energy. Simulation program inputs and hourly reports should be reviewed to ensure all items are represented as close as possible to the actual result of the proposed control sequences.

Requirements related to condenser heat recovery are documented in Section 3.8.7 of this manual.

**Exhaust Air Energy Recovery**

<i>Applicability</i>	Any system with outside air heat recovery
<i>Definition</i>	Provision of exhaust air energy recovery system. Provisions shall be made to bypass heat recovery system to permit air-side economizer operation as specified in Section 3.7.4.2 of this document.
<i>Units</i>	Unitless
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	<p>Required for fan systems with a design supply air flow rate of 5,000 cfm or greater, if the minimum outside air quantity is 70% of the design air flow rate. Energy recovery is not required for the following situations:</p> <ul style="list-style-type: none"> <li>• Systems serving spaces that are not cooled and that are heated to less than 60°F.</li> <li>• Systems exhausting toxic, flammable, paint, or corrosive fumes or dust. This exception shall only be used if heat recovery is not used in the proposed design.</li> <li>• Commercial kitchen hoods used for collecting and removing grease vapors and smoke classified as Type 1 my NFPA 96. This exception shall only be used if heat recovery is not used in the proposed design.</li> <li>• Heating systems in climate zones 1 through 3</li> <li>• Cooling systems in climate zones 3c, 4c, 5b, 5c, 6b, 7 and 8</li> <li>• Where the largest source of air exhausted at a single location at the building exterior is less than 75% of the design outdoor air flow rate. This exception shall only be used if heat recovery is not used in the proposed design.</li> <li>• Systems requiring dehumidification that employ energy recovery in series with the cooling coil. This exception shall only be used if heat recovery is not used in the proposed design.</li> </ul>

**Enthalpy Recovery Ratio**

<i>Applicability</i>	Any system with outside air heat recovery
<i>Definition</i>	<p>The general effectiveness of an air-to-air heat exchanger as characterized by the reduction in heating or cooling load between the building exhaust and entering outside air streams. Enthalpy Recovery Ratio is defined as follows:</p>

$$ERRH = \frac{(OSAH - OSLAH)}{(OSAH - ELAH)} \quad (43)$$

Where:

- $ERR_H$  = The air-to-air heat exchanger enthalpy recovery
- $OSA_H$  = The total enthalpy of the outside air entering the exchanger
- $OSLA_H$  = The total enthalpy of the outside air leaving the heat exchanger
- $ELA_H$  = The total enthalpy of the exhaust air entering the heat exchanger

<i>Units</i>	Fraction (between 0 and 1)
<i>Input Restrictions</i>	As designed in accordance to the formula above
<i>Baseline Building</i>	The baseline would have 50% energy recovery effectiveness based on design conditions. Fifty percent energy recovery effectiveness shall mean a change in the enthalpy of the outdoor air supply equal to 50% of the difference between the outdoor air and return air enthalpies at design conditions.

**Exhaust Air Energy Recovery Economizer Interaction**

<i>Applicability</i>	Any system with outside air enthalpy heat recovery
<i>Definition</i>	Energy recovery control during economizer operation
<i>Units</i>	Lockout, no lockout
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Lockout. The baseline system should bypass the energy recovery device during economizer operation. Refer to Section 3.7.4 of this document for baseline economizer requirements. During economizer operation, parasitic losses of energy recovery device and fan energy impact of pressure drop through energy recovery device should not occur.

**Heat Exchanger Parasitic Energy**

<i>Applicability</i>	Systems that use heat recovery
<i>Definition</i>	This input is used to model electric power consumption by controls (transformers, relays, etc.) and/or a motor for a rotary heat exchanger. None of this electric power contributes thermal load to the supply or exhaust air streams.
<i>Units</i>	Watts (W)
<i>Input Restrictions</i>	As designed. A default of 50W is assumed which can be overridden by the user.
<i>Baseline Building</i>	50W

**Heat Exchanger Fan Energy Consumption**

<i>Applicability</i>	Systems that use heat recovery
<i>Definition</i>	The additional fan energy needed for the energy recovery device.  For all energy recovery ventilator (ERV) systems that include a bypass during economizer operations, the fan energy consumption for ERV systems should only be modeled when the ERV runs and should not be considered when the ERV is bypassed for economizer operation.
<i>Units</i>	Watts (W)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	The ERV fan power for the baseline system can be calculated as follows:

$$Bhp = [(0.6 \times OAcfm) + (0.6 \times 0.9 \times OAcfm)] / 4131$$

$$W = bhp \times 746/nm$$

This has been calculated from:

$$Bhp = [((2.2 \times HREFF) - dp_{oa}) \times OAcfm] / 4131 + [((2.2 \times HREFF \times E_f) - dp_{ex}) \times OAcfm] / 4131$$

Where:

$Bhp$  = Fan brake horse power

$HREFF$  = Heat exchanger effectiveness

$dp_{oa}$  = ERV pressure drop on the outdoor air side (is assumed to be 0.5 in. w.c.)

$dp_{ex}$  = ERV pressure drop on the exhaust air side (is assumed to be 0.5 in. w.c.)

$E_f$	=	Exhaust airflow fraction (exhaust airflow is 90% of outdoor airflow after considering leakage and zone exhaust)
$W$	=	Fan power
$nm$	=	Fan motor efficiency of supply fan. For EnergyPlus fan, energy for an ERV is not an input of the ERV module and the ERV fan energy should not simply be added to the system supply fan if the ERV includes a bypass during economizer operations as required in the baseline. The following workaround should be used instead. The fan energy associated with energy recovery is modeled as additional ERV parasitic power. This results in the ERV fan energy occurring only when the ERV runs, which is the desired behavior. If there is not a bypass in the proposed design, ERV fan energy shall be included in the HVAC system fan so that its impact is accounted for whenever the fans are running.

### 3.7.7 Humidity Controls and Devices

Humidity control, devices, and sources are not represented fully in many simulation program, but humidification and dehumidification can result in significant energy consumption. A simulation program should be chosen that most adequately represents the components, or has adequate workarounds implemented, or supplemental calculations employed to determine the associated energy use. These methods should be documented in the manner required for “exceptional calculations.”

#### 3.7.7.1 General

##### *Humidifier Type*

<i>Applicability</i>	Optional humidifier
<i>Definition</i>	The type of humidifier employed. Choices include: <ul style="list-style-type: none"> <li>• Hot water</li> <li>• Steam</li> <li>• Electric</li> <li>• Evaporative humidification</li> <li>• Adiabatic humidification</li> </ul>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	For systems serving zones where humidification is included in the proposed design, the baseline shall include the same humidifier type unless the proposed humidifier does not include automatic shutoff valves and insulated dispersion tubes meeting the requirements of 90.1-2019 Section 6.5.2.4. In that case, adiabatic humidification shall be used in the baseline. In either case, the baseline humidification system uses the same schedule and setpoints as the proposed building.

**Humidistat Maximum Setting**

<i>Applicability</i>	Systems with humidity control
<i>Definition</i>	The control setpoint for dehumidification
<i>Units</i>	Percent (%)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	If the proposed design HVAC system(s) have humidistatic controls, then the baseline building design shall use mechanical cooling for dehumidification and shall have reheat available to avoid overcooling. Systems serving computer rooms shall not have reheat for dehumidification. The reheat type shall be the same as the system heating type. Only 25% of the system reheat energy shall be included in the baseline building performance, when the baseline building doesn't comply with any of the exceptions listed below (Standard 90.1-2019 Section 6.5.2.3). The requirements and exceptions to the same are listed below-  Humidity controls shall prevent reheating, mixing of hot and cold airstreams, or other means of simultaneous heating and cooling of the same airstream.

## Exceptions :

1. The system is capable of and configured to reduce supply air volume to 50% or less of the design airflow rate or the minimum outdoor air ventilation rate specified in ASHRAE Standard 62.1 or other applicable federal, state, or local code or recognized standard, whichever is larger, before simultaneous heating and cooling takes place.
2. The individual fan cooling unit has a design cooling capacity of 65,000 Btu/h or less and is capable of and configured to unload to 50% capacity before simultaneous heating and cooling takes place.
3. The individual mechanical cooling unit has a design cooling capacity of 40,000 Btu/h or less. An individual mechanical cooling unit is a single system comprising a fan or fans and a cooling coil capable of providing mechanical cooling.
4. Systems serving spaces where specific humidity levels are required to satisfy process needs, such as vivariums; museums; surgical suites; pharmacies; and buildings with refrigerating systems, such as supermarkets, refrigerated warehouses, and ice arenas, and where the building includes site-recovered energy or site-solar energy that provide energy equal to at least 75% of the annual energy for reheating or for providing warm air in mixing systems. This exception does not apply to computer rooms.
5. At least 90% of the annual energy for reheating or for providing warm air in mixing systems is provided from site-recovered energy (including condenser heat) or site-solar energy.
6. Systems where the heat added to the airstream is the result of the use of a desiccant system, and 75% of the heat added by the desiccant system is removed by a heat exchanger, either before or after the desiccant system, with energy recovery.

**Humidistat Minimum Setting**

<i>Applicability</i>	Systems with humidity control
<i>Definition</i>	The control setpoint for dehumidification
<i>Units</i>	Percent (%)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Same as proposed

### 3.7.7.2 Desiccant

#### ***Desiccant Type***

<i>Applicability</i>	Systems with desiccant dehumidification
<i>Definition</i>	Describes the configuration of desiccant cooling equipment The following configurations for desiccant systems are allowed: <ul style="list-style-type: none"> <li>• A liquid desiccant dehumidifying unit</li> <li>• A liquid desiccant dehumidifying unit combined with a gas-fired absorption chiller</li> <li>• A solid desiccant dehumidifying unit</li> <li>• No desiccant – the default, which indicates that no desiccant system is present</li> </ul>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable

#### ***Desiccant Control Mode***

<i>Applicability</i>	Systems with desiccant dehumidification
<i>Definition</i>	The method of controlling the operation of the desiccant unit. For liquid-based systems this can be either: <ul style="list-style-type: none"> <li>• Dry-bulb: The desiccant unit is turned on whenever the outside air dry-bulb exceeds a set limit.</li> <li>• Evaporative cooling: Cycles the desiccant unit on when an evaporative cooler is on to maintain a dewpoint setpoint.</li> <li>• Dewpoint: Cycles the desiccant unit on and off to maintain the dewpoint temperature of the supply air.</li> </ul> For solid-based systems the following configurations are possible: <ul style="list-style-type: none"> <li>• Dehumidification only: The desiccant unit cycles on and off to maintain indoor humidity levels.</li> <li>• Sensible heat exchanger plus regeneration: The desiccant unit includes a sensible heat exchanger to precool the hot, dry air leaving the desiccant unit. The air leaving the exhaust side of the heat exchanger is directed to the desiccant unit.</li> <li>• Sensible heat exchanger: The desiccant unit includes a heat exchanger, but the air leaving the exhaust side of the heat exchanger is exhausted to the outdoors.</li> </ul>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable



**Desiccant Air Fraction**

<i>Applicability</i>	Systems with desiccant dehumidification
<i>Definition</i>	The fraction of the supply air that passes through the desiccant unit. Typically either the minimum outside air fraction or all of the air passes through the desiccant system.
<i>Units</i>	Fraction (between 0 and 1)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable

**Desiccant Heat Source**

<i>Applicability</i>	Systems with desiccant dehumidification
<i>Definition</i>	The source of heat that is used to dry out the desiccant. This can be either: <ul style="list-style-type: none"> <li>• Gas – hydronic: The regeneration heat load is met with a gas-fired heater.</li> <li>• Hot water: The heat load is met with hot water from the plant.</li> </ul>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable

**Liquid Desiccant Performance Curves**

*Applicability* Systems with liquid-based desiccant dehumidification

*Definition* A set of performance curves apply to liquid desiccant systems:

$$DESC - T - FTW = a + b \times T + c \times T^2 + d \times w + e \times w^2 + f \times T \times w \quad (44)$$

$$DESC - W - FTW = a + b \times T + c \times T^2 + d \times w + e \times w^2 + f \times T \times w \quad (45)$$

$$DESC - Gas - FTW = a + b \times T + c \times T^2 + d \times w + e \times w^2 + f \times T \times w \quad (46)$$

$$DESC - kW - FTW = a + b \times T + c \times T^2 + d \times w + e \times w^2 + f \times T \times w \quad (47)$$

Where:

$DESC-T-FTW$  = Temperature leaving desiccant unit

$DESC-W-FTW$  = Humidity ratio leaving desiccant unit

$DESC-Gas-FTW$  = Gas usage of desiccant unit

$DESC-kW-FTW$  = Electric usage of desiccant unit

$T$  = Entering air temperature

$w$  = Entering humidity ratio

Table 78. Liquid Desiccant Unit Performance Curves

Coefficient	DESC-T-FTW	DESC-W-FTW	DESC-Gas-FTW	DESC-kW-FTW
a	11.5334997	11.8993998	58745.8007813	3.5179000
b	0.6586730	-0.2695580	-1134.4899902	-0.0059317
c	-0.0010280	0.0044549	-3.6676099	0.0000000
d	0.2950410	0.0830525	3874.5900879	0.0040401
e	-0.0001700	0.0006974	-1.6962700	0.0000000
f	-0.0008724	0.0015879	-13.0732002	0.0000000

Source: COMNET 2017

<i>Units</i>	Data structure
<i>Input Restrictions</i>	As designed, default to values in Table 78
<i>Baseline Building</i>	Not applicable

#### ***Desiccant Dewpoint Temperature Setpoint***

<i>Applicability</i>	Systems with desiccant dehumidification
<i>Definition</i>	The setpoint dewpoint temperature of the air leaving the desiccant system
<i>Units</i>	Degrees Fahrenheit (°F)
<i>Input Restrictions</i>	As designed. Defaults to 50°F.
<i>Baseline Building</i>	Not applicable

#### ***Desiccant Heat Exchanger Effectiveness***

<i>Applicability</i>	Systems with desiccant dehumidification
<i>Definition</i>	The effectiveness of a sensible heat exchanger used with a desiccant system
<i>Units</i>	Fraction (between 0 and 1)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable

#### ***Desiccant Heat Exchanger Pressure Drop***

<i>Applicability</i>	Systems with desiccant dehumidification
<i>Definition</i>	The pressure drop across a sensible heat exchanger used with a desiccant system
<i>Units</i>	in. H <sub>2</sub> O
<i>Input Restrictions</i>	As designed. Defaults to 1.0 in. H <sub>2</sub> O.
<i>Baseline Building</i>	Not applicable

### **3.8 HVAC Primary Systems**

This section covers the building descriptors for the primary HVAC systems. The baseline building HVAC system may or may not have a primary system. See Table 3.8-1 for a summary of the properties of the baseline building primary system. More detail is provided in subsequent sections.

Table 79. Summary of Baseline Primary HVAC Properties

System	Cooling Primary System Applicability	Heating Primary System Applicability
1 PTAC		✓
2 PTHP		
3 PSZ-AC		
4 PSZ-HP		
5 PVAV		✓
6 PVAV / PFP		
7 VAV	✓	✓
8 VAV / PFP	✓	
9 HV Furnace		
10 HV Electric		
11 SZ-VAV	✓	✓
12 SZ-CV-HW	✓	✓
13 SZ-CV-ER	✓	

### 3.8.1 Boilers

#### **Boiler Name**

<i>Applicability</i>	All boilers
<i>Definition</i>	A unique descriptor for each boiler, heat pump, central heating heat-exchanger, or heat recovery device
<i>Units</i>	None
<i>Input Restrictions</i>	User entry
<i>Baseline Building</i>	Boilers are only designated in the baseline model if the baseline system is of type 1 (PTAC), type 5 (Packages VAV with reheat) or type 7 (VAV with reheat) and system 11 for climate zones 3B to 8 and system 12

#### **Boiler Fuel**

<i>Applicability</i>	All boilers
<i>Definition</i>	The fuel source for the central heating equipment. The choices are: <ul style="list-style-type: none"> <li>• Gas</li> <li>• Oil</li> <li>• Electricity</li> </ul>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Buildings located in climate zones 3B, 3C and 4 through 8 shall use hot-water fossil fuel boilers. Boilers are not used for the baseline HVAC system for climate zones 0 to 3A.  For fossil fuel systems where natural gas is not available for the proposed building site as determined by the rating authority, the baseline HVAC systems shall be modeled using propane as their fuel.

**Boiler Type**

<i>Applicability</i>	All boilers
<i>Definition</i>	The boiler type. Choices include: <ul style="list-style-type: none"> <li>• Steam boiler</li> <li>• Hot water boiler</li> <li>• Heat-pump water heater</li> </ul>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	The boiler type will be a hot water boiler for baseline systems 1, 5, 7, 11, and 12. All other baseline system types do not have a boiler

**Boiler Draft Type**

<i>Applicability</i>	All boilers
<i>Definition</i>	How combustion airflow is drawn through the boiler. Choices are: <ul style="list-style-type: none"> <li>• Natural (sometimes called atmospheric)</li> <li>• Mechanical</li> </ul> <p>Natural draft boilers use natural convection to draw air for combustion through the boiler. Natural draft boilers are subject to outside air conditions and the temperature of the flue gases.</p> <p>Mechanical draft boilers enhance the airflow in one of three ways: 1) induced draft, which uses ambient air, a steam jet, or a fan to induce a negative pressure that pulls flow through the exhaust stack; 2) forced draft, which uses a fan and ductwork to create a positive pressure that forces air into the furnace; or 3) balanced draft, which uses both induced draft and forced draft methods to bring air through the furnace, usually keeping the pressure slightly below atmospheric.</p>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed. Default is natural draft.
<i>Baseline Building</i>	The boiler for the baseline system shall be natural draft boiler

**Number of Identical Boiler Units**

<i>Applicability</i>	All boilers
<i>Definition</i>	The number of identical units for staging
<i>Units</i>	Numeric: integer
<i>Input Restrictions</i>	As designed. Default is 1.
<i>Baseline Building</i>	The baseline building shall have one boiler when the baseline plant serves a conditioned floor area of 15,000 ft <sup>2</sup> or less, and have two equally size boilers for plants serving more than 15,000 ft <sup>2</sup>

**Boiler Heat Loss**

<i>Applicability</i>	All boilers
<i>Definition</i>	The boiler or heat-exchanger heat loss expressed as a percentage of full load output capacity. This loss only occurs when the boiler is firing.
<i>Units</i>	Percent (%)
<i>Input Restrictions</i>	Default is 2% for electric boilers and heat-exchangers and 0% for fuel-fired boilers. If the user overrides the default, supporting documentation is required.
<i>Baseline Building</i>	<p>Prescribed at 2% for electric boilers and heat-exchangers. Prescribed at 0% for fuel-fired boilers, since this loss is already incorporated into the overall thermal efficiency, or AFUE of the boiler.</p> <p>For boilers with efficiency rating prescribed as combustion efficiency, 2% jacket losses will be assumed. Hence:</p> $Et = Ec - 2\%$ <p>Where:</p> <p><i>Et</i> = Thermal efficiency</p> <p><i>Ec</i> = Combustion efficiency</p>

**Boiler Design Capacity**

<i>Applicability</i>	All boilers
<i>Definition</i>	The heating capacity at design conditions
<i>Units</i>	Btu/h
<i>Input Restrictions</i>	UMLH shall not exceed 300. If they do, the proposed boiler capacity shall be increased incrementally until the unmet loads are reduced to 300 or less.
<i>Baseline Building</i>	Autosized, with a heating oversizing factor of 25%. Sizing calculations shall be based on the heating design day and cooling design day conditions, as defined in Section 3.2.3 of this document. Oversizing would be carried out at zone level where the sizing parameters would be applied to the zone design heating loads, but not the airflow rates. Refer to Section 2.7.2 of this document for more details. If the number of UMLH for the baseline exceeds 300, heating coil capacity may need to be increased along with system airflow as described in Section 2.7.2 of this document.

**Boiler Efficiency Type**

<i>Applicability</i>	All boilers
<i>Definition</i>	The full load efficiency of a boiler is expressed as one of the following: <ul style="list-style-type: none"> <li>• Annual fuel utilization efficiency (AFUE) is a measure of the boiler’s efficiency over a predefined heating season.</li> <li>• Thermal efficiency (Et) is the ratio of the heat transferred to the water divided by the heat input of the fuel.</li> <li>• Combustion efficiency (Ec) is the measure of how much energy is extracted from the fuel and is the ratio of heat transferred to the combustion air divided by the heat input of the fuel.</li> </ul>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	AFUE for all gas and oil-fired boilers with less than 300,000 Btu/h capacity Et for all gas and oil-fired boilers with capacities between 300,000 and 2,500,000 Btu/h Ec for all gas and oil-fired boilers with capacities above 2,500,000 Btu/h
<i>Baseline Building</i>	Same efficiency type relationship with capacity as described for proposed design

**Boiler Efficiency**

<i>Applicability</i>	All boilers
<i>Definition</i>	The full load efficiency of a boiler at rated conditions (see efficiency type above) expressed as a dimensionless ratio of output over input. The software must accommodate input in either thermal efficiency (Et), combustion efficiency (Ec), or annual fuel utilization efficiency (AFUE).  Where AFUE is provided, Et shall be calculated as follows: $\begin{aligned} &1) 75\% \leq AFUE < 80\% \\ &E_t = 0.1 \times AFUE + 72.5\% \\ &2) 80\% \leq AFUE \leq 100\% \\ &E_t = 0.875 \times AFUE + 10.5\% \end{aligned} \tag{48}$ Where Ec is provided, Et shall be calculated as follows: $E_t = E_c - 2\% \tag{49}$ All electric boilers will have an efficiency of 100%. For applicable software, heat input ratio shall be defined as the inverse of thermal efficiency.
<i>Units</i>	Ratio
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Boilers for the baseline design are assumed to have the minimum efficiency as listed below (Standard 90.1-2019 Table G3.5.6)-

Size	Minimum Efficiency	Test Procedure
<300,000 Btu/h	80% AFUE	DOE 10 CFR Part 430
≥300,000 Btu/h and ≤2,500,000 Btu/h	75% Et	DOE 10 CFR Part 431
>2,500,000 Btu/h	80% Ec	

**Boiler Part-Load Performance Curve**

<i>Applicability</i>	All boilers
<i>Definition</i>	An adjustment factor that represents the percentage full load fuel consumption as a function of the percentage full load capacity. This curve shall take the form of a quadratic equation as follows:
	$Fuel_{partload} = Fuel_{design} \times FHeatPLC(Q_{partload}, Q_{rated}) \quad (50)$ $FHeatPLC = \left( a + b \times \frac{Q_{partload}}{Q_{rated}} + c \times \left( \frac{Q_{partload}}{Q_{rated}} \right)^2 \right)$
	Where
	<i>FHeatPLC</i> = The fuel heating part load efficiency curve
	<i>Fuel<sub>partload</sub></i> = The fuel consumption at part load conditions (Btu/h)
	<i>Fuel<sub>design</sub></i> = The fuel consumption at design conditions (Btu/h)
	<i>Q<sub>partload</sub></i> = The boiler capacity at part load conditions (Btu/h)
	<i>Q<sub>rated</sub></i> = The boiler capacity at design conditions (Btu/h)
	<i>a</i> = Constant, 0.082597
	<i>b</i> = Constant, 0.996764
	<i>c</i> = Constant, -0.079361
<i>Units</i>	Ratio
<i>Input Restrictions</i>	As designed. Supporting documentation is required for use of different curves. Default part load performance curves provided in COMNET Appendix H (COMNET 2017) can be used based on draft type.
<i>Baseline Building</i>	The baseline building uses natural draft curve specified in Equation (50) above

**Boiler Forced Draft Fan Power**

<i>Applicability</i>	All mechanical draft boilers
<i>Definition</i>	The minimum unloading ratio is where the boiler capacity can no longer be reduced by unloading and must be false loaded to meet smaller heating loads. The minimum unloading capacity of a boiler expressed as a percentage of the rated capacity. Below this level the boiler must cycle to meet the load.
<i>Units</i>	Horsepower
<i>Input Restrictions</i>	As designed
	The software shall convert the user entry of motor HP to fan power in watts by the following equation:
	$\text{Fan Power (W)} = \text{Motor HP} \times 746 \times 0.5$
<i>Baseline Building</i>	Not applicable

**Boiler Minimum Unloading Ratio**

<i>Applicability</i>	All boilers
<i>Definition</i>	The minimum unloading capacity of a boiler expressed as a percentage of the rated capacity. Below this level the boiler must cycle to meet the load.

Table 80. Default Minimum Unloading Ratios

Boiler Type	Default Unloading Ratio
Electric Steam	1%
Electric Hot Water	1%
Fuel-Fired Steam	25%
Fuel-Fired Hot Water	25%

<i>Units</i>	Percent (%)
<i>Input Restrictions</i>	As designed. If the user does not use the default value, the software must indicate that supporting documentation is required on the output forms.
<i>Baseline Building</i>	Use Table 80

**Boiler Minimum Flow Rate**

<i>Applicability</i>	All boilers
<i>Definition</i>	The minimum flow rate recommended by the boiler manufacturer for stable and reliable operation of the boiler
<i>Units</i>	gpm
<i>Input Restrictions</i>	As designed  If the boiler(s) is piped in a primary only configuration in a variable flow system, then the software shall assume there is a minimum flow bypass valve that allows the HW pump to bypass water from the boiler outlet back to the boiler inlet to maintain the minimum flow rate when boiler is enabled. Note that the boiler entering water temperature must accurately reflect the mixed temperature (colder water returning from the coil(s) and hotter bypass water) in order to accurately model boiler efficiency as a function of boiler entering water temperature.
<i>Baseline Building</i>	25% of design flow rate. Pumping configuration as described in Section 3.8.5.

**Hot Water Supply Temperature**

<i>Applicability</i>	All boilers
<i>Definition</i>	The temperature of the water produced by the boiler and supplied to the hot water loop
<i>Units</i>	Degrees Fahrenheit (°F)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Use 180°F for baseline boiler



**Hot Water Return Temperature**

<i>Applicability</i>	All boilers
<i>Definition</i>	The temperature of the water returning to the boiler from the hot water loop
<i>Units</i>	Degrees Fahrenheit (°F)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Use 130°F for baseline boiler design

**Hot Water Supply Temperature Reset**

<i>Applicability</i>	All boilers
<i>Definition</i>	Variation of the hot water supply temperature with OAT
<i>Units</i>	Degrees Fahrenheit (°F)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	The hot water supply temperature should vary according to the following: <ul style="list-style-type: none"> <li>• 180°F when outside air is &lt; 20°F</li> <li>• ramp linearly between 180°F and 150°F when outdoor air is between 20°F and 50°F</li> <li>• 150°F when outdoor air is &gt; 50°F</li> </ul>

**3.8.2 Chillers****Chiller Name**

<i>Applicability</i>	All chillers
<i>Definition</i>	Unique descriptor for each chiller
<i>Units</i>	Text, unique
<i>Input Restrictions</i>	User entry. Where applicable, this should match the tags that are used on the plans.
<i>Baseline Building</i>	Chillers are only designated when the baseline system is of type 7 (VAV with reheat), 8 (VAV with PFP boxes) 11, 12, and 13

**Chiller Type**

<i>Applicability</i>	All chillers
<i>Definition</i>	<p>The type of chiller, either a vapor-compression chiller or an absorption chiller.</p> <p>Vapor compression chillers operate on the reverse-Rankine cycle, using mechanical energy to compress the refrigerant, and include:</p> <ul style="list-style-type: none"> <li>• Positive displacement: Includes reciprocating (piston-style), scroll and screw compressors.</li> <li>• Centrifugal: Uses rotating impeller blades to compress the refrigerant and impart velocity.</li> <li>• Single effect absorption: Uses a single generator and condenser.</li> <li>• Double effect absorption: Uses two generators/concentrators and condensers, one at a lower temperature and the other at a higher temperature. It is more efficient than the single effect, but it must use a higher temperature heat source.</li> <li>• Double effect absorption, indirect-fired.</li> <li>• Gas engine driven chiller.</li> <li>• Positive displacement: Includes reciprocating (piston-style), scroll and screw compressors.</li> </ul>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	The baseline building will use electric chillers regardless of the cooling energy source. The baseline building chiller is based on the baseline building peak cooling load, as follows:

Table 81. Type and Number of Chillers

Building Peak Cooling Load	Number and Type of Chiller(s)
<= 300 tons	1 water cooled screw chiller
>300 tons, < 600 tons	2 water cooled screw chillers, sized equally
>= 600 tons	A minimum of two (2) water cooled centrifugal chillers, sized to keep the unit size below 800 tons, all sized equally.

**Number of Identical Chiller Units**

<i>Applicability</i>	All chillers
<i>Definition</i>	The number of identical units for staging
<i>Units</i>	None
<i>Input Restrictions</i>	As designed. Default is 1.
<i>Baseline Building</i>	From Table 81 above, there is one chiller if the baseline system cooling load is 300 tons or less and two equally sized chillers for baseline system loads between 300 and 600 tons. For loads above 600 tons, two or more chillers of equal size are used, with no chiller larger than 800 tons.

**Chiller Fuel**

- Applicability* All chillers
- Definition* The fuel source for the chiller. The choices are:
  - Electricity (for all vapor-compression chillers)
  - Gas (absorption units only, designated as direct-fired units)
  - Oil (absorption units only, designated as direct-fired units)
  - Hot Water (absorption units only, designated as indirect-fired units)
  - Steam (absorption units only, designated as indirect-fired units)
- Units* List (see above)
- Input Restrictions* As designed  
This input is restricted, based on the choice of chiller type, according to the following rules:

	Electricity	Gas	Hot Water	Steam
Reciprocating	Allowed			
Scroll	Allowed			
Screw	Allowed			
Centrifugal	Allowed			
Single effect absorption		Allowed	Allowed	Allowed
Direct fired double effect absorption		Allowed	Allowed	Allowed
Indirect fired absorption		Allowed	Allowed	Allowed

*Baseline Building* Electricity

**Chiller Capacity**

- Applicability* All chillers
- Definition* The cooling capacity of a chiller at rated conditions
- Units* Btu/h or tons
- Input Restrictions* As designed. If UMLH are greater than 300, the chiller may have to be made larger.
- Baseline Building* The zone loads and airflow rates are oversized by 15% and the chiller is sized to the sum of the individual oversized zone peak loads. The zones shall be sized using weather files containing 1% dry-bulb and 1% wet-bulb cooling design temperatures. Section 3.2.3 has more details regarding design day data to be used for equipment sizing.

**Chiller Rated Efficiency**

<i>Applicability</i>	All chillers
<i>Definition</i>	The efficiency of the chiller: EER for air cooled chillers, kW/ton for water cooled, positive displacement chillers, and COP for fuel-fired and heat driven chillers at ARI 550/590 rated full-load conditions. The test conditions for the full load (FL) rating are summarized below: <ul style="list-style-type: none"> <li>• 44°F leaving chilled-fluid temperature</li> <li>• 2.4 gpm/ton evaporator fluid flow</li> <li>• 85°F entering condenser-fluid temperature</li> <li>• 3.0 gpm/ton condenser-fluid flow</li> </ul>
<i>Units</i>	Ratio (kW/ton, EER, or COP based on chiller type and condenser type)
<i>Input Restrictions</i>	As designed. Must meet the minimum requirements of Table 6.8.1C of Standard 90.1-2019.
<i>Baseline Building</i>	Use the minimum efficiency requirements EER or kW/ton values from Table 82 (Standard 90.1-2019 Table G3.5.3).

Table 82. Minimum Efficiency Requirements for Water Chilling Packages

	Size Category	Sub Category	Minimum Efficiency	Test Procedure
Water cooled, Electrically Operated, Positive Displacement (rotary screw and scroll)	<150 tons	kW/ton	0.790 FL 0.676 IPLV.IP	ARI 550/590
	≥150 tons and <300 tons	kW/ton	0.718 FL 0.629 IPLV.IP	
	≥300 tons	kW/ton	0.639 FL 0.572 IPLV.IP	
	Allowed		0.703 FL 0.670 IPLV.IP	
Water cooled, Electrically Operated, Centrifugal	<150 tons	kW/ton	0.634 FL 0.596 IPLV.IP	ARI 550/590
	≥150 tons and <300 tons	kW/ton	0.576 FL 0.549 IPLV.IP	
	≥300 tons	kW/ton	0.549 IPLV.IP	

FL= Full Load; IPLV = Integrated Part Load Value

**Integrated Part Load Value**

<i>Applicability</i>	All chillers
<i>Definition</i>	The part-load efficiency of a chiller developed from a weighted average of four rating conditions, according to AHRI Standard 550
<i>Units</i>	Ratio (kW/ton, COP, or EER, depending on chiller type and condenser type) Water cooled electric chiller: kW/ton Air cooled or evaporatively cooled electric chiller: EER All non-electric chillers: COP
<i>Input Restrictions</i>	As designed. Must meet the minimum requirements of Table 6.8.1C of Standard 90.1-2019.
<i>Baseline Building</i>	The baseline building is analyzed with the minimum full load efficiency as specified in Table 82. The IPLV is calculated by the simulation software according to ANSI/AHRI Standard 550/590 based on the full load efficiency and the performance curves.

**Chiller Minimum Unloading Ratio**

<i>Applicability</i>	All chillers
<i>Definition</i>	The minimum unloading capacity of a chiller expressed as a fraction of the rated capacity. Below this level the chiller must cycle to meet the load.

Table 83. Default Minimum Unloading Ratios

Chiller Type	Default Unloading Ratio
Reciprocating	25%
Screw	15%
Centrifugal	10%
Scroll	25%
Single Effect Absorption	10%
Double Effect Absorption	10%

<i>Units</i>	Percent (%)
<i>Input Restrictions</i>	As designed. If the user does not employ the default values, supporting documentation is required.
<i>Baseline Building</i>	Same as proposed (if the proposed includes a chiller). Else, use defaults listed above.

### Chiller Minimum Part Load Ratio

<i>Applicability</i>	All chillers
<i>Definition</i>	The minimum unloading capacity of a chiller expressed as a fraction of the rated capacity. Below this level the chiller must cycle to meet the load. If the chiller minimum part-load ratio (PLR) is less than the chiller minimum unloading ratio, then the software shall assume hot-gas bypass operation between the minimum PLR and the minimum unloading ratio. Standard 90.1-2019 Section 6.5.9 specifies a limit for maximum hot-gas bypass as a percentage of the total cooling capacity of the cooling system. The difference between the maximum unloading ratio and minimum part load ratio cannot exceed this limit for hot gas bypass operation.
<i>Units</i>	Percent (%)
<i>Input Restrictions</i>	As designed, but constrained to a minimum value of 10%. If the user does not employ the default values, supporting documentation is required.
<i>Baseline Building</i>	When the baseline design has a screw chiller, the minimum part load ratio is 15%. When the baseline design has a centrifugal chiller, the minimum part load ratio is 10%.

### Chiller Cooling Capacity Adjustment Curve

<i>Applicability</i>	All chillers
<i>Definition</i>	A curve or group of curves or other functions that represent the available total cooling capacity as a function of evaporator and condenser conditions and perhaps other operating conditions. The default curves are given as follows:

$$Q_{available} = CAP_{FT} \times Q_{rated} \tag{51}$$

For air cooled chillers:

$$CAP_{FT} = a + b \times t_{chws} + c \times t_{chws}^2 + d \times t_{odb} + e \times t_{odb}^2 + f \times t_{chws} \times t_{odb} \tag{52}$$

For water cooled chillers:

$$CAP_{FT} = a + b \times t_{chws} + c \times t_{chws}^2 + d \times t_{cws} + e \times t_{cws}^2 + f \times t_{chws} \times t_{cws} \tag{53}$$

Where:

$Q_{available}$  = Available cooling capacity at present evaporator and condenser conditions (MBH)

$t_{chws}$  = The chilled water supply temperature (°F)

$t_{cws}$  = The condenser water supply temperature (°F)

$t_{odb}$  = The outside air dry-bulb temperature (°F)

$Q_{rated}$  = Rated capacity at ARI conditions (MBH)

Note: If an air cooled unit employs an evaporative condenser,  $t_{odb}$  is the effective dry-bulb temperature of the air leaving the evaporative cooling unit.

Separate curves are provided for Path A and Path B chillers in COMNET Appendix H (COMNET 2017).

Table 84. Default Capacity Coefficients – Electric Air Cooled Chillers

Coefficient	Scroll	Recip	Screw	Centrifugal
a	0.40070684	0.57617295	-0.09464899	N/A
b	0.01861548	0.02063133	0.03834070	N/A
c	0.00007199	0.00007769	-0.00009205	N/A
d	0.00177296	-0.00351183	0.00378007	N/A
e	-0.00002014	0.00000312	-0.00001375	N/A
f	-0.00008273	-0.00007865	-0.00015464	N/A
Tchws	Min = 40°F, Max = 54°F	Min = 40°F, Max = 54°F	Min = 40°F, Max = 54°F	NA
Todb	Min = 40°F, Max = 115°F	Min = 40°F, Max = 115°F	Min = 40°F, Max = 115°F	NA

Table 85. Default Capacity Coefficients – Electric Water Cooled Chillers

Coefficient	Recip	Screw	Scroll	Centrifugal
a	0.36131454	0.58531422	0.33269598	-0.29861976
b	0.01855477	0.01539593	0.00729116	0.02996076
c	0.00003011	0.00007296	-0.00049938	-0.00080125
d	0.00093592	-0.00212462	0.01598983	0.01736268
e	-0.00001518	-0.00000715	-0.00028254	-0.00032606
f	-0.00005481	-0.00004597	0.00052346	0.00063139
Tchws	Min = 40°F, Max = 54°F	Min = 40°F, Max = 54°F	Min = 40°F, Max = 54°F	Min = 40°F, Max = 54°F
Tcws	Min = 60°F, Max = 85°F	Min = 60°F, Max = 85°F	Min = 60°F, Max = 85°F	Min = 60°F, Max = 85°F

Table 86. Default Capacity Coefficients – Fuel- and Steam-Source Water Cooled Chillers

Coefficient	Single Stage Absorption	Double Stage Absorption	Direct-Fired Absorption	Engine Driven Chiller
A	0.723412	-0.816039	1.000000	0.573597
B	0.079006	-0.038707	0.000000	0.0186802
C	-0.000897	0.000450	0.000000	0.000000
D	-0.025285	0.071491	0.000000	-0.00465325
E	-0.000048	-0.000636	0.000000	0.000000
F	0.000276	0.000312	0.000000	0.000000

Source: COMNET 2017

<i>Units</i>	Data structure
<i>Input Restrictions</i>	The user may input curves or use default curves. If the default curves are overridden, supporting documentation is required.
<i>Baseline Building</i>	Use default curve

Applicability

All chillers

PNNL-29674

Definition

A curve or group of curves that varies the cooling efficiency of an electric chiller as a function of evaporator conditions, condenser conditions, and part-load ratio. Note that for variable-speed chillers, the part-load cooling efficiency curve is a function of both part-load ratio and leaving condenser water temperature. The default curves are given as follows:

$$PLR = \frac{Q_{operating}}{Q_{available}(t_{chws}, t_{cws/odb})} \tag{54}$$

$$EIR_{FPLR} = a + b \times PLR + c \times PLR^2$$

variable-speed

$$EIR_{FPLR} = a + b \times PLR + c \times PLR^2 + d \times t_{cws} + e \times t_{cws}^2 + f \times PLR \cdot t_{cws} + g \times PLR^3 + h \times t_{cws}^3 + i \times PLR^2 \cdot t_{cws} + j \times t_{cws}^2 \cdot PLR$$

Air-Cooled:

$$EIR_{FT} = a + b \times t_{chws} + c \times t_{chws}^2 + d \times t_{odb} + e \times t_{odb}^2 + f \times t_{chws} \times t_{odb}$$

Water-Cooled :

$$EIR_{FT} = a + b \times t_{chws} + c \times t_{chws}^2 + d \times t_{cws} + e \times t_{cws}^2 + f \times t_{chws} \times t_{cws}$$

$$P_{operating} = P_{rated} \times EIR_{FPLR} \times EIR_{FT} \times CAP_{FT}$$

Source: PRM-RM 2010Where:

- $PLR$  = Part load ratio based on available capacity (not rated capacity)
- $Q_{operating}$  = Present load on chiller (Btu/h)
- $Q_{available}$  = Chiller available capacity at present evaporator and condenser conditions (Btu/h)
- $t_{chws}$  = The chilled water supply temperature (°F)
- $t_{cws}$  = The condenser water supply temperature (°F)
- $t_{odb}$  = The outside air dry-bulb temperature (°F)
- $P_{rated}$  = Rated power draw at ARI conditions (kW)
- $P_{operating}$  = Power draw at specified operating conditions (kW)

Note: If an air cooled chiller employs an evaporative condenser,  $t_{odb}$  is the effective dry-bulb temperature of the air leaving the evaporative cooling unit.

Table 87. Default Efficiency EIR-FT Coefficients – Air Cooled Chillers

Coefficient	Scroll	Reciprocating	Screw	Centrifugal
a	0.99006553	0.66534403	0.13545636	N/A
b	-0.00584144	-0.01383821	0.02292946	N/A
c	0.00016454	0.00014736	-0.00016107	N/A
d	-0.00661136	0.00712808	-0.00235396	N/A
e	0.00016808	0.00004571	0.00012991	N/A
f	-0.00022501	-0.00010326	-0.00018685	N/A
Tchws	Min = 40°F, Max = 54°F	Min = 40°F, Max = 54°F	Min = 40°F, Max = 54°F	NA
Todb	Min = 40°F, Max = 115°F	Min = 40°F, Max = 115°F	Min = 40°F, Max = 115°F	NA



Table 88. Default Efficiency EIR-FT Coefficients – Water Cooled Chillers

Coefficient	Scroll	Reciprocating	Screw	Centrifugal
a	1.00121431	0.46140041	0.66625403	0.51777196
b	-0.01026981	-0.00882156	0.00068584	-0.00400363
c	0.00016703	0.00008223	0.00028498	0.00002028
d	-0.00128136	0.00926607	-0.00341677	0.00698793
e	0.00014613	0.00005722	0.00025484	0.00008290
f	-0.00021959	-0.00011594	-0.00048195	-0.00015467

Table 89. Default Efficiency EIR-FPLR Coefficients – Air Cooled Chillers

Coefficient	Scroll	Reciprocating	Screw	Centrifugal
a	0.06369119	0.11443742	0.03648722	N/A
b	0.58488832	0.54593340	0.73474298	N/A
c	0.35280274	0.34229861	0.21994748	N/A

Table 90. Default Efficiency EIR-FPLR Coefficients – Water Cooled Chillers

Coefficient	Scroll	Reciprocating	Screw	Centrifugal
a	0.04411957	0.08144133	0.33018833	0.17149273
b	0.64036703	0.41927141	0.23554291	0.58820208
c	0.31955532	0.49939604	0.46070828	0.23737257

Source: COMNET 2017

<i>Units</i>	Data structure
<i>Input Restrictions</i>	User may input curves or use default curves. If defaults are overridden, supporting documentation is required.
<i>Baseline Building</i>	Use default curve

**Chilled Water Supply Temperature**

<i>Applicability</i>	All chillers
<i>Definition</i>	The chilled water supply temperature of the chiller at design conditions
<i>Units</i>	Degrees Fahrenheit (°F)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	The baseline chilled water supply temperature is set to 44°F

**Chilled Water Return Temperature**

<i>Applicability</i>	All chillers
<i>Definition</i>	The chilled water return temperature setpoint
<i>Units</i>	Degrees Fahrenheit (°F)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	The baseline chilled water return temperature is set to 56°F

**Chilled Water Supply Temperature Control Type**

<i>Applicability</i>	All chillers
<i>Definition</i>	The method by which the chilled water setpoint temperature is reset. The chilled water setpoint may be reset based on demand or OAT.
<i>Units</i>	List
<i>Input Restrictions</i>	None, can be either “outside air-based reset” or “demand-based reset”
<i>Baseline Building</i>	Outside air based reset

**Chilled Water Supply Temperature Reset**

<i>Applicability</i>	All chillers
<i>Definition</i>	The reset schedule for the chilled water supply temperature. The chilled water setpoint may be reset based on demand or OAT.
<i>Units</i>	Degrees Fahrenheit (°F)
<i>Input Restrictions</i>	As designed. The default is as shown in the figure below.
<i>Baseline Building</i>	The baseline chilled water supply temperature is reset from 44°F to 54°F based on OAT as shown in the figure below.

The figure depicts a linear reset schedule that represents the chilled water setpoint as a function of outdoor air dry-bulb temperature. This schedule is defined by the following data points:

- 44°F at OAT 80°F and above
- 54°F at OAT 60°F and below
- Ramped linearly between 44°F and 54°F at temperatures between 80°F and 60°F

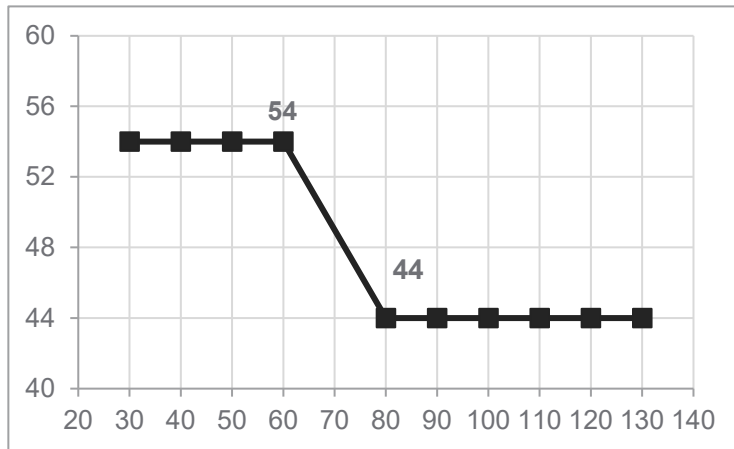


Figure 11. Chilled Water Supply Temperature Reset Schedule

**Air Cooled Condenser Power**

<i>Applicability</i>	All chillers with air cooled condensers where fan energy is not part of the COP
<i>Definition</i>	The energy usage of the condenser fan(s) at design conditions on an air cooled chiller. This unit should only be used for chillers composed of separate evaporator and condenser sections where the fan energy is not part of the chiller COP.
<i>Units</i>	Kilowatts (kW)
<i>Input Restrictions</i>	As designed. The user must enter data for remote air cooled condensing units.
<i>Baseline Building</i>	Not applicable, since all baseline chillers have water cooled condensers

**3.8.3 Cooling Towers**

Baseline building systems 7, 8, and 11 through 13, have one or more cooling towers. One tower is assumed to be matched to each baseline building chiller. Each baseline building chiller has its own condenser water pump that operates when the chiller is brought into service. The range between the condenser water return (CWR) and condenser water supply (CWS) is 10°F so that condenser water flow is a constant 2.5 gpm per cooling ton.<sup>1</sup> The baseline building pumping energy is assumed to be 19 W/gpm. The baseline building cooling tower is assumed to have a variable speed fan that is controlled to provide a CWS equal to 70°F when weather permits. The tower fan would operate to maintain a CWS of 70 °F at low wet-bulb conditions. Under cooling conditions closer to design conditions, the CWS floats up to a maximum of 85 °F (the design condition).

The baseline building condenser water design supply temperature shall be calculated using the cooling tower approach to the 0.4% evaporation design wet-bulb temperature as generated by the formula below, with a design temperature rise of 10°F.

$$\text{Approach } 10^{\circ}\text{F Range} = 25.72 - (0.24 \times \text{WB})$$

where WB is the 0.4% evaporation design wet-bulb temperature in °F; valid for wet bulbs from 55°F to 90°F.

The tower shall be controlled to maintain a leaving water temperature based on climate zone (see below), floating up to the design leaving water temperature for the cooling tower.

Climate Zone	Leaving Water Temperature
5B, 5C, 6B, 8	65°F
0B, 1B, 2B, 3B, 3C, 4B, 4C, 5A, 6A, 7	70°F
3A,4A	75°F
0A, 1A, 2A	80°F

<sup>1</sup> Cooling capacity is related to flow and delta-T through the equation  $Q = 500 * \text{GPM} * \text{Delta-T}$ . When Q is one ton (12,000 Btu/h),  $\text{GPM} = 24 / \text{Delta-T}$  and  $\text{Delta-T} = 24 / \text{GPM}$

**Cooling Tower Name**

<i>Applicability</i>	All cooling towers
<i>Definition</i>	A unique descriptor for each cooling tower
<i>Units</i>	Text, unique
<i>Input Restrictions</i>	User entry. Where applicable, this should match the tags that are used on the plans.
<i>Baseline Building</i>	Descriptive name that keys the baseline building plant

**Cooling Tower Type**

<i>Applicability</i>	All cooling towers
<i>Definition</i>	<p>The type of cooling tower employed. The choices are:</p> <ul style="list-style-type: none"> <li>• Open tower, centrifugal fan</li> <li>• Open tower, axial fan</li> <li>• Closed tower, centrifugal fan</li> <li>• Closed tower, axial fan</li> </ul> <p>Open cooling towers collect the cooled water from the tower and pump it directly back to the cooling system. Closed towers circulate the evaporated water over a heat exchanger to indirectly cool the system fluid.</p>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	The baseline cooling tower is an open tower axial fan device with a two speed fan

**Cooling Tower Capacity**

<i>Applicability</i>	All cooling towers
<i>Definition</i>	The tower thermal capacity per cell adjusted to CTI (Cooling Technology Institute) rated conditions of 95°F condenser water return, 85°F condenser water supply, and 78°F wet-bulb with a 3 gpm/nominal ton water flow. The default cooling tower curves below are at unity at these conditions.
<i>Units</i>	But/h
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	The baseline building chiller is autosized and increased by 15%. The tower is sized to supply 85°F condenser water or 10°F approach to wet bulb, whichever is lower, at design conditions for the oversized chiller.

**Cooling Tower Number of Cells**

<i>Applicability</i>	All cooling towers
<i>Definition</i>	The number of cells in the cooling tower. Each cell will be modeled as equal size. Cells are subdivisions in cooling towers, each with its own fan and water flow, and allow the cooling system to respond more efficiently to lower load conditions.
<i>Units</i>	Numeric: integer
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	The baseline building shall be modeled with one cooling tower with one cell.

**Cooling Tower Total Fan Horse Power**

<i>Applicability</i>	All cooling towers
<i>Definition</i>	The sum of the nameplate rated horsepower (hp) of all fan motors on the cooling tower. Pony motors should not be included
<i>Units</i>	gpm/hp or unitless if EIR is specified. (If the nominal tons but not the condenser water flow is specified, the condenser design water flow shall be 2.4 gpm per nominal cooling ton.)
<i>Input Restrictions</i>	As designed, but the cooling towers shall meet minimum performance requirements in Table 6.8.1-7 of Standard 90.1-2019 and must be at least 40.2 gpm/hp for an axial fan, open circuit cooling tower and at least 20 gpm/hp for a centrifugal fan open-circuit cooling tower
<i>Baseline Building</i>	38.2 gpm/hp. Defined according to the minimum performance requirements for an axial fan cooling tower in Table 6.8.17 of Standard 90.1-2019 and rated gpm of the autosized tower.

**Cooling Tower Design Wet-Bulb**

<i>Applicability</i>	All cooling towers
<i>Definition</i>	The design wet-bulb temperature that was used for selection and sizing of the cooling tower
<i>Units</i>	Degrees Fahrenheit (°F)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	1% wet-bulb design conditions if the proposed building has a cooling tower

**Cooling Tower Design Leaving Water Temperature**

<i>Applicability</i>	All cooling towers
<i>Definition</i>	The design condenser water supply temperature (leaving tower) that was used for selection and sizing of the cooling tower
<i>Units</i>	Degrees Fahrenheit (°F)
<i>Input Restrictions</i>	As designed. Default to 85°F.
<i>Baseline Building</i>	85°F or 10°F above the design wet-bulb temperature, whichever is lower

**Cooling Tower Design Entering Water Temperature**

<i>Applicability</i>	All cooling towers
<i>Definition</i>	The design leaving condenser water temperature (entering tower) that was used for selection and sizing of the cooling tower
<i>Units</i>	Degrees Fahrenheit (°F)
<i>Input Restrictions</i>	As designed. Default to 95°F.
<i>Baseline Building</i>	Set to 10°F above the cooling tower design leaving water temperature

**Cooling Tower Capacity Adjustment Curve(s)**

*Applicability* All cooling towers

*Definition* A curve or group of curves that represent the available total cooling capacity as a function of outdoor air wet-bulb, condenser water supply and condenser water return temperatures. The default curves are given as follows:

Option 1 (DOE-2 based performance curves)

$$\begin{aligned}
 t_R &= t_{cwr} - t_{cws} \\
 t_A &= t_{cws} - t_{owb} \\
 t_A &= a + b \times t_R + c \times t_R^2 + d \times FRA + e \times FRA^2 + f \times t_R \times FRA \\
 FRA &= \frac{-d - f \times t_R + \sqrt{(d + f \times t_R)^2 - 4 \times e \times (a + b \times t_R + c \times t_R^2 - t_A)}}{2 \times e} \\
 FWB &= a + b \times FRA + c \times FRA^2 + d \times t_{owb} + e \times t_{owb}^2 + f \times FRA \times t_{owb} \\
 Q_{available} &= Q_{rated} \times FWB \times \left(\frac{t_R}{10}\right)
 \end{aligned}
 \tag{55}$$

Where:

$Q_{available}$  = Available cooling capacity at present outside air and condenser water conditions (MBH)

$Q_{rated}$  = Rated cooling capacity at CTI test conditions (MBH)

$t_{cws}$  = The condenser water supply temperature (in °F)

$t_{cwr}$  = The condenser water return temperature (in °F)

$t_{owb}$  = The outside air wet-bulb temperature (°F)

$t_R$  = The tower range (in °F)

$t_A$  = The tower approach (in °F)

$FRA$  = An intermediate capacity curve based on range and approach

$FWB$  = The ratio of available capacity to rated capacity (gpm/gpm)

Table 91. Default Capacity Coefficients – Cooling Towers

Coefficient	FRA	FWB
a	-2.22888899	0.60531402
b	0.16679543	-0.03554536
c	-0.01410247	0.00804083
d	0.03222333	-0.02860259
e	0.18560214	0.00024972
f	0.24251871	0.00490857

Option 2: CoolTools performance curve (EnergyPlus)

$$\begin{aligned}
 \text{Approach} &= \text{Coeff}(1) + \text{Coeff}(2) \cdot \text{FRair} + \text{Coeff}(3) \cdot (\text{FRair})^2 + \text{Coeff}(4) \cdot (\text{FRair})^3 + \text{Coeff}(5) \cdot \text{FRwater} + \\
 &\quad \text{Coeff}(6) \cdot \text{FRair} \cdot \text{FRwater} + \text{Coeff}(7) \cdot (\text{FRair})^2 \cdot \text{FRwater} + \text{Coeff}(8) \cdot (\text{FRwater})^2 + \\
 &\quad \text{Coeff}(9) \cdot \text{FRair} \cdot (\text{FRwater})^2 + \\
 &\quad \text{Coeff}(10) \cdot (\text{FRwater})^3 + \text{Coeff}(11) \cdot \text{Twb} + \text{Coeff}(12) \cdot \text{FRair} \cdot \text{Twb} + \text{Coeff}(13) \cdot (\text{FRair})^2 \cdot \text{Twb} + \\
 &\quad \text{Coeff}(14) \cdot \text{FRwater} \cdot \text{Twb} + \text{Coeff}(15) \cdot \text{FRair} \cdot \text{FRwater} \cdot \text{Twb} + \text{Coeff}(16) \cdot (\text{FRwater})^2 \cdot \text{Twb} + \\
 &\quad \text{Coeff}(17) \cdot (\text{Twb})^2 + \text{Coeff}(18) \cdot \text{FRair} \cdot (\text{Twb})^2 + \text{Coeff}(19) \cdot \text{FRwater} \cdot (\text{Twb})^2 + \text{Coeff}(20) \cdot (\text{Twb})^3 + \\
 &\quad \text{Coeff}(21) \cdot \text{Tr} + \text{Coeff}(22) \cdot \text{FRair} \cdot \text{Tr} + \text{Coeff}(23) \cdot \text{FRair} \cdot \text{FRair} \cdot \text{Tr} + \text{Coeff}(24) \cdot \text{FRwater} \cdot \text{Tr} + \\
 &\quad \text{Coeff}(25) \cdot \text{FRair} \cdot \text{FRwater} \cdot \text{Tr} + \\
 &\quad \text{Coeff}(26) \cdot (\text{FRwater})^2 \cdot \text{Tr} + \text{Coeff}(27) \cdot \text{Twb} \cdot \text{Tr} + \text{Coeff}(28) \cdot \text{FRair} \cdot \text{Twb} \cdot \text{Tr} + \\
 &\quad \text{Coeff}(29) \cdot \text{FRwater} \cdot \text{Twb} \cdot \text{Tr} + \\
 &\quad \text{Coeff}(30) \cdot (\text{Twb})^2 \cdot \text{Tr} + \text{Coeff}(31) \cdot (\text{Tr})^2 + \text{Coeff}(32) \cdot \text{FRair} \cdot (\text{Tr})^2 + \text{Coeff}(33) \cdot \text{FRwater} \cdot (\text{Tr})^2 + \\
 &\quad \text{Coeff}(34) \cdot \text{Twb} \cdot (\text{Tr})^2 + \text{Coeff}(35) \cdot (\text{Tr})^3
 \end{aligned}$$

Where:

$FR_{air}$  = Ratio of airflow to airflow at design conditions

$FR_{water}$  = Ratio of water flow to water flow at design conditions

$Tr$  = Tower range (°F)

$T_{wb}$  = Wet-Bulb temperature

Coefficients for this performance curve are provided in COMNET Appendix H (COMNET 2017).

<i>Units</i>	Data structure
<i>Input Restrictions</i>	User may input curves or use one of the two default curves. If defaults are overridden, the rating software must indicate that supporting documentation is required on the output forms.
<i>Baseline Building</i>	Use one of the two default curves

### Cooling Tower Set Point Control

<i>Applicability</i>	All cooling towers
<i>Definition</i>	The type of control for the condenser water supply. The choices are: <ul style="list-style-type: none"> <li>• Fixed</li> <li>• Wet-bulb reset</li> </ul> <p>A fixed control will modulate the tower fans to provide the design condenser water supply temperature at all times when possible. A wet-bulb reset control will reset the condenser water setpoint according to the following control scheme:</p>

$$t_{cws} = t_{owb} + t_A + RR \times (t_{dwb} - t_{owb})$$

Where:

$t_{cws}$  = The condenser water supply setpoint (in °F)

$t_{owb}$  = The outside air wet-bulb temperature (°F)

$t_{dwb}$  = The design outside air wet-bulb temperature (°F)

$t_A$  = The tower design approach (in °F)

$RR$  = The reset ratio (default is 0.29)

A reset ratio ( $RR$ ) of 0 will force the tower to always attempt a fixed approach to the outdoor wet-bulb temperature. An  $RR$  of 1 will cause the system to perform as if it had fixed condenser water controls.

<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed. If the user does not use the default control, supporting documentation is required.
<i>Baseline Building</i>	Controlled to 70°F when weather permits, floating up to leaving water temperature at design conditions

**Cooling Tower Capacity Control**

<i>Applicability</i>	All cooling towers
<i>Definition</i>	Describes the modulation control employed in the cooling tower. Choices include: <ul style="list-style-type: none"> <li>• Fluid bypass: Provides a parallel path to divert some of the condenser water around the cooling tower at part-load conditions.</li> <li>• Fan cycling: A simple method of capacity control where the tower fan is cycled on and off. This is often used on multiple-cell installations.</li> <li>• Two-speed fan/pony motor: From an energy perspective, these are the same. A lower horsepower pony motor is an alternative to a two-speed motor; the pony motor runs at part-load conditions (instead of the full sized motor) and saves fan energy when the tower load is reduced. Additional building descriptors are triggered when this method of capacity control is selected.</li> <li>• Variable Speed fan: A variable frequency drive is installed for the tower fan so that the speed can be modulated.</li> </ul>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Variable speed fans

**Cooling Tower Low-Speed Airflow Ratio**

<i>Applicability</i>	All cooling towers with variable speed, two-speed, or pony motors
<i>Definition</i>	The percentage full load airflow that the tower has at low speed or with the pony motor operating. This is equivalent to the percentage full load capacity when operating at low speed.
<i>Units</i>	Fraction (between 0 and 1)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	0.50

**Cooling Tower Low-Speed kW Ratio**

<i>Applicability</i>	All cooling towers
<i>Definition</i>	The percentage full load power that the tower fans draw at low speed or with the pony motor operating
<i>Units</i>	Fraction (between 0 and 1)
<i>Input Restrictions</i>	Calculated, using the as-designed flow ratio and the cooling tower power adjustment curve below
<i>Baseline Building</i>	0.30



**Cooling Tower Fan Power Adjustment Curve**

*Applicability* All cooling towers with VSD control  
*Definition* A curve that varies the cooling tower fan energy usage as a function of part-load ratio for cooling towers with variable speed fan control. The default curve is given as follows:

$$\begin{aligned}
 PLR &= \frac{Q_{operating}}{Q_{available}(t_R, t_A, t_{OWB})} \\
 TWR\_FAN\_FPLR &= a + b \times PLR + c \times PLR^2 + d \times PLR^3 \\
 P_{operating} &= P_{rated} \times TWR\_FAN\_FPLR
 \end{aligned}
 \tag{56}$$

Where:

- $PLR$  = Part load ratio based on available capacity (not rated capacity)
- $Q_{operating}$  = Present load on tower (in Btu/h)
- $Q_{available}$  = Tower available capacity at present range, approach, and outside wet-bulb conditions (in Btu/h).
- $t_{owb}$  = The outside air wet-bulb temperature (°F)
- $t_R$  = The tower range (°F)
- $t_A$  = The tower approach (°F)
- $P_{rated}$  = Rated power draw at CTI conditions (kW)
- $P_{operating}$  = Power draw at specified operating conditions (kW)

Table 92. Default Efficiency TWR-FAN-FPLR Coefficients – VSD on Cooling Tower Fan

Coefficient	TWR-FAN-FPLR
a	0.33162901
b	-0.88567609
c	0.60556507
d	0.9484823

*Units* Data structure  
*Input Restrictions* User may input curves or use default curves. If defaults are overridden, supporting documentation is required.  
*Baseline Building* Use default curves, given above.

**Cooling Tower Minimum Speed**

*Applicability* All cooling towers with a VSD control  
*Definition* The minimum fan speed setting of a VSD controlling a cooling tower fan expressed as a ratio of full load speed  
*Units* Fraction (between 0 and 1)  
*Input Restrictions* As designed. The default is 0.40.  
*Baseline Building* Not applicable

### 3.8.4 Fluid Economizers

#### Baseline Building Summary:

Baseline building system 11 would include an integrated fluid economizer, meeting the requirements as specified in this section, also in Section 6.5.1.2 of Standard 90.1-2019. Additional inputs to those below may be required to simulate actual control sequences.

#### *Fluid Economizer Name*

<i>Applicability</i>	All fluid economizers
<i>Definition</i>	The name of a fluid economizer for a cooling system
<i>Units</i>	Text, unique
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	A water side fluid economizer will be modeled for baseline system 11, for computer rooms

***Water Economizer Type***

<i>Applicability</i>	All fluid economizers
<i>Definition</i>	<p>The type of fluid economizer. Choices include:</p> <ul style="list-style-type: none"> <li>• None</li> <li>• Heat exchanger in parallel with chillers: This would be used with an open cooling tower combined with a heat exchanger or evaporative cooler (closed circuit cooling tower) and is a non-integrated economizer, because the chillers are locked out when the plant is in economizer mode.</li> <li>• Heat exchanger in series with chillers: This would be used with an open cooling tower and heat exchanger or evaporative cooler (closed circuit cooling tower) and is integrated because the piping is arranged so the chilled water return is pre-cooled and chillers can operate simultaneously with water economizer operation. Depending on the proportion of water economizer capacity compared to chiller capacity, the water economizer heat exchanger may see the full chilled water flow, or be in a “sidecar” arrangement where only a portion of the chilled water flow goes through the heat exchanger.</li> <li>• Direct water economizer: In this system, the condenser and chilled-water systems are connected. When the outdoor wet bulb temperature is low enough, cold water from the cooling tower is routed directly into the chilled-water loop. This would be used with filtration of the condenser water. In this case, a heat exchanger is not needed. This type can work as either an integrated or a non-integrated economizer, depending on piping arrangement. Although the strainer cycle is the most efficient water economizer option, it greatly increases the risk of fouling in the chilled-water system and cooling coils with the same type of contamination that is common in open cooling-tower systems. A strainer or filter can be used to minimize this contamination, but the potential for fouling prevents widespread use of the strainer-cycle system (Trane, 2016).</li> </ul>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed

*Baseline Building* The baseline water side economizer should be a ‘heat exchanger in series with chillers’.

It shall be modeled for HVAC system 11 that serve computer rooms. The baseline system will be modeled with a heat exchanger in series with the chiller that pre-cools the chilled water return. The flow through the heat exchanger shall match the required water economizer capacity. The fluid economizer shall be capable of providing up to 100% of the expected system cooling load at outdoor air temperatures listed in Table 93.

Table 93. Fluid Economizer Sizing Dry-Bulb and Wet-Bulb Requirements for Computer Rooms

Climate Zone	Dry Bulb °F	Wet Bulb °F
0 A	NR	NR
0 B	NR	NR
1 A	NR	NR
1 B	NR	NR
2 A	40	35
2 B	35	30
3 A	40	35
3 B	30	25
3 C	30	25
4 A	40	35
4 B	30	25
4 C	30	25
5 A	40	35
5 B	30	25
5 C	30	25
6 A	35	30
6 B	30	25
7	30	25
8	30	25

NR = Not Required

### **Fluid Economizer Approach**

<i>Applicability</i>	All fluid economizers
<i>Definition</i>	The design temperature difference between the chilled water temperature leaving the heat exchanger and the condenser water (tower leaving) inlet to the heat exchanger.
<i>Units</i>	Degrees Fahrenheit (°F)
<i>Input Restrictions</i>	As designed. Defaults to 2°F.
<i>Baseline Building</i>	This will be specified as 2°F for the baseline building.

**Fluid Economizer Activation Temperature Difference**

<i>Applicability</i>	All fluid economizers
<i>Definition</i>	The minimum temperature difference between the tower leaving temperature and the chilled water return below which the fluid economizer is disabled.
<i>Units</i>	Degrees Fahrenheit (°F)
<i>Input Restrictions</i>	As designed. Defaults to 3.5°F below the chilled water return temperature.
<i>Baseline Building</i>	This will be specified as 3.5°F below the chilled water return temperature for the baseline building.

**Fluid Economizer Tower Leaving Temperature Setpoint**

<i>Applicability</i>	All fluid economizers
<i>Definition</i>	The temperature setpoint for the water side economizer heat exchanger entering temperature (tower leaving temperature).
<i>Units</i>	Degrees Fahrenheit (°F)
<i>Input Restrictions</i>	As designed.
<i>Baseline Building</i>	This will be the 2°F below the chilled water supply temperature for the baseline building.

**Fluid Economizer Availability Schedule**

<i>Applicability</i>	All fluid economizers
<i>Definition</i>	A schedule that represents the availability of the fluid economizer
<i>Units</i>	Data structure: schedule, on/off
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	The waterside economizer will be simulated to be ‘Always On’ for the baseline building.

**Fluid Economizer Hydronic Pressure Drop**

<i>Applicability</i>	All fluid economizers
<i>Definition</i>	Pressure drop of the pre-cooling coils of the fluid to water heat exchanger.
<i>Units</i>	ft of water
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Refer to Section 3.8.5 for baseline system hydronic pressure drop requirements.

**3.8.5 Pumps**

Hot water pumping in the baseline building (systems 1, 5, 7, 11, and 12) shall be modeled as a primary only system with continuous variable flow, and a minimum of 25% of design flow rate of the baseline building. When the spaces served by the hot water system are greater than or equal to 120,000 ft<sup>2</sup>, the pump shall have a variable speed drive; otherwise, the pump “rides the curve.” Pumping energy shall be assumed to be 19 W/gpm. Two-way valves are assumed at the heating coils with a modulating bypass valve at the end of the loop. The bypass valve shall open as necessary to maintain minimum flow through the boiler when the system is activated. This will establish the minimum flow through the system.

District hot water systems shall follow the same rules as hot water pumps, except for pump energy, which shall be equal to 14 W/gpm.

Chilled water pumping in the baseline building (systems 7, 8, 11, 12, and 13) is a primary/secondary system with constant flow primary loop and variable flow secondary loop. The minimum flow of the secondary loop is 25% of the design flow rate. Each chiller has its own primary and condenser water pumps that operate when the chiller is activated. All primary pumps shall be 9 W/gpm and secondary pump shall be 13 W/gpm, and the condenser water pump is assumed to be 19 W/gpm. For plants less than or equal to 300 tons, the secondary pump “rides the curve,” for larger plants, the pump has a variable speed drive. The primary chilled water pump is constant speed and the condenser water pump is fixed speed. District chilled water system pumps shall follow the same rules as secondary chilled water pumps and pump energy shall be assumed to be 16 W/gpm. For computer room systems using system 11 with an integrated fluid economizer, the baseline building design both primary chilled water pump and condenser water pump power shall be increased by 3 W/gpm for flow associated with the fluid economizer.

The building descriptors in this section are repeated for each pumping system. See the Pump Service building descriptor for a list of common pump services.

<b>Pump Name</b>	
<i>Applicability</i>	All pumps
<i>Definition</i>	A unique descriptor for each pump
<i>Units</i>	Text, unique
<i>Input Restrictions</i>	User entry. Where applicable, this should match the tags that are used on the plans.
<i>Baseline Building</i>	Same as the proposed design. If there is no equivalent in the proposed design, assign a sequential tag to each piece of equipment. The sequential tags should indicate the pump service as part of the descriptor (e.g., CW for condenser water, CHW for chilled water, or HHW for heating hot water).

<b>Pump Service</b>	
<i>Applicability</i>	All pumps
<i>Definition</i>	The service for each pump. Choices include: <ul style="list-style-type: none"> <li>• Chilled water</li> <li>• Chilled water (primary)</li> <li>• Chilled water (secondary)</li> <li>• Heating water</li> <li>• Heating water (primary)</li> <li>• Heating water (secondary)</li> <li>• Service hot water</li> <li>• Condenser water</li> <li>• Loop water (for hydronic heat pumps)</li> </ul>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	As needed by the baseline building system

**Number of Pumps**

<i>Applicability</i>	All pumps
<i>Definition</i>	The number of identical pumps in service in a particular loop, e.g., the heating hot water loop, chilled water loop, or condenser water loop
<i>Units</i>	Numeric: integer
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	The number of pumps will be defined as specified below: <ul style="list-style-type: none"> <li>• One heating hot water pump for each boiler</li> <li>• One primary chilled water pump for each chiller and one secondary chilled water pump for the chilled water loop</li> <li>• One condenser water pump for each chiller</li> <li>• One district hot water pump for each building served by a district hot water system</li> <li>• One district chilled water pump for each building served by a district chilled water system</li> </ul>

**Water Loop Design**

<i>Applicability</i>	All pumps
<i>Definition</i>	The heating and cooling delivery systems can consist of a simple primary loop system, or more complicated primary/secondary loops or primary/secondary/tertiary loops
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Heating water systems shall be modeled with primary loops only. Chilled water systems shall be modeled with primary/secondary loops.

**Pump Motor Modeling Method**

<i>Applicability</i>	All pumps
<i>Definition</i>	Software commonly models pumps in one of two ways: The simple method is for the user to enter the electric power per unit of flow (W/gpm). This method is commonly used for smaller systems. A more detailed method requires a specification of the pump head, design flow, impeller, and motor efficiency.
<i>Units</i>	List: Power-Per-Unit-Flow or Detailed
<i>Input Restrictions</i>	Either method may be used, as appropriate
<i>Baseline Building</i>	Detailed modeling method will be used for the baseline building.

**Pump Motor Power-Per-Unit-Flow**

<i>Applicability</i>	All proposed design pumps that use the power-per-unit-flow method
<i>Definition</i>	The electric power of the pump divided by the flow at design conditions
<i>Units</i>	W/gpm
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Detailed modeling method will be used for the baseline building.

**Pump Motor Horsepower**

<i>Applicability</i>	All pumps
<i>Definition</i>	The nameplate motor horsepower
<i>Units</i>	horsepower
<i>Input Restrictions</i>	Constrained to be a value from the following list of standard motor sizes:  A standard motor size table (hp) is defined as: 1/12, 1/8, 1/4, 1/2, 3/4, 1, 1.5, 2, 3, 5, 7.5, 10, 15, 20, 25, 30, 40, 50, 60, 75, 100, 125, 150, 200
<i>Baseline Building</i>	Not applicable

**Pump Design Head**

<i>Applicability</i>	All baseline building pumps and proposed design pumps that use the detailed modeling method
<i>Definition</i>	The head of the pump at design flow conditions
<i>Units</i>	ft or wg
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	For the baseline building: <ul style="list-style-type: none"> <li>• District chilled water <ul style="list-style-type: none"> <li>– Pressure drop is 55 ft head</li> </ul> </li> <li>• District hot water <ul style="list-style-type: none"> <li>– Pressure drop is 44 ft head</li> </ul> </li> <li>• Chilled water system <ul style="list-style-type: none"> <li>– Pressure drop is 31 ft of head for the primary loop and 45 ft of head for the secondary loop</li> <li>– For pumps serving baseline system 11, pressure drop is 41 ft of head for the primary loop and 45 feet of head for the secondary loop.</li> </ul> </li> <li>• Condenser water system <ul style="list-style-type: none"> <li>– Pressure drop is 60 ft of head</li> <li>– For pumps serving baseline system 11, pressure drop is 70 ft of head.</li> </ul> </li> <li>• Hot water system <ul style="list-style-type: none"> <li>– Pressure drop is 60 ft of head</li> </ul> </li> </ul>



### ***Impeller Efficiency***

<i>Applicability</i>	All pumps in proposed design that use the detailed modeling method
<i>Definition</i>	The full load efficiency of the impeller
<i>Units</i>	Ratio (between 0 and 1)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	For the baseline building: <ul style="list-style-type: none"> <li>• District chilled water system <ul style="list-style-type: none"> <li>– Impeller efficiency = 72% (assuming motor efficiency of 90% and a total pump efficiency of 65%)</li> </ul> </li> <li>• District hot water system <ul style="list-style-type: none"> <li>– Impeller efficiency = 66.67% (assuming motor efficiency of 90% and a total pump efficiency of 60%)</li> </ul> </li> <li>• Chilled water system <ul style="list-style-type: none"> <li>– Impeller efficiency = 72% (assuming motor efficiency of 90% and total pump efficiency of 65%)</li> </ul> </li> <li>• Condenser water system <ul style="list-style-type: none"> <li>– Impeller efficiency = 66.67% (assuming motor efficiency of 90% and total pump efficiency of 60%)</li> </ul> </li> <li>• Hot water system <ul style="list-style-type: none"> <li>– Impeller efficiency = 66.67% (assuming motor efficiency of 90% and total pump efficiency of 60%)</li> </ul> </li> </ul>

### ***Motor Efficiency***

<i>Applicability</i>	All pumps in proposed design that use the detailed modeling method
<i>Definition</i>	The full load efficiency of the pump motor
<i>Units</i>	Ratio (between 0 and 1)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	<ul style="list-style-type: none"> <li>• District chilled water system <ul style="list-style-type: none"> <li>– Motor efficiency = 90%</li> </ul> </li> <li>• District hot water system <ul style="list-style-type: none"> <li>– Motor efficiency = 90%</li> </ul> </li> <li>• Chilled water system <ul style="list-style-type: none"> <li>– Motor efficiency = 90%</li> </ul> </li> <li>• Condenser water system <ul style="list-style-type: none"> <li>– Motor efficiency = 90%</li> </ul> </li> <li>• Hot water system <ul style="list-style-type: none"> <li>– Motor efficiency = 90%</li> </ul> </li> </ul>

**Pump Minimum Speed**

<i>Applicability</i>	All two-speed or variable-speed pumps
<i>Definition</i>	The minimum pump speed for a two-speed or variable-speed pump. A fraction of the pump design head. For two-speed pumps this is typically 0.67 or 0.5. Note that the pump minimum speed is not necessarily the same as the minimum flow ratio, since the system head may change.
	$Pump\ Speed_{min} = Pump\ Speed_{design} * \sqrt{(Head_{min} / Head_{design})}$
<i>Units</i>	Ratio (between 0 and 1)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	When the baseline pumps are required to have variable speed drives in accordance with descriptor Pump Control Type, the pump minimum speed shall be 0.10

**Pump Design Flow (gpm)**

<i>Applicability</i>	All pumps
<i>Definition</i>	The flow rate of the pump at design conditions. For the baseline, this is derived from the heating and cooling loads, the appropriate oversizing factors, and the design supply and return temperatures.
<i>Units</i>	gpm or gpm/ton for condenser and primary chilled water pumps
<i>Input Restrictions</i>	Not a user input
<i>Baseline Building</i>	The temperature change on the evaporator side of the chillers is 12°F (56°F less 44°F) and this equates to a flow of 2 gpm/ton.  The temperature change on the condenser side of the chillers is 10°F, which equates to a flow of 2.4 gpm/ cooling ton. The flow for secondary chilled water varies with cooling demand, since there are two-way valves at the coils. The flow for primary only heating varies with demand down to the minimum required for flow through the boiler. For hot water pumps servicing boilers, the flow rate in gpm shall be the boiler capacity in Btu/h / 25,000, which corresponds to a loop temperature drop of 50°F.

### **Pump Control Type**

<i>Applicability</i>	All pumps
<i>Definition</i>	The type of control for the pump. Choices are: <ul style="list-style-type: none"> <li>• Fixed speed, fixed flow</li> <li>• Fixed speed, variable flow (the default, with flow control via a valve)</li> <li>• Two-speed</li> <li>• Variable speed, variable flow</li> </ul>
<i>Units</i>	None
<i>Input Restrictions</i>	As designed. The default is “Fixed Speed, Variable Flow,” which models the action of a constant speed pump riding the curve against two-way control valves.
<i>Baseline Building</i>	Hot water loops are primary loops only. <ul style="list-style-type: none"> <li>• For systems serving less than 120,000 ft<sup>2</sup>, the HW pump is modeled as variable flow with a constant speed pump riding the pump curve. For systems serving more than 120,000 ft<sup>2</sup>, the HW pump is modeled as a variable flow with a variable speed pump controlled with a variable speed drive.</li> </ul> <p>Condenser water pumps:</p> <ul style="list-style-type: none"> <li>• Condenser water loops are primary only. CW pumps are required to be modeled as fixed speed and fixed flow.</li> </ul> <p>Chilled water pumps:</p> <ul style="list-style-type: none"> <li>• The CHW pumping for systems 7, 8, 11, 12, and 13 are primary/secondary with variable flow. The chilled water pumps used for the primary loop are fixed speed and fixed flow. <ul style="list-style-type: none"> <li>– For systems with a capacity of less than 300 tons, the secondary system pumps shall ride the pump curve.</li> <li>– For systems with a capacity greater than 300 tons, the secondary pumps will be modeled as variable speed.</li> </ul> </li> </ul> <p>District chilled water pump shall follow the same rules for secondary chilled water pumps.</p>

### **Pump Operation**

<i>Applicability</i>	All pumps
<i>Definition</i>	The type of pump operation can be either on-demand, standby, or scheduled. On-demand operation means the pumps are only pumping when their associated equipment is cycling, so chiller and condenser pumps are on when the chiller is on and the heating hot water pump operates when its associated boiler is cycling. Standby operation allows hot or chilled water to circulate through the primary loop of a primary/secondary loop system or through a reduced portion of a primary-only system, assuming the system has appropriate three-way valves. Scheduled operation means that the pumps and their associated equipment are turned completely off according to occupancy schedules, time of year, or outside conditions. Under scheduled operation, when the systems are on they are assumed to be in On-Demand mode.
<i>Units</i>	List: On Demand, Standby, Scheduled
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	The baseline system pumps are assumed to operate in on-demand mode. The chilled water and condenser pumps are tied to the chiller operation, cycling on and off with the chiller, and the heating hot water pumps are tied to the boiler operation.

**Pump Part Load Curve**

*Applicability* All pumps

*Definition* A part-load power curve for the pump:

$$CIRC - PUMP - FPLR = a + b \times PLR + c \times PLR^2 + d \times PLR^3 \tag{57}$$

$$P_{pump} = P_{design} \times CIRC - PUMP - FPLR \tag{58}$$

Where:

*PLR* = Part load ratio (the ratio of operating flow rate in gpm to design flow rate in gpm)

*P<sub>pump</sub>* = Pump power draw at part-load conditions (W)

*P<sub>design</sub>* = Pump power draw at design conditions (W)

Table 94. Default Part-Load CIRC-PUMP-FPLR Coefficients<sup>1</sup>

Coefficient	Constant Speed, no VSD (Pump rides pump curve)	Default (VSD, No Reset)	VSD, DP Reset
	a	0	0
b	3.2485	0.5726	0.0205
c	-4.7443	-0.301	0.4101
d	2.5294	0.7347	0.5753

Source: Thornton et al. 2011  
VSD = Variable Speed Drive  
DP = Differential Pressure

*Units* Data structure

*Input Restrictions* As designed. Default is curve above.

*Baseline Building* Use the defaults described above based on pump type. The curve with differential pressure reset isn't used for the baseline building.

**3.8.6 Thermal Storage**

There are multiple ways to model thermal storage in the proposed design. The baseline building does not have thermal storage.

**Storage Type**

*Applicability* All thermal storage systems

*Definition* A type of thermal energy storage (TES) that indicates the storage medium

*Units* List

*Input Restrictions* Ice, chilled water

*Baseline Building* No thermal storage systems

<sup>1</sup> [http://www.pnnl.gov/main/publications/external/technical\\_reports/PNNL-22043.pdf](http://www.pnnl.gov/main/publications/external/technical_reports/PNNL-22043.pdf)

**Configuration**

<i>Applicability</i>	All thermal storage systems
<i>Definition</i>	Indication of how the TES is configured and operated in relation to the chilled water cooling
<i>Units</i>	List
<i>Input Restrictions</i>	Series, chiller upstream Series, chiller downstream Parallel
<i>Baseline Building</i>	No thermal storage systems

**Ice Storage Type**

<i>Applicability</i>	All thermal storage systems with storage type = ice
<i>Definition</i>	Indication of the storage type for ice storage
<i>Units</i>	List, with Options for Internal Melt, External Melt
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	No thermal storage systems

**Storage Capacity**

<i>Applicability</i>	All thermal storage systems using ice storage
<i>Definition</i>	Nominal storage capacity of the tank
<i>Units</i>	Ton-hrs
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	No thermal storage systems

**Tank Volume**

<i>Applicability</i>	All thermal storage systems using ice storage
<i>Definition</i>	Nominal storage capacity of the tank
<i>Units</i>	ft <sup>3</sup>
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	No thermal storage systems

**CHW Setpoint Schedule**

<i>Applicability</i>	All thermal storage systems using ice storage
<i>Definition</i>	Nominal storage capacity of the tank
<i>Units</i>	Series, °F
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	No thermal storage systems

**Deadband Temperature Difference**

<i>Applicability</i>	All thermal storage systems using chilled water
<i>Definition</i>	The deadband temperature difference between enabling and disabling use of the TES system for cooling
<i>Units</i>	°F
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	No thermal storage systems

**Maximum Temperature Limit**

<i>Applicability</i>	All thermal storage systems using chilled water
<i>Definition</i>	The minimum allowed temperature of the tank, below which charging of the tank cannot occur
<i>Units</i>	°F
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	No thermal storage systems

**Storage Tank Location Indicator**

<i>Applicability</i>	All thermal storage systems using ice storage
<i>Definition</i>	Nominal storage capacity of the tank
<i>Units</i>	List
<i>Input Restrictions</i>	Schedule, zone, or exterior  If <i>schedule</i> , the ambient temperature schedule must be specified. If <i>zone</i> , the zone name must be specified.
<i>Baseline Building</i>	No thermal storage systems

**Storage Tank Heat Gain Coefficient**

<i>Applicability</i>	All thermal storage systems using chilled water
<i>Definition</i>	The heat transfer coefficient between the tank and the ambient surroundings
<i>Units</i>	Btu/h-°F
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	No thermal storage systems

**Use Side Heat Transfer Effectiveness**

<i>Applicability</i>	All thermal storage systems using chilled water
<i>Definition</i>	The heat transfer effectiveness between the use side water and the tank water
<i>Units</i>	None
<i>Input Restrictions</i>	Between 0 and 1
<i>Baseline Building</i>	No thermal storage systems

***Use Side Design Flow Rate***

<i>Applicability</i>	All thermal storage systems using chilled water
<i>Definition</i>	Design flow rate through the use side of the storage tank
<i>Units</i>	gpm
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	No thermal storage systems

***Source Side Heat Transfer Effectiveness***

<i>Applicability</i>	All thermal storage systems using chilled water
<i>Definition</i>	The heat transfer effectiveness between the source side water and the tank water
<i>Units</i>	None
<i>Input Restrictions</i>	Between 0 and 1
<i>Baseline Building</i>	No thermal storage systems

***Source Side Design Flow Rate***

<i>Applicability</i>	All thermal storage systems using chilled water
<i>Definition</i>	Design flow rate through the source side of the storage tank
<i>Units</i>	gpm
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	No thermal storage systems

***Tank Recovery Time***

<i>Applicability</i>	All thermal storage systems using ice storage
<i>Definition</i>	This is the time in hours for the tank to cool from 58°F to 48°F. This input is only used if the source side design flow rate is not specified.
<i>Units</i>	Hours
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	No thermal storage systems

**3.8.7 Heat Recovery Equipment**

Requirements related to exhaust air recovery are documented in Section 3.7.6.6 of this manual.

***Heat Recovery Name***

<i>Applicability</i>	All heat recovery systems
<i>Definition</i>	A name assigned to a heat recovery system. This would provide a link to the construction documents.
<i>Units</i>	Text, unique
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Same as proposed

### ***Heat Recovery Device Type***

<i>Applicability</i>	All heat recovery systems
<i>Definition</i>	The type of heat recovery equipment. Choices include: <ul style="list-style-type: none"> <li>• Double-bundled chiller</li> <li>• Single-bundle heat recovery chiller</li> <li>• Generator</li> <li>• Engine-driven chiller</li> <li>• Air conditioning unit</li> <li>• Refrigerated casework</li> </ul>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	The baseline building is modeled with a condenser heat recovery system for service water heating, when all of the following conditions are true: <ul style="list-style-type: none"> <li>• The building operates 24 hours per day.</li> <li>• The total installed heat rejection capacity of the water cooled system exceeds 6,000,000 Btu/h.</li> <li>• The design service hot water load is greater than 1,000,000 Btu/h.</li> </ul> <p>The required heat recovery system for the baseline building, shall have the capacity to provide the smaller of:</p> <ul style="list-style-type: none"> <li>• 60% of the peak heat rejection load at design conditions, or</li> <li>• Preheat of the peak service hot water draw to 85°F</li> </ul> <p>If the simulation software is not capable of modeling the requirements described, the requirement for providing such a system in the proposed building shall be met as a prescriptive requirement and heat recovery shall not be modeled in the baseline or proposed building designs.</p>

### ***Heat Recovery Loads***

<i>Applicability</i>	All heat recovery systems
<i>Definition</i>	The loads met by the heat recovery system. Choices include: <ul style="list-style-type: none"> <li>• Service water heating</li> <li>• Space heating</li> <li>• Process heating</li> </ul> <p>More than one load may be selected.</p>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Service water heating when required as described above



**Condenser Heat Recovery Effectiveness**

<i>Applicability</i>	Systems that use recover heat from a condenser
<i>Definition</i>	The percentage of heat rejection at design conditions from a DX or heat pump unit in cooling mode that is available for space or water heating
<i>Units</i>	Percent (%)
<i>Input Restrictions</i>	As designed. The software must indicate that supporting documentation is required on the output forms if heat recovery is specified.
<i>Baseline Building</i>	Same as proposed

**Condenser Heat Recovery Use**

<i>Applicability</i>	Systems that use heat recovery
<i>Definition</i>	The end use of the heat recovered from a DX or heat pump unit. The choices are: <ul style="list-style-type: none"> <li>• Reheat coils</li> <li>• Water heating</li> </ul>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	As designed. The software must indicate that supporting documentation is required on the output forms if heat recovery is specified.
<i>Baseline Building</i>	Not applicable for most conditions. The end use will be water heating if required for 24-hour facility operation.

**3.8.8 Plant Management**

Plant management is a method of sequencing equipment. Separate plant management schemes may be entered for chilled water systems, hot water systems, etc. The following building descriptors are specified for each load range, e.g., when the cooling load is below 300 tons, between 300 tons and 800 tons, and greater than 800 tons.

**Equipment Type Managed**

<i>Applicability</i>	All plant systems
<i>Definition</i>	The type of equipment under a plant management control scheme. Choices include: <ul style="list-style-type: none"> <li>• Chilled water cooling</li> <li>• Hot water space heating</li> <li>• Condenser water heat rejection</li> <li>• Service water heating</li> <li>• Electrical generation</li> </ul>
<i>Units</i>	None
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Same as the proposed design

**Equipment Schedule**

<i>Applicability</i>	All plant equipment
<i>Definition</i>	A schedule that identifies when the equipment is in service
<i>Units</i>	Data structure
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Where multiple equipment is used, they shall be staged in operation

**Equipment Operation**

<i>Applicability</i>	All plant equipment
<i>Definition</i>	Equipment operation can be either on-demand or always-on. On-demand operation means the equipment cycles on when it is scheduled to be in service and when it is needed to meet building loads, otherwise it is off. Always-on means that equipment runs continuously when scheduled to be in service.
<i>Units</i>	None
<i>Input Restrictions</i>	As designed. The default is on-demand.
<i>Baseline Building</i>	Assume on-demand operation

**Equipment Staging Sequence**

<i>Applicability</i>	All plant equipment
<i>Definition</i>	The staging sequence for plant equipment (chillers and boilers) indicates how multiple equipment will be staged on and off when a single piece of equipment is unable to meet the load
<i>Units</i>	Structure – this should include (a) the percent of capacity above which additional equipment is staged on and (b) the percent of capacity below which one plant equipment is staged off
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Software shall bring the first boiler to 100% capacity prior to the staging of the next boiler. When more than one chiller is required in the baseline design, each chiller shall run to full capacity prior to staging of the next chiller. When more than one chiller is operational, then the load shall be shared equally among all the chillers.

## 3.9 Miscellaneous Energy Uses

Miscellaneous energy uses are defined as those that may be treated separately since they have little or no interaction with the conditioned thermal zones or the HVAC systems that serve them.

### 3.9.1 Water Heating

Water heating systems shall always be modeled for both the proposed design and baseline building when the proposed building is expected to have a water heating load, even if no water heating is shown on the plans or specifications for the proposed design. In such instances, an electric resistance system shall be modeled for both the proposed design and baseline building, meeting the efficiency requirements of the baseline standard.

When the construction documents show a water heating system, the layout and configuration of the baseline building system shall be the same as the proposed design, e.g., the baseline building shall have the same number of water heaters and the same distribution system.

### 3.9.1.1 System Loads and Configuration

#### *Water Heating System Name*

<i>Applicability</i>	All water heating systems
<i>Definition</i>	A unique descriptor for each water heating system. A system consists of one or more water heaters, a distribution system, an estimate of hot water use, and a schedule for that use. Nonresidential buildings will typically have multiple systems, perhaps a separate electric water heater for each office break room, etc. Other building types such as hotels and hospitals may have a single system serving the entire building.
<i>Units</i>	Text, unique
<i>Input Restrictions</i>	Where applicable, this should match the tags that are used on the plans such that a plan reviewer can make a connection
<i>Baseline Building</i>	The naming convention for the baseline building system shall be similar to the proposed design

#### *Water Heating Peak Use*

<i>Applicability</i>	All water heating systems, required
<i>Definition</i>	<p>An indication of the peak hot water usage (e.g., service to sinks, showers, and kitchen appliances). When specified per occupant, this value is multiplied by design occupancy density values and modified by service water heating schedules to obtain hourly load values that are used in the simulation.</p> <p>Peak consumption is commonly specified as gallons per hour per occupant, dwelling unit, hotel room, patient room, or floor area. If consumption is specified in gallons per hour, then additional inputs would be needed such as supply temperature, cold water inlet temperature, etc.</p> <p>It is also common to specify peak use as a thermal load in Btu/h. In the latter case, there is an implied assumption for the cold water inlet temperature, supply temperature, distribution losses, and other factors. The thermal load does not include conversion efficiencies of water heating equipment.</p>
<i>Units</i>	Btu/h or gallons/h
<i>Input Restrictions</i>	As designed. If these values are not available, the hot water use specified in COMNET Appendix B (COMNET 2017) may be used.
<i>Baseline Building</i>	<p>Hot water consumption or load in the baseline building shall be the same as the proposed design, except in cases where:</p> <ul style="list-style-type: none"> <li>• A specific measure is specified for the proposed design that will reduce water consumption. Examples of such measures include low-flow terminal devices or controls. The baseline flow rates shall be determined based on prescriptive requirements in Standard 90.1-2019. When no such prescriptive requirement exists, it shall be equal to requirements of other efficiency or equipment codes or standards applicable to the design of the building systems and equipment.</li> <li>• SHW energy consumption can be demonstrated to be reduced by increasing makeup water temperature or reducing SHW temperature (e.g., alternative sanitizing technologies for dishwashing and heat recovery to entering makeup water).</li> </ul>

- SHW energy consumption can be demonstrated to be reduced by reducing the hot fraction of mixed water. Examples include heat recovery laundry or showers drains.

**NOTE:** Calculations need to be provided to support the difference in service hot water loads between the proposed and baseline model.

### ***Water Heating Schedule***

<i>Applicability</i>	All water heating systems
<i>Definition</i>	A fractional schedule reflecting the time pattern of water heating use. This input modifies the water heating peak use, described above.
<i>Units</i>	Data structure: schedule, fractional
<i>Input Restrictions</i>	If known, anticipated schedules shall be used. If not known, the schedules from COMNET Appendix C (COMNET 2017) may be used.
<i>Baseline Building</i>	Hot water schedules for the baseline building shall be the same as the proposed design, except in cases where a specific measure is specified for the proposed design that will reduce water consumption and the impact of the measure can be best approximated through an adjustment to the schedule. In general, such measures would be addressed through an adjustment to the water heating, peak use (see above).

### ***Water Heating System Configuration***

<i>Applicability</i>	All water heating systems
<i>Definition</i>	The configuration and layout of the water heating system, including the number of water heaters; the size, location, recirculation systems and pumps; and any other details about the system that would affect the energy model. Piping heat losses shall not be modeled per Standard 90.1-2019.
<i>Units</i>	Data structure
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	The number of water heaters in the baseline building are dependent on the building area types. Section 3.9.1.2 discusses the requirements for the baseline building model.

### ***Water Mains Temperature Schedule***

<i>Applicability</i>	All water heating systems
<i>Definition</i>	A monthly temperature schedule indicating the water mains temperature. This temperature and the setpoint temperature are used to convert the load into a water flow rate.
<i>Units</i>	Data structure: schedule, °F
<i>Input Restrictions</i>	Entering water temperature can be defaulted to the values in Table 95 or provided by the user
<i>Baseline Building</i>	Same as proposed

Table 95. Defaults for Water Mains Temperature Based on Climate Zone

	Monthly Average																
	Water Main Supply Temp (°F)																
	1A	1B	2A	2B	3A	3B	3C	4A	4B	4C	5A	5B	5C	6A	6B	7	8
January	76.5	70.2	64.6	65.8	56.5	59.4	59.7	50.8	52.3	52.9	45.5	48	50.6	43.1	43.1	37.6	32
February	77.1	72.2	65	67.3	56.4	59.5	59.5	50	51.7	52.3	44.1	47	49.9	41.6	41.6	35.6	32
March	79	77.6	67.9	72.2	59.5	62.4	60.1	52.2	53.8	53.4	45.8	48.7	50.7	42.7	42.5	36.1	32
April	81.7	85.1	72.7	79.5	65	67.4	61.5	57	58.3	56.1	50.1	53.1	52.7	46.4	45.6	39	32
May	84.6	92.6	77.9	87.2	71.6	73.3	63.2	63.1	64	59.5	56	58.8	55.5	51.6	50.2	43.5	32.9
June	86.8	98.1	82.3	93.1	77.4	78.4	64.8	68.9	69.3	62.9	61.9	64.3	58.3	57	54.9	48.5	36.9
July	87.7	100.2	84.6	95.8	80.8	81.3	65.9	72.7	72.8	65.2	66.2	68.2	60.4	61.1	58.6	52.6	40.7
August	87.1	98.1	84.2	94.3	80.9	81.3	66.1	73.6	73.5	65.9	67.6	69.4	61.1	62.8	60.2	54.7	43.1
September	85.1	92.6	81.2	89.2	77.8	78.3	65.4	71.3	71.3	64.7	65.9	67.6	60.3	61.6	59.2	54.2	43.4
October	82.4	85.1	76.4	81.8	72.2	73.2	64	66.4	66.7	62	61.5	63.2	58.2	57.9	56	51.3	41.5
November	79.5	77.6	71.1	74.2	65.6	67.3	62.3	60.3	61	58.5	55.6	57.5	55.4	52.6	51.4	46.7	38
December	77.4	72.2	66.8	68.3	59.9	62.3	60.7	54.6	55.8	55.2	49.7	51.9	52.6	47.2	46.7	41.7	33.8

### 3.9.1.2 Water Heaters

This section describes the building descriptors for water heaters. Typically, a building will have multiple water heating systems and each system can have multiple water heaters, so these building descriptors may need to be specified more than once.

<i>Water Heater Name</i>	
<i>Applicability</i>	All water heaters
<i>Definition</i>	A unique descriptor for each water heater in the system. Some systems will have multiple pieces of equipment, for instance a series of water heaters plumbed in parallel or a boiler with a separate storage tank.
<i>Units</i>	Text, unique
<i>Input Restrictions</i>	Where applicable, this should match the tags that are used on the plans such that a plan reviewer can make a connection
<i>Baseline Building</i>	The naming convention for the baseline building system shall be similar to the proposed design

### ***Water Heater Type and Size***

<i>Applicability</i>	All water heaters
<i>Definition</i>	<p>This building descriptor includes information needed to determine the criteria from baseline standards. The choices are listed below.</p> <ul style="list-style-type: none"> <li>• Electric water heaters (storage and instantaneous) <ul style="list-style-type: none"> <li>– Small (<math>\leq 12</math> kW)</li> <li>– Large (<math>&gt; 12</math> kW)</li> <li>– Heat pump</li> </ul> </li> <li>• Gas storage water heaters <ul style="list-style-type: none"> <li>– Small (<math>\leq 75,000</math> Btu/h)</li> <li>– Large (<math>&gt; 75,000</math> Btu/h)</li> </ul> </li> <li>• Gas instantaneous water heaters <ul style="list-style-type: none"> <li>– Small (<math>&gt; 50,000</math> and <math>&lt; 200,000</math> Btu/h)</li> <li>– Large (<math>\geq 200,000</math> Btu/h), <math>&lt; 10</math> gal</li> <li>– Large (<math>\geq 200,000</math> Btu/h), <math>\geq 10</math> gal</li> </ul> </li> <li>• Oil storage water heaters <ul style="list-style-type: none"> <li>– Small (<math>\leq 105,000</math> Btu/h)</li> <li>– Large (<math>&gt; 105,000</math> Btu/h)</li> </ul> </li> <li>• Oil instantaneous water heaters <ul style="list-style-type: none"> <li>– Small (<math>\leq 210,000</math> Btu/h)</li> <li>– Large (<math>&gt; 210,000</math> Btu/h), <math>&lt; 10</math> gal</li> <li>– Large (<math>&gt; 210,000</math> Btu/h), <math>\geq 10</math> gal</li> </ul> </li> <li>• Gas hot water supply boiler</li> <li>• Oil hot water supply boiler</li> <li>• Heat exchanger from steam or district hot water</li> </ul>
<i>Units</i>	List (see above)
<i>Input Restrictions</i>	<p>The water heater type shall agree with equipment specified in the construction documents.</p> <p>If no service hot water system exists or has been specified, but the building will have service hot water loads, a service water system shall be modeled that matches the system type in the baseline building design.</p> <p>For buildings that will have no service hot water load, no service water heating system shall be modeled.</p>

*Baseline Building*

Where a complete water heating system exists or a new service water heating system has been specified in the proposed design, the water heaters in the baseline system will be based on the building area type classification. See Table 96 below.

For new service hot water systems, the system will be sized according to the provisions of Standard 90.1-2019, Section 7.4.1, and the equipment shall match the minimum efficiency requirements in Standard 90.1-2019, Section 7.4.2. Where the energy source is electricity, the heating method shall be electrical resistance. When the energy source is ‘Gas Storage’, the water heater shall be modeled using natural gas as their fuel. Where natural gas is not available or the proposed building site, as determined by the rating authority, gas storage water heaters shall be modeled using propane as their fuel.

If no service hot water system exists or has been specified, but the building will have service hot water loads, a service water system shall be modeled for each building area type in the proposed design, in accordance to Table 96. and matching minimum efficiency requirements of Standard 90.1-2019, Section 7.4.2.

Table 96. Baseline Building Water Heater Type (Standard 90.1-2019 Table G3.1.1-2)

Gas Storage	Electric Resistance Storage
Automotive facility	Convenience Store
Dining: Bar lounge/leisure	Convention center
Dining: Cafeteria/fast food	Courthouse
Dining: Family	Health-care clinic
Dormitory	Library
Exercise center	Motion picture theater
Fire station	Museum
Grocery Store	Office
Gymnasium	Parking garage
Hospital and Outpatient Surgery Center	Police station
Hotel	Post office
Manufacturing facility	Religious building
Motel	Retail
Multifamily	Town hall
Penitentiary	Transportation
Performing arts theater	Warehouse
School/university	Workshop
Sports arena	
All Others	

**Rated Capacity**

<i>Applicability</i>	All water heaters
<i>Definition</i>	The heating capacity of a water heater at the rated conditions specified in DOE 10 CFR Part 430 or ANSI Z21.10
<i>Units</i>	Thousands of British thermal units per hour (MBH)
<i>Input Restrictions</i>	As designed. If the loads are not met, then the system needs to be autosized.
<i>Baseline Building</i>	Autosize

**Storage Volume**

<i>Applicability</i>	All water heaters
<i>Definition</i>	The storage volume of a gas-fired water heater. This is used in the standby loss calculations and baseline calculations of energy factor (EF).
<i>Units</i>	gallons
<i>Input Restrictions</i>	As designed. If the loads are not met, then the system needs to be autosized.
<i>Baseline Building</i>	Autosize

**Energy Factor**

<i>Applicability</i>	Equipment covered by the National Appliance Energy Conservation Act (NAECA), which includes small storage and instantaneous water heaters
<i>Definition</i>	The EF is the ratio of the energy delivered by the water heater divided by the energy used, in the same units. EF is calculated according to the DOE 10 CFR Part 430 test procedure, which specifies a 24-hour pattern of draws, a storage temperature, inlet water temperature, and other test conditions. These conditions result in the energy delivered for the test period. Energy inputs are measured for the same test period and the EF ratio is calculated.
<i>Units</i>	Unitless ratio (between 0 and 1)
<i>Input Restrictions</i>	Building descriptors for the proposed design should be consistent with equipment specified on the construction documents or observed in the candidate building
<i>Baseline Building</i>	The EF for the baseline building system shall be determined from Table 7.8 of Standard 90.1-2019. Additional UEF efficiency requirements can be found in Table F-2 of Standard 90.1-2019.

**Thermal Efficiency**

<i>Applicability</i>	Oil and gas-fired water heaters not covered by NAECA
<i>Definition</i>	The full load efficiency of a water heater at rated conditions expressed as a dimensionless ratio of output over input
<i>Units</i>	Unitless ratio (between 0 and 1)
<i>Input Restrictions</i>	Building descriptors for the proposed design should be consistent with equipment specified on the construction documents or observed in the candidate building
<i>Baseline Building</i>	From Table 7.8 of Standard 90.1-2019

**Tank Standby Loss**

<i>Applicability</i>	Water heaters not covered by NAECA
<i>Definition</i>	The tank standby loss for storage tanks, which includes the effect of recovery efficiency
<i>Units</i>	Btu/h for the entire tank
<i>Input Restrictions</i>	As specified in manufacturer data and documented on the construction documents
<i>Baseline Building</i>	As specified in Table 7.8 of Standard 90.1-2019



**Tank Off-Cycle Loss Coefficient**

<i>Applicability</i>	Water heaters
<i>Definition</i>	The tank standby loss coefficient (UA) for the water heater. For small water heaters covered by NAECA, the loss coefficient is a derived parameter, a function of the energy factor and recovery efficiency.
<i>Units</i>	Btu/h-°F
<i>Input Restrictions</i>	For NAECA covered water heaters, the loss coefficient is calculated by the following:

$$UA = \frac{1/EF - 1/RE}{67.5 \times \left( \frac{24}{41094} - \frac{1}{RE \cdot Pon} \right)}$$

Where:

*EF* = The energy factor of the rated water heater (unitless)

*RE* = The recovery efficiency of the rated water heater. If this data is not available, the default shall be 0.78 for gas water heaters and 0.93 for electric water heaters.

*Pon* = The input power to the water heater, in Btu/h

*Baseline Building*

**Off Cycle Parasitic Losses**

<i>Applicability</i>	Water heater
<i>Definition</i>	The rate of parasitic losses, such as a pilot light or controls, when the water heater is not heating. If modeled explicitly, pilot lights should contribute to off-cycle heating.
<i>Units</i>	Watts
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	0

**Off Cycle Fuel Type**

<i>Applicability</i>	Water heater
<i>Definition</i>	The type of fuel that serves energy using parasitic equipment, such as a pilot light or controls, when the water heater is not heating
<i>Units</i>	List: Electricity, Gas, Oil, Propane
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable

**On Cycle Parasitic Losses**

<i>Applicability</i>	Water heater
<i>Definition</i>	The rate of parasitic losses, such as a pilot light or draft fan controls, when the water heater is heating. This may be different than off cycle losses if the flue energy is considered.
<i>Units</i>	Watts
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	0

**On Cycle Fuel Type**

<i>Applicability</i>	Water heater
<i>Definition</i>	The type of fuel that serves energy using parasitic equipment, such as a pilot light or controls, when the water heater is not heating
<i>Units</i>	List: Electricity, Gas, Oil, Propane
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Not applicable

**Water Heater Ambient Temperature Indicator**

<i>Applicability</i>	Water heater
<i>Definition</i>	The location of the water heater for determining losses and energy interaction with the surroundings
<i>Units</i>	List: Schedule, Zone, Outdoors
<i>Input Restrictions</i>	As designed. When “Schedule” is used, a time of day schedule needs to be specified with temperature schedule for each hour.
<i>Baseline Building</i>	Same as proposed

**Fuel Water Heater Part Load Efficiency Curve**

<i>Applicability</i>	Water heating equipment for which a thermal efficiency as opposed to an EF is specified
<i>Definition</i>	A set of factors that adjust the full-load thermal efficiency for part load conditions. The factor is set as a curve.
<i>Units</i>	Percent (%)
<i>Input Restrictions</i>	The following default curve shall be used unless detailed information is provided to justify alternative values. The default curve shall take the form of a quadratic equation as follows:

$$\begin{aligned}
 Fuel_{partload} &= Fuel_{design} \times FHeatPLC && (59) \\
 FHeatPLC &= \left( a + b \times \frac{Q_{partload}}{Q_{rated}} + c \times \left( \frac{Q_{partload}}{Q_{rated}} \right)^2 \right)
 \end{aligned}$$

Where:

- $FHeatPLC$  = The fuel heating part load efficiency curve
- $Fuel_{partload}$  = The fuel consumption at part load conditions (Btu/h)
- $Fuel_{design}$  = The fuel consumption at design conditions (Btu/h)
- $Q_{partload}$  = The water heater capacity at part load conditions (Btu/h)
- $Q_{rated}$  = The water heater capacity at design conditions (Btu/h)
- $a$  = Constant, 0.021826
- $b$  = Constant, 0.977630
- $c$  = Constant, 0.000543

<i>Baseline Building</i>	The baseline shall use the default curve
--------------------------	--

### 3.9.1.3 Recirculation Systems

This section describes the building descriptors for hot water recirculation systems. The baseline building has a recirculation system when the proposed design does. This is one aspect of the *water heating system configuration* (see above).

#### ***Recirculation System Name***

<i>Applicability</i>	All recirculation systems
<i>Definition</i>	A unique descriptor for each water heating recirculation system
<i>Units</i>	Text, unique
<i>Input Restrictions</i>	Where applicable, this should match the tags or descriptions that are used on plans such that a plan reviewer can make a connection
<i>Baseline Building</i>	The naming convention of the baseline building shall be similar to the proposed design

#### ***Pumping Power***

<i>Applicability</i>	All recirculation systems
<i>Definition</i>	The electric demand of the pumps when the recirculation system is operating. This input is a function of the flow rate, the pumping head, the motor efficiency, and the pump efficiency. Some software may allow each of these factors to be separately entered.
<i>Units</i>	Watts (W)
<i>Input Restrictions</i>	Pumping power shall be consistent with the piping configuration, flow rate, and equipment specified on the construction documents
<i>Baseline Building</i>	Pumping power in the baseline building shall be the same as the proposed design unless specific measures are included in the proposed design to reduce the pumping power. Example measures could include reducing pumping head by oversizing distribution piping or specifying premium efficiency motors or pumps.

#### ***Schedule***

<i>Applicability</i>	All recirculation systems
<i>Definition</i>	An on/off or fraction schedule that indicates when the recirculation system is expected to be operated
<i>Units</i>	Data structure: schedule, on/off or fraction
<i>Input Restrictions</i>	The schedule for operation of the recirculation system shall be consistent with the design intent of the system. Hotels, hospitals, and other 24x7 institutional buildings will typically have a system that runs continuously. The schedule should be consistent with the controls called for on the construction documents: no control (runs constantly), timer control, temperature control, timer/temperature control, or demand control.
<i>Baseline Building</i>	Recirculation schedules for the baseline building shall be the same as the proposed design

**Piping**

<i>Applicability</i>	All recirculation systems
<i>Definition</i>	The heat loss rate of piping for recirculating systems. This may be defined separately for pipe that is exposed to outdoor conditions, indoor or semi-heated conditions, or buried underground conditions.
<i>Units</i>	Btu/h-°F specified separately for outdoor, indoor, or buried locations
<i>Input Restrictions</i>	In accordance with Standard 90.1-2019, Section G3.1.3.6, piping heat losses are not modeled for the proposed building
<i>Baseline Building</i>	Piping losses shall not be modeled for the baseline building.

**3.9.1.4 Water Heating Auxiliaries****External Storage Tank Insulation**

<i>Applicability</i>	All water heating systems that have an external storage tank
<i>Definition</i>	Some water heating systems have a storage tank that is separate from the water heater(s) that provides additional storage capacity. This building descriptor addresses the heat loss related to the external tank, which is an additional load that must be satisfied by the water heater(s).
<i>Units</i>	R-value (h-ft <sup>2</sup> -°F/Btu)
<i>Input Restrictions</i>	As specified in manufacturer data and documented on the construction documents
<i>Baseline Building</i>	Heat loss associated with the storage tank in the baseline building shall meet the requirements for an unfired storage tank in the baseline standards (Standard 90.1-2019, Table 7.8), which is an insulation R-value of 12.5. The surface area and location of the storage tank shall be the same as the proposed design.

**External Storage Tank Area**

<i>Applicability</i>	All water heating systems that have an external storage tank
<i>Definition</i>	Some water heating systems have a storage tank that is separate from the water heater(s) that provides additional storage capacity. This documents the entire exterior surface area of the tank.
<i>Units</i>	ft <sup>2</sup>
<i>Input Restrictions</i>	As specified in manufacturer specifications
<i>Baseline Building</i>	Same as proposed

**External Storage Tank Location**

<i>Applicability</i>	All water heating systems that have an external storage tank
<i>Definition</i>	Location of the storage tank, used to determine the heat loss rate and energy exchange with the surroundings
<i>Units</i>	List: Schedule, Zone, Outdoors
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Same as proposed

**Heat Recovery**

<i>Applicability</i>	Water heating systems that are coupled to heat recovery equipment
<i>Definition</i>	Building equipment such as air conditioners, chillers, gas-fired generators, and others produce thermal energy that may be recovered and used to heat water. The heat-producing characteristics are generally defined for the equipment that is producing the heat, not the equipment that is receiving the heat (water heaters in this case). The building descriptors will vary depending on the equipment. The models for heat-producing equipment need to produce output hourly so that the schedule of heat production and heating needs can be aligned and evaluated in the water heating model.
<i>Units</i>	Data structure: depends on the equipment producing the heat
<i>Input Restrictions</i>	There are no restrictions, other than agreement with the construction documents
<i>Baseline Building</i>	The baseline building requirements for condenser heat recovery are documented in Section 3.8.7 of this manual

**Solar Thermal**

<i>Applicability</i>	Water heating systems with a solar thermal system
<i>Definition</i>	<p>A solar thermal water heating system consists of one or more collectors. Water is passed through these collectors and is heated under the right conditions. There are two general types of solar water heaters: integrated collector storage (ICS) systems and active systems. Active systems include pumps to circulate the water, storage tanks, piping, and controls. ICS systems generally have no pumps and piping is minimal.</p> <p>Solar systems may be tested and rated as a complete system or the collectors may be separately tested and rated. SRCC OG-300 is the test procedure for whole systems and SRCC OG-100 is the test procedure for collectors. The building descriptors used to define the solar thermal system may vary with each software application and with the details of system design.</p> <p>The solar fraction shall be estimated by the f-chart procedure for solar water heating systems.</p>
<i>Units</i>	Data structure: will vary with the software and system details
<i>Input Restrictions</i>	As designed. The proposed design may have a combined space and water heating system.
<i>Baseline Building</i>	Not applicable

**Combined Space Heating and Water Heating**

<i>Applicability</i>	Projects that use a boiler to provide both space heat and water heating
<i>Definition</i>	A system that provides both space heating and water heating from the same equipment, generally the space heating boiler. Such systems are restricted by the baseline standards, but may be modeled in the candidate building. The restrictions are due to the misalignment of the space heating load and the water heating load. The first is highly intermittent and weather dependent, while the latter is more constant and not generally related to the weather.
<i>Units</i>	Data structure
<i>Input Restrictions</i>	As designed. The proposed design may have a combined space and water heating system.
<i>Baseline Building</i>	The baseline building shall be modeled with separate space heating and water heating systems, according to the baseline system type and corresponding requirements in Section 3.1.1 and baseline water heating system type and requirements identified in Section 3.9.1 .

### 3.9.2 Exterior Lighting

All exterior lighting applications shall be included in the model. Exterior lighting applications not connected to the building electricity meter (e.g., street lighting or common area lighting) should not be included.

The building descriptors that are described in this section apply separately to each lighting application; input for each building descriptor is provided for parking lot lighting, façade lighting, entry lighting, and other exterior lighting applications. Each lighting application is modeled as a separate system. Exterior lighting applications affect the electric load of the building but do not produce heat that would need to be removed by the building’s cooling system.

Standard 90.1-2019 groups exterior lighting applications as tradable or non-tradable. Non-tradable lighting applications are “use-it-or-lose-it” categories such that no credit can be applied and the power is the same in the baseline and proposed..

- Tradable applications include uncovered parking areas, building grounds, building entrances and exits, canopies and overhangs, and outdoor sales areas. Thus, the allowed LPD of these applications is multiplied by the associated area or length to yield the baseline power.
- Non-tradable applications can only be used for the specific application and cannot be traded between applications or with other non-tradable applications such as building façades, automated teller machines, guard houses, loading for law enforcement, drive-through windows, or parking near retail.

#### Calculation of Baseline Exterior Lighting Power Allowance

The baseline building exterior lighting power allowance (ELPA) is the sum of all tradable surfaces, plus either the allowance from Table G3.6 or what is installed, whichever is smaller for all non-tradable surfaces.

- Tradable applications: Allowance for tradable surfaces is calculated in accordance to Standard 90.1-2019 Table G3.6
- Other exterior lighting applications: For exterior lighting that is not a part of Standard 90.1-2019 Table G3.6, including building facades, loading areas for emergency vehicles, entrances etc. shall be modeled the same in the baseline building design as in the proposed design.

Trade-offs are allowed for tradable surfaces only. The baseline power for these other exterior lighting applications is the same as the installed power in the proposed design

<i>Exterior Lighting Name</i>	
<i>Applicability</i>	All exterior lighting systems
<i>Definition</i>	A name for the lighting system
<i>Units</i>	Text, unique
<i>Input Restrictions</i>	The name should be descriptive and provide a link to the construction documents
<i>Baseline Building</i>	The baseline building should have a corresponding exterior lighting system that maps to the one in the proposed design. The name should be similar.

**Exterior Lighting Zones**

<i>Applicability</i>	All projects with exterior lighting
<i>Definition</i>	Standard 90.1-2019 identifies five lighting zones for determining exterior lighting power allowance: <ul style="list-style-type: none"> <li>a. Zone 0 - Undeveloped areas within national parks, state parks, forest land, rural areas</li> <li>b. Zone 1 - Developed areas of national parks, state parks, forest land, and rural areas</li> <li>c. Zone 2 - Areas predominantly consisting of residential zoning, neighborhood business districts, light industrial with limited nighttime use, and residential mixed use areas</li> <li>d. Zone 3 - All other areas</li> <li>e. Zone 4 - High activity commercial districts in major metropolitan areas as designated by the local jurisdiction</li> </ul>
<i>Units</i>	List: Zone 0, Zone 1, Zone 2, Zone 3, Zone 4
<i>Input Restrictions</i>	Not applicable
<i>Baseline Building</i>	Not applicable

**Exterior Lighting Category**

<i>Applicability</i>	All projects with exterior lighting
<i>Definition</i>	A classification of each exterior lighting system from Table G3.6 of ASHRAE Standard 90.1-2019. This classification determines the lighting power for the baseline exterior lighting system.. Credit is offered for power reductions for tradable lighting applications, but not for other lighting applications.
<i>Units</i>	List (from Table G3.6 of ASHRAE Standard 90.1-2019)
<i>Input Restrictions</i>	The classification should accurately match the exterior lighting application in the rated building
<i>Baseline Building</i>	Same as the proposed design

### Exterior Lighting Area or Length

<i>Applicability</i>	All exterior lighting systems
<i>Definition</i>	<p>All exterior lighting applications have an associated area or length. This area or length is a factor in determining the baseline building lighting power. The following rules should be taken into account when calculating length or area:</p> <ul style="list-style-type: none"> <li>• Façade illuminated area: Only areas of façade that are illuminated without obstruction are included in the illuminated area.</li> <li>• If the lighted façade area exceeds exterior wall area or if the door linear footage exceeds 25% of building perimeter, the software shall produce a warning.</li> <li>• Uncovered parking: Uncovered parking shall be calculated according to the rules for the parking portion of “Illuminated hardscape” from Title 24-2013. This definition accounts for the paved area that is within 3 times the luminaire mounting height of parking luminaires: “Illuminated area is defined as any area within a square pattern around each luminaire or pole that is six times the mounting height with the luminaire in the middle of the pattern less any area that is within a building, under a canopy, beyond property lines or obstructed by a sign or structure.”<sup>1</sup></li> </ul>
<i>Units</i>	ft <sup>2</sup> or linear feet
<i>Input Restrictions</i>	The area of the exterior lighting application should be determined using the rules in the baseline standard and the associated user’s manual
<i>Baseline Building</i>	Same as proposed

### Exterior Lighting Power

<i>Applicability</i>	All projects with exterior lighting. All exterior lighting connected to the building’s electricity meter should be included.
<i>Definition</i>	The calculated exterior lighting power. For the proposed building, this is referred to as the exterior installed lighting power (EILP), for the baseline building, this is referred to as the exterior lighting power allowance (ELPA).
<i>Units</i>	W or W/ft <sup>2</sup>
<i>Input Restrictions</i>	<p>As designed. The EILP for the proposed design is determined by totaling the installed exterior lighting power for all proposed exterior luminaires that are not exempt from the exterior lighting requirements. (Refer to the section below for a list of exempt exterior lighting applications.)</p> <p>According to Standard 90.1-2019 Section 9.4.2, the EIPA cannot exceed the ELPA as determined in accordance to this section in Standard 90.1-2019. ELPA is determined from the product of the exterior lighting area or length and the allowed power for the exterior lighting category. Trade-offs are allowed only among exterior lighting applications listed as ‘Tradable Surfaces’ in Standard 90.1-2019 Table 9.4.2-2.</p>
<i>Baseline Building</i>	<p>The total ELPA for all exterior building applications is the sum of the individual allowances for areas that are designed to be illuminated and are permitted in Standard 90.1-2019 Table G3.6.</p> <p>ELPA is determined from the product of the exterior lighting area or length and the allowed power for the exterior lighting category. The allowed power is determined from Table 97.</p> <p>For -other lighting applications, not included in the tradabale surfaces, the baseline building lighting power will be the same as the proposed exterior lighting power for those</p>

<sup>1</sup> 2005 T-24 Section 147(c)1A



applications. . For tradeable exterior lighting applications, the lighting power shall be equal to the allowance in Table 97 below, Standard 90.1-2019 Table G3.6.

Table 97. Exterior Lighting Power Allowances for the Baseline Building

Exterior Lighting Category		Power Allowance (all lighting zones)
<i>Tradable</i>		
Uncovered Parking Areas	Parking lots and drives	0.15 W/ft <sup>2</sup>
	Walkways less than 10 ft wide	1.0 W/ft
Building Grounds	Walkways 10 ft wide or greater and Plaza areas	0.2 W/ft <sup>2</sup>
	Special feature areas and Stairways	1.0 W/ft
	Building Entrances and Exits	30 W/ft of door width
Canopies and Overhangs	Main entries	20 W/ft of door width
	Other doors	20 W/ft of door width
Outdoor Sales	Canopies (free standing and attached and overhangs)	1.25 W/ft <sup>2</sup>
	Open areas (including vehicle sales lots)	0.5 W/ft <sup>2</sup>
	Street frontage for vehicle sales lots in addition to open-area allowance	20 W/ft

***Non-Regulated Exterior Lighting Power Allowance***

<i>Applicability</i>	All projects with exterior lighting
<i>Definition</i>	Lighting used for the following exterior applications is exempt when equipped with a control device that complies with the requirements for exterior lighting control, as specified in Standard 90.1-2019 Section 9.4.1.4, and is independent of the control of the nonexempt lighting. These are not required to be included in the total calculated exterior lighting power allowance. <ul style="list-style-type: none"> <li>a. Lighting that is integral to signage and installed in the signage by the manufacturer.</li> <li>b. Lighting for athletic playing areas.</li> <li>c. Lighting for industrial production, material handling, transportation sites, and associated storage areas.</li> <li>d. Theme elements in theme/amusement parks.</li> <li>e. Lighting used to highlight features of public monuments, public art displays, and registered historic landmark structures or buildings.</li> <li>f. Lighting for water features.</li> </ul> <p>Lighting used for the following exterior applications is exempt when controlled separately:</p> <ul style="list-style-type: none"> <li>g. Specialized signal, directional, and marker lighting associated with transportation.</li> <li>h. Lighting integral to equipment or instrumentation and installed by its manufacturer.</li> <li>i. Lighting for theatrical purposes, including performance, stage, film production, and video production.</li> <li>j. Temporary lighting.</li> <li>k. Lighting for hazardous locations.</li> <li>l. Lighting for swimming pools.</li> <li>m. Searchlights.</li> </ul>
<i>Units</i>	W/ft <sup>2</sup> or watts
<i>Input Restrictions</i>	As designed. The exceptions to exterior lighting power allowance should be cross-referenced to the type of exception and to the construction documents.
<i>Baseline Building</i>	Same as proposed

### Exterior Lighting Schedule

<i>Applicability</i>	All exterior lighting systems
<i>Definition</i>	The exterior lighting schedule describes the fraction of installed connected lighting power that is operating for any given hour. The lighting schedule is a matrix of fractional values for each hour of the day and by day of week.
<i>Units</i>	Data structure: schedule, fractional
<i>Input Restrictions</i>	The default exterior lighting schedule shall be from dusk until 1 hour after the indoor lighting schedule drops below emergency lighting level (i.e., below 15%). Custom schedules may be created for atypical operating hours for exterior lighting systems. Each lighting system may operate on its own schedule. The default schedule shall be used as a starting point, however mandatory exterior lighting controls in 90.1-2019 Section 9.4.1.4 will require that the schedules for exterior lighting for certain applications turn off lighting during some nighttime hours. See Exterior Lighting Control below for more details.
<i>Baseline Building</i>	The schedule for the baseline building shall be the same as the proposed design modified to ignore any controls that shuts off exterior lighting during nighttime hours.  <b>NOTE:</b> If exterior lighting loads/schedule for the baseline building differs from the proposed design, this needs to be flagged and reported in the compliance reports.

### Exterior Lighting Control

<i>Applicability</i>	All projects with exterior lighting
<i>Definition</i>	These are mandatory requirements for Standard 90.1-2019, Section 9.4.1.4. Lighting for exterior applications shall meet the following requirements: <ul style="list-style-type: none"> <li>a. Photocell or other device that shuts off lighting during daylight hours</li> <li>b. Automatic shut-off for building façade and landscape lighting between midnight or business closing, whichever is later, and 6 am or business opening, whichever comes first, or between times established by the authorities having jurisdiction.</li> <li>c. All other lighting shall be controlled by time switches that automatically reduce the connected lighting power by at least 30% for at least one of the following conditions <ul style="list-style-type: none"> <li>a. From 12 midnight or within 1 hour of the end of business operations, whichever is later, until 6 am or business opening, whichever is earlier</li> <li>b. During any period when no activity has been detected for a time of no longer than 15 minutes</li> </ul> </li> </ul> <p><b>Exception:</b> Lighting required for safety, security, or eye adaptation</p>
<i>Units</i>	List: Photocell, Automatic Shut-Off, Time Switches
<i>Input Restrictions</i>	As designed, at a minimum meeting the above mandatory requirements
<i>Baseline Building</i>	a. Photocell or other device that shuts off lighting during daylight hours

### 3.9.3 Other Electricity Use

This set of building descriptors should be used to include any miscellaneous electricity use that would add to the electric load of the building and would be on the building meter. These energy uses are assumed to be outside the building envelope and do not contribute heat gain to any thermal zone.

Snow-melt systems prevent snow and ice buildup at building entrances and other critical areas. Systems consist of a heating element, which is embedded in the slab; sensors to detect OATs and moisture; a heating source; and controls to tie the heating element, sensors, and heating source together. The energy modeler should make a reasonable estimate of the energy consumption of the snow-melt system and this estimate shall be used for both the baseline building and the proposed design, e.g., no credit. Other such systems could include outdoor electric grill, exterior sound system etc.

#### **Miscellaneous Electric Power**

<i>Applicability</i>	All buildings with miscellaneous electric equipment located on the building site
<i>Definition</i>	The power for miscellaneous equipment
<i>Units</i>	watts (W)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Same as the proposed

#### **Miscellaneous Electric Schedule**

<i>Applicability</i>	All buildings with miscellaneous electric equipment located on the building site
<i>Definition</i>	The schedule of operation for miscellaneous electric equipment
<i>Units</i>	Data structure: schedule, fractional
<i>Input Restrictions</i>	The schedule specified for the building should match the operation patterns of the system
<i>Baseline Building</i>	Same as proposed

### **3.9.4 Other Gas Use**

This set of building descriptors should be used to include any miscellaneous gas use that would add to the load of the building and would be on the building meter. These energy uses are assumed to be outside the building envelope and do not contribute heat gain to any thermal zone. Examples of these include radiant heaters for outdoor spaces, outdoor gas lighting etc.

#### **Other Gas Power**

<i>Applicability</i>	All buildings that have commercial gas equipment
<i>Definition</i>	Gas power is the peak power, which is modified by the schedule (see below)
<i>Units</i>	Btu/h-ft <sup>2</sup>
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Same as the proposed

#### **Other Gas Schedule**

<i>Applicability</i>	All buildings that have commercial gas equipment
<i>Definition</i>	The schedule of operation for commercial gas equipment
<i>Units</i>	Data structure: schedule, fractional
<i>Input Restrictions</i>	Continuous operation is prescribed
<i>Baseline Building</i>	Same as the proposed

### 3.9.5 Swimming Pools

Swimming pools must meet applicable mandatory requirements mentioned in the sections below.

#### **Pool Name**

<i>Applicability</i>	All pools
<i>Definition</i>	A unique identifier that keys the pool to the construction documents
<i>Units</i>	Text, unique
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	The name for the baseline building pool should be similar to the proposed design

#### **Volume**

<i>Applicability</i>	All pools
<i>Definition</i>	The volume of the pool
<i>Units</i>	Cubic feet (ft <sup>3</sup> )
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as proposed

#### **Surface Area**

<i>Applicability</i>	All pools
<i>Definition</i>	The surface area of the pool affects heat loss and evaporation
<i>Units</i>	Square feet (ft <sup>2</sup> )
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as proposed

#### **Cover**

<i>Applicability</i>	All pools
<i>Definition</i>	An indication
<i>Units</i>	Boolean (yes/no)
<i>Input Restrictions</i>	As designed. Pool covers are required for heated pools in accordance with Standard 90.1-2019 Section 7.4.5.2.
<i>Baseline Building</i>	Pool should be covered when the space is unoccupied

#### **Cover Schedule**

<i>Applicability</i>	All pools
<i>Definition</i>	A schedule indicating when the pool cover is in place
<i>Units</i>	Data structure: schedule, on/off or fractional
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as proposed

**Filtration Rate**

<i>Applicability</i>	All pools
<i>Definition</i>	The rate at which the pool water is passed through the filtering system when the filtration system is operating
<i>Units</i>	Hours per pool change
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as proposed

**Filtration Schedule**

<i>Applicability</i>	All pools
<i>Definition</i>	A schedule indicating when the pool filtration system is in operation
<i>Units</i>	Data structure: schedule, on/off or fractional
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as proposed

**Temperature**

<i>Applicability</i>	All pools
<i>Definition</i>	Temperature at which the pool is maintained
<i>Units</i>	Degrees Fahrenheit (°F)
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as proposed

**Temperature Schedule**

<i>Applicability</i>	All pools
<i>Definition</i>	A schedule indicating variation in the pool temperature, either seasonally or monthly
<i>Units</i>	Data structure: schedule, temperature
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as proposed

**Pumping and Filtration: Pumping Power**

<i>Applicability</i>	All pools
<i>Definition</i>	The power used by the pumping system. This is a function of the pumping head (which depends on pipe lengths, sizes, and filtration type), the pump efficiency, the motor efficiency, and the flow rate. Some software may allow these to be entered as separate building descriptors. This value should be consistent with the filtration rate noted above.
<i>Units</i>	Watts (W)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Same as the proposed design unless the proposed design uses special low head filters and premium efficiency motors

**Heating Equipment: Heater Type**

<i>Applicability</i>	All pools
<i>Definition</i>	The type of equipment that is used to maintain the pool temperature
<i>Units</i>	List: Solar, Heat Pump, Gas, Oil, or Electric Resistance
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	If there is gas or oil on the site, the baseline building shall be modeled with a natural gas or oil pool heater meeting the requirements of Table 7.8 of Standard 90.1-2019. If there is no gas or oil on the site, the baseline building shall be modeled with a heat pump pool heater meeting the requirements of Table 7.8 of Standard 90.1-2019.

**Heating Equipment: Heater Efficiency**

<i>Applicability</i>	All pools with heaters
<i>Definition</i>	The thermal efficiency of the pool heater
<i>Units</i>	Unitless, thermal efficiency
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	See the baseline rules for heater type

**Solar System Features**

<i>Applicability</i>	All pools with solar pool heaters
<i>Definition</i>	The collector area, size, efficiency, and pumping characteristics of the solar pool system
<i>Units</i>	Data structure
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Not applicable

**3.9.6 Transformers****Transformer Type**

<i>Applicability</i>	Buildings with large electric service
<i>Definition</i>	Transformers can be classified as either dry type or liquid filled (usually oil)
<i>Units</i>	List: dry type, liquid filled
<i>Input Restrictions</i>	Transformers can be modeled or not at the discretion of the energy modeler. If they are more efficient than the requirements in Standard 90.1-2019, then they must be modeled in order to take credit.
<i>Baseline Building</i>	If transformers are modeled in the proposed design, then they must also be modeled in the baseline building

### Transformer Efficiency

<i>Applicability</i>	When transformers are modeled for the proposed design
<i>Definition</i>	The efficiency with which transformers transfer electricity from the grid to the building or from onsite generators to the grid.
<i>Units</i>	Percent (%)
<i>Input Restrictions</i>	For new construction, transformers must meet or exceed the efficiency requirements in Table 8.4.4 of Standard 90.1-2019
<i>Baseline Building</i>	Efficiency shall be taken from Table 8.4.4. of Standard 90.1-2019

## 3.10 On-Site Power Generation

Building projects may incorporate on-site electricity generation equipment, such as photovoltaics (PV) and wind turbines or combined heat and power or fuel cells that make electricity and produce heat. These systems may be modeled in various ways. Descriptors have been added below for PV, combined heat and power cogeneration and wind turbines. Fuel cells are not addressed by this manual currently. In all cases, the baseline building will be modeled without heat recovery from on-site generation equipment. If there is no thermal link between the power generation equipment and building equipment (such as heat recovery from combined heat and power [CHP]), on-site power generation can be modeled in a separate process; otherwise, it needs to be linked to the building simulation.

On-site renewable energy shall be subtracted from the proposed design energy consumption prior to calculating the proposed building performance, additional details are provided in Section 1.3. On-site renewable energy generated by systems included on the building permit that is used by the building is considered free and shall not be included in the proposed design energy cost for renewable energy contributions up to 5% of the baseline building performance. When renewable energy contribution of the on-site renewable energy generation system exceeds 5% of the BBP, the PCI will be calculated as explain in Section 1.3 of this manual.

### 3.10.1 Photovoltaic Systems

Candidate buildings may have photovoltaic (PV) systems and the energy generated by these systems may offset the power used by HVAC, lighting, and other building systems. Since most PV systems work under a net metering arrangement whereby the utility grid is used as a storage battery, accepting excess energy when it is available and providing power back to the building at night and other times when the PV system is not generating, the simulation of PV systems need to be on an hourly time step so that it can be aligned with the building loads and the utility rate structure.

This section describes one set of building descriptors for specifying a PV system. This set of building descriptors is based on the five-parameter model (De Soto et al. 2006). Other models may be used for PV systems. The inputs apply only to the proposed design, as the baseline building is modeled without a PV system.

#### 3.10.1.1 Configuration

This set of building descriptors addresses the overall layout and design of the PV system, including the orientation and slope of the collectors, how they are wired together, and how they are linked to an inverter that converts DC power to AC and synchronizes it with the grid.

**PV System Name**

<i>Applicability</i>	All PV systems
<i>Definition</i>	A unique identifier that can be used to reference the PV system and associate it with the construction documents
<i>Units</i>	Text, Unique
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	None (PV not modeled for the baseline building)

**Number of Modules in a String**

<i>Applicability</i>	All PV systems
<i>Definition</i>	This is the number of modules in a series string. Modules in series increase voltage which is often needed in order to match output voltage with the inverter requirements; modules in parallel increase current.
<i>Units</i>	Numeric: Integer
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	None (PV not modeled for the baseline building)

**Number of Strings**

<i>Applicability</i>	All PV systems
<i>Definition</i>	This is the number of strings of modules in parallel. Modules in series increase voltage; modules in parallel increase current.
<i>Units</i>	Numeric: Integer
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	None (PV not modeled for the baseline building)

**Collector Area**

<i>Applicability</i>	All PV systems
<i>Definition</i>	The area of the collector module
<i>Units</i>	Square feet (ft <sup>2</sup> )
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	None (PV not modeled for the baseline building)



**Tilt**

<i>Applicability</i>	All PV systems
<i>Definition</i>	The tilt angle is the angle from horizontal of the photovoltaic modules in the array. For a fixed array, the tilt angle is the angle from horizontal of the array where 0° = horizontal, and 90° = vertical. For arrays with one-axis tracking, the tilt angle is the angle from horizontal of the tracking axis. The tilt angle does not apply to arrays with two-axis tracking.
<i>Units</i>	Degrees (°)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	None (PV not modeled for the baseline building)

**Azimuth**

<i>Applicability</i>	All PV systems
<i>Definition</i>	<p>The azimuth angle is the angle clockwise from true north describing the direction that the array faces. An azimuth angle of 180° is for a south-facing array, and an azimuth angle of 0° is for a north-facing array.</p> <p>For an array with one-axis tracking, the azimuth angle is the angle clockwise from true north of the axis of rotation. The azimuth angle does not apply to arrays with two-axis tracking.</p> <p>The default value is an azimuth angle of 180° (south-facing) for locations in the northern hemisphere and 0° (north-facing) for locations in the southern hemisphere. These values typically maximize electricity production over the year, although local weather patterns may cause the optimal azimuth angle to be slightly more or less than the default values.</p>
<i>Units</i>	Degrees (°)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	None (PV not modeled for the baseline building)

**PV Mounting Height**

<i>Applicability</i>	All PV systems
<i>Definition</i>	The height of the collectors above the ground
<i>Units</i>	Feet (ft)
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	None (PV not modeled for the baseline building)

**PV Array Mounting Type**

<i>Applicability</i>	All PV systems
<i>Definition</i>	The array type describes whether the PV modules in the array are fixed, or whether they move to track the movement of the sun across the sky with one or two axes of rotation.
<i>Units</i>	List: Fixed, one axis tracking, two axis tracking.
<i>Input Restrictions</i>	As designed. The default value is a fixed, or no tracking.
<i>Baseline Building</i>	None (PV not modeled for the baseline building)

### 3.10.1.2 Shading

Shading of PV systems results in significant reduction of production and must be accounted for in an acceptable manner. A method is implied in the following building descriptors that is consistent with the NSHP Calculator.<sup>1</sup> With this method, the area around the solar system is divided into 22.5° cones and the height and distance to shading objects is entered for each quadrant. Other methods may be used, including use of the building shade inputs (see building site characteristics under project data)

#### ***Shading Azimuth***

<i>Applicability</i>	All PV systems
<i>Definition</i>	A quadrant where the height and distance of shading objects is specified
<i>Units</i>	List: ENE, E, ESE, SE, SSE, S, SSW, SW, WSW, W, WNW
<i>Input Restrictions</i>	As estimated from existing surrounding buildings and shading structures
<i>Baseline Building</i>	None (PV not modeled for the baseline building)

#### ***Shading Object Height***

<i>Applicability</i>	All PV systems
<i>Definition</i>	The height of the building or shading object in the 22.5° cone
<i>Units</i>	Feet (ft)
<i>Input Restrictions</i>	As estimated from existing surrounding buildings and shading structures
<i>Baseline Building</i>	None (PV not modeled for the baseline building)

#### ***Shading Object Distance***

<i>Applicability</i>	All PV systems
<i>Definition</i>	The horizontal distance from the shading object to the collectors
<i>Units</i>	Feet (ft)
<i>Input Restrictions</i>	As estimated from existing surrounding buildings and shading structures
<i>Baseline Building</i>	None (PV not modeled for the baseline building)

<sup>1</sup> <http://www.gosolarcalifornia.org/tools/nshpcalculator/index.php>

### 3.10.1.3 Collector Performance

The collector performance can be characterized by the following five variables that are available from PV array manufacturers: the open-circuit voltage, the short-circuit current, the voltage and current at the maximum power-point, and the temperature coefficient of the open-circuit voltage. These are described below.

#### ***Short-Circuit Current***

<i>Applicability</i>	All PV systems
<i>Definition</i>	Isc - current measured with zero voltage
<i>Units</i>	Amps
<i>Input Restrictions</i>	From manufacturer's specification
<i>Baseline Building</i>	None (PV not modeled for the baseline building)

#### ***Open-Circuit Voltage***

<i>Applicability</i>	All PV systems
<i>Definition</i>	Voc - voltage measured with an open circuit
<i>Units</i>	Volts
<i>Input Restrictions</i>	From manufacturer's specification
<i>Baseline Building</i>	None (PV not modeled for the baseline building)

#### ***Maximum Power-Point Voltage and Current***

<i>Applicability</i>	All PV systems
<i>Definition</i>	Imp, Vmp - current and voltage at the maximum power-point condition. These parameters are typically reported at Standard Test Conditions of 1000 W/m <sup>2</sup> and a cell temperature of 25°C.
<i>Units</i>	Amps and Volts
<i>Input Restrictions</i>	From manufacturer's specification
<i>Baseline Building</i>	None (PV not modeled for the baseline building)

#### ***Open-Circuit Temperature Coefficient***

<i>Applicability</i>	All PV systems
<i>Definition</i>	Temperature coefficient of the open circuit voltage (Voc) measures the changing open circuit voltage values of the PV module when the temperature increases (or decreases)
<i>Units</i>	%/°C
<i>Input Restrictions</i>	From manufacturer's specification
<i>Baseline Building</i>	None (PV not modeled for the baseline building)

**Short Circuit Temperature Coefficient**

<i>Applicability</i>	All PV systems
<i>Definition</i>	Temperature coefficient of the short-circuit current ( $I_{sc}$ ) measures the changing short-circuit current values of the PV module when the solar cell temperature increases (or decreases)
<i>Units</i>	%/°C
<i>Input Restrictions</i>	From manufacturer's specification
<i>Baseline Building</i>	None (PV not modeled for the baseline building)

**Nominal Operating Cell Temperature (NOCT)**

<i>Applicability</i>	All PV systems
<i>Definition</i>	The normal operating cell temperature, typically between 45°C and 55°C
<i>Units</i>	Degrees Celsius (°C)
<i>Input Restrictions</i>	From manufacturer's specification
<i>Baseline Building</i>	None (PV not modeled for the baseline building)

**PV Array Mounting Type**

<i>Applicability</i>	All PV systems
<i>Definition</i>	The array type describes whether the PV modules in the array are fixed, or whether they move to track the movement of the sun across the sky with one or two axes of rotation.
<i>Units</i>	List: Fixed, one axis tracking, two axis tracking
<i>Input Restrictions</i>	As designed. The default value is a fixed, or no tracking.
<i>Baseline Building</i>	None (PV not modeled for the baseline building)

**PV Array Mounting Type**

<i>Applicability</i>	All PV systems
<i>Definition</i>	The array type describes whether the PV modules in the array are fixed, or whether they move to track the movement of the sun across the sky with one or two axes of rotation
<i>Units</i>	List: Fixed, one axis tracking, two axis tracking
<i>Input Restrictions</i>	As designed. The default value is a fixed, or no tracking.
<i>Baseline Building</i>	None (PV not modeled for the baseline building)

**3.10.2 Wind Systems**

Wind systems produce electricity and their output depends on the availability of wind at the project site. Wind speed and direction is contained on the climate file used for the building simulation. The building descriptors below assume that the wind turbine is free to pivot to face the wind.

**System Name**

<i>Applicability</i>	All wind systems
<i>Definition</i>	A unique identifier that can be used to reference the wind system and associate it with the construction documents
<i>Units</i>	Text, unique
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	None (Wind systems are not modeled for the baseline building)

**Rated Output**

<i>Applicability</i>	All wind systems
<i>Definition</i>	The rated output of the wind turbine at a given design condition, e.g., wind speed
<i>Units</i>	Kilowatts (kW)
<i>Input Restrictions</i>	As specified by the manufacturer
<i>Baseline Building</i>	None (Wind systems are not modeled for the baseline building)

**Rated Wind Speed**

<i>Applicability</i>	All wind systems
<i>Definition</i>	The wind speed at which the rated output is measured
<i>Units</i>	Miles per hour (mph)
<i>Input Restrictions</i>	As specified by the manufacturer
<i>Baseline Building</i>	None (Wind systems are not modeled for the baseline building)

**Cut-in Wind Speed**

<i>Applicability</i>	All wind systems
<i>Definition</i>	The wind speed above which the system will produce useful power
<i>Units</i>	Miles per hour (mph)
<i>Input Restrictions</i>	As specified by the manufacturer
<i>Baseline Building</i>	None (Wind systems are not modeled for the baseline building)

**Part Load Performance**

<i>Applicability</i>	All wind systems
<i>Definition</i>	The rated capacity gives the power production at one wind speed. The part load performance will generally be a curve that gives the output for wind speeds that are greater or lower than the rated wind speed.
<i>Units</i>	Data structure
<i>Input Restrictions</i>	As specified by the manufacturer
<i>Baseline Building</i>	None (Wind systems are not modeled for the baseline building)

### 3.10.3 Combined Heat and Power Cogeneration Systems

Candidate buildings may have combined heat and power (CHP) cogeneration systems and the energy generated by these systems may offset the power used by HVAC, lighting, and other building systems. Since most CHP systems work under a metering arrangement whereby the building electrical or thermal loads act as a control of the system, the simulation of CHP systems needs to be on the same timestep as the whole building energy simulation so that it can be aligned with the building loads and the utility rate structure.

This section describes one set of building descriptors for specifying a CHP system. This set of building descriptors is based on the DOE 2.2 electric generator with heat recovery scheme. Other models may be used for CHP systems. The heat recovery inputs apply only to the proposed design, as the baseline building is modeled as an electrical generator only without recovered heat.

#### 3.10.3.1 Configuration

This set of building descriptors addresses the overall design of the CHP system, including the type, control, capacity, efficiency and heat recovery possibilities.

##### *CHP System Name*

<i>Applicability</i>	All CHP systems
<i>Definition</i>	A unique identifier that can be used to reference the CHP system and associate it with the construction documents. This is typically listed as an electric generator with or without heat recovery.
<i>Units</i>	Text, Unique
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	Same as Proposed

##### *CHP System Type*

<i>Applicability</i>	All CHP systems
<i>Definition</i>	This building descriptor includes information needed to determine the criteria from baseline standards. The choices are typically Engine Generator, Gas Turbine Generaotor and Steam Turbine Generator.
<i>Units</i>	Text, Unique
<i>Input Restrictions</i>	Engine Generator, Gas Turbine Generaotor and Steam Turbine Generator
<i>Baseline Building</i>	Same As Proposed

**CHP Equipment Capacity**

<i>Applicability</i>	All CHP systems
<i>Definition</i>	This building descriptor includes the nominal full load capacity of the electrical generator portion of the CHP plant expressed in kW. This may be expressed as a range or in separate minimum and maximum ratios
<i>Units</i>	Unitless ratio
<i>Input Restrictions</i>	As Designed (minimum must be > 0)
<i>Baseline Building</i>	Same As Proposed

**CHP Track Mode**

<i>Applicability</i>	All CHP systems
<i>Definition</i>	This building descriptor describes how the cogeneration equipment attached to this meter is to be controlled. This is typically achieved by tracking an electric load of a particular electric meter or a thermal load of the loop to which the waste heat is being rejected or a combination thereof.
<i>Units</i>	<p>Keyword / Code Word</p> <p>The code-word applies to this keyword, and the number in parenthesis the flag value that is equivalent to the code-word when the COGEN-TRACK-SCH is used:</p> <p>DONT-RUN (0)        Specifies that the generators are shut off. This mode of operation allows a COGEN-TRACK-SCH to shut off the generators during certain times of the day or year.</p> <p>TRACK-ELEC (1)       Specifies that the generators are to track the meter's electrical load. This mode works only for UTILITY electric meters, as ELECTRIC-SALE meters do not have any demands that can be tracked.</p> <p>TRACK-THERMAL (2)   Specifies that the generators are to track the thermal load of an attached loop. For this mode to work, each attached generator must also be attached to a hot water loop. Note that, while multiple generators may be on the same electric meter, each of these generators may be attached to the same or different hot water loops, and may therefore be tracking the same or different thermal loads when operating in this mode.</p> <ul style="list-style-type: none"> <li>• When using this mode with a UTILITY meter, it is possible that the generators might produce more electricity than this meter demands. In this case, you should also attach each generator to a meter of type electric sale (via the generator's surplus-sale keyword); otherwise the surplus power will be lost.</li> <li>• When using this mode with an electric-sale meter (as the electric-meter, not the surplus-meter), all power will be sold. The amount generated and sold will then be a function of the thermal demands.</li> </ul> <p>TRACK-LESSER (3)   Specifies that each generator is to track the smaller of this meter's electric demand, and the thermal demand of the generator's attached hot water loop. This mode works only when the generators are also attached to hot water loop</p> <p>TRACK-GREATER (4)   Specifies that each generator is to track the greater of this meter's electric demand, and the thermal demand of the generator's attached hot water loop. This mode works only when the generators are also attached to a hot water loop.</p> <ul style="list-style-type: none"> <li>• When using this mode, it is possible that the generators might produce more electricity than this meter demands. In this case, you should also attach each generator to a meter of type electric-sale (via the generator's surplus-sale keyword); otherwise the surplus power will be lost.</li> </ul> <p>MAX-OUTPUT (5)       Specifies that the generators are to run at maximum output. When using this mode with a utility meter, it is possible that the generators might produce more electricity than this meter demands. In this case, you should also attach each generator to a meter of type electric-sale (via the generator's surplus-sale keyword); otherwise the surplus power will be lost.</p>
<i>Input Restrictions</i>	As Designed per keywords or code words
<i>Baseline Building</i>	No heat recovery is to be modeled in the baseline design so the electrical generator CHP system shall be set to track electric loads only (TRACK-ELEC (1))



**CHP Track Schedule**

<i>Applicability</i>	All CHP systems
<i>Definition</i>	This building descriptor when specified, will override any value given for COGEN-TRACK-MODE. This keyword allows the operational mode of generators to shift according to the time of day or year.
<i>Units</i>	8760 Scheule of type = Flag. Acceptable flag values are 0, 1, 2, 3, 4, and 5, and have the meaning as described for CHP Track Mode.
<i>Input Restrictions</i>	As designed
<i>Baseline Building</i>	No heat recovery is to be modeled in the baseline design so the electrical generator CHP system shall be set to track electric loads only (TRACK-ELEC (1)) for all hours that the generator is available to run per the proposed operating schedule.

**CHP Performance range**

<i>Applicability</i>	All CHP systems
<i>Definition</i>	This building descriptor includes the operational range as a decimal relative to the CHP equipment capacity
<i>Units</i>	Text, Unique
<i>Input Restrictions</i>	As Designed
<i>Baseline Building</i>	Same As Proposed

**CHP Equipment Capacity**

<i>Applicability</i>	All CHP systems
<i>Definition</i>	This building descriptor specifies the ratio of design fuel consumption to design electrical output, when both are in the same units. Note that for DOE 2.2 this entry is in terms of the higher heating value of the fuel and should be verified based upon the simulation protocol utilized.
<i>Units</i>	Unitless ratio
<i>Input Restrictions</i>	As Designed (must be > 0)
<i>Baseline Building</i>	Same As Proposed

**CHP Heat Recovery Loop**

<i>Applicability</i>	All CHP systems
<i>Definition</i>	This building descriptor specifies the loop to which this generator will recover exhaust heat
<i>Units</i>	Text, Unique
<i>Input Restrictions</i>	As Designed (must be > 0)
<i>Baseline Building</i>	None – no heat is to be recovered in the baseline building

### CHP Heat Recovery Performance Curve

<i>Applicability</i>	All CHP systems
<i>Definition</i>	This building descriptor specifies the efficiency of the cogeneration equipment to recover heat as a function of the instantaneous performance (expressed as part load ratio) Specifically this descriptor specifies the variation in full-load recoverable exhaust heat with part load ratio. The factor is set as a curve and must be normalized to 1.0 at a part load ratio of 1.0.
<i>Units</i>	Percent (%)
<i>Input Restrictions</i>	As Designed - Quadric Curve with Input Coefficients ( $Z = a + bX + cX^2$ )
<i>Baseline Building</i>	Default Coefficients $a = 0.29562601$ , $b = 0.4930194$ , $c = 0.21135481$

## 3.11 Common Data Structures

This section describes common data structures referenced in this chapter. The data structures presented here define objects and example parameters needed to define them. The parameters described are the most common for energy simulation engines. Other parameters or data constructs are acceptable; however, the fields used by the simulation program must be mapped to the fields used by the building descriptor.

### 3.11.1 Schedule

This data structure provides information on how equipment, people, lights, or other building items are operated hourly to best represent overall building utilization and availability. The ultimate construct of a schedule is an hourly time series for the simulation period, typically 8,760 hours (365 days, 24 hours per day). However, software has often built up the hourly schedule from 24-hour schedules for different day types: weekdays, Saturdays, Sundays, holidays, design conditions etc.

There are several types of schedules:

- Temperature** schedules specify a temperature to be maintained in a space, a temperature to be delivered from an air handler, or the leaving temperature from a chiller or other equipment.
- Fraction** schedules specify the fraction of lights that are on, the fraction of people that are in the space, the fraction of maximum infiltration, lighting controls or other factors.
- On/off** schedules specify when equipment is operating, damper operation (open/closed based on occupancy) or when infiltration is occurring.
- Time period** schedules define periods of time for equipment sequencing, utility tariffs, etc. A time period schedule typically breaks the year in to two or more seasons. For each season, day types are identified such as weekday, Saturday, Sunday, and holidays. Each day type in each season is then divided into time periods.
- Flag Schedules accept a flag of any value.** The flag value must exactly match a comparison criterion for the component to be active. For example for cogeneration systems, a flag schedule could be created to indicate what a cogeneration system should track. A flag value of 1 could mean that the cogen equipment should track electric load, a value of 2 could mean track the thermal load, 3 could mean the lesser of the electric or thermal load, etc.

### 3.11.2 Holidays

A series of dates defining holidays for the simulation period. Dates identified are operated for the schedule specified for holidays.

### 3.11.3 Surface Geometry

This data structure represents the location, size, and position of a surface. Surfaces include roofs, walls, floors, and partitions. Surfaces are typically planar and can be represented in various manners, including the following:

- Rectangular surfaces may be represented by a height and width along with the X, Y, and Z of surface origin and the tilt and azimuth
- Surfaces may also be represented by a series of vertices (X, Y, and Z coordinates defining the vertices of a surface). More complex polygons may be represented in this manner.

### 3.11.4 Opening Geometry

This data structure represents the location and size of an opening within a surface. The most common method of specifying the geometry of an opening is to identify the parent surface, the height and width of the opening, and the horizontal and vertical offset (X and Y coordinates relative to the origin of the parent surface). An opening can also include a recess into the parent surface, which provides shading. However, other geometric constructs are acceptable.

### 3.11.5 Shading Devices

This data structure describes the dimensions and position of external shading devices such as overhangs, side fins, or louvers that shade the building. Overhangs are specified in terms of the projection distance, height above the opening, and extension distance on each side of the opening.

### 3.11.6 Construction Assembly

This data structure describes the layers that make up the construction of a wall, roof, floor, or partition. Typically, a construction consists of a sequence of materials, described from the outside surface to the inside surface.

### 3.11.7 Fenestration Construction

This data structure describes the frame, glass, air gap and other components of a window or skylight. Information may be defined in multiple ways, but the criteria themselves are published as a combination of U-factor, solar heat gain coefficient (SHGC), and visible light transmission (VT) for the installed fenestration assembly. Some simulation programs use more detailed methods of describing the performance of fenestration that take into account the angle of incidence of sun striking the fenestration and other factors, such as the properties of each pane and the fill. Some simulation programs only use whole window performance properties (U-factor, SHGC, VT).

### 3.11.8 Material

This data structure describes a material that is used to build up a construction assembly. Typical material properties include specific heat, density, conductivity, and thickness. Materials can also be described in terms of their thermal resistance. The latter approach is sometimes used to approximate construction

layers that are not homogeneous, such as framing members in combination with cavity insulation. Material properties may include emissivity, reflectivity, and roughness. The first two govern radiation exchange from the surface, while the latter governs the magnitude of the exterior air film resistance. Fenestration material might include additional properties for transmittance and reflectance.

### **3.11.9 Slab Construction**

This data structure describes the composition of a slab-on-grade. The model has building descriptors for the perimeter length and the F-factor, which represents the heat loss per lineal foot.

### **3.11.10 Occupant Heat Rate**

This data structure represents the rate of heat and moisture generated by building occupants. This is typically specified in terms of a sensible heat rate and a latent heat rate. Both are specified in Btu/h.

### **3.11.11 Furniture and Contents**

This data structure represents the thermal mass effect of furniture and other building contents. This is expressed in terms of lb/ft<sup>2</sup> for the space in question.

### **3.11.12 Reference Position in a Space**

This data structure locates a reference point in a space, typically for the purposes of daylighting control. The typical construct for the reference point is a set of coordinates (X, Y, and Z) relative to the space coordinate system.

### **3.11.13 Two Dimensional Curve**

This data structure explains one parameter in terms of another. An example is a curve that modifies the efficiency of an air conditioner relative to the fraction of time that the equipment operates within the period of an hour, for example. The relationship can be expressed in terms of the X and Y coordinates of points on the curve or it can be expressed as an equation.

### **3.11.14 Three-Dimensional Curve**

This data structure explains one parameter in terms of two others. An example is a curve that modifies the efficiency of an air conditioner relative to the outside air dry-bulb temperature and the wet-bulb temperature of air returning to the coil. The relationship is a three-dimensional surface and can be expressed in terms of the X and Y coordinates of points on the curve or it can be expressed as an equation.

## 4.0 Energy Price Data

Annual energy costs shall be determined using either actual rates of purchased energy or the state average energy prices published by the Energy Information Administration (EIA). Rates from different sources cannot be mixed for the same project.

### Currency

<i>Applicability</i>	All projects
<i>Definition</i>	The currency used to compare the proposed design and the baseline building
<i>Units</i>	List: Custom Energy Costs, Default State Average Energy Costs
<i>Input Restrictions</i>	The default is state average energy costs as published by the EIA
<i>Baseline Building</i>	Same as the proposed design

## 4.1 State Average Energy Costs

The building descriptors specified below are used when the currency type is Default State Average Energy Costs.

### State Average Electric Utility Rates

<i>Applicability</i>	When Currency (see above) is “state average energy costs”
<i>Definition</i>	The state average electricity prices are published by DOE’s EIA for commercial building customers
<i>Units</i>	\$/kWh
<i>Input Restrictions</i>	The energy prices are prescribed and cannot be overwritten
<i>Baseline Building</i>	The baseline building shall use the same utility rate as the proposed design

### State Average Natural Gas Utility Rates

<i>Applicability</i>	When Currency (see above) is “state average energy costs”
<i>Definition</i>	The utility rates for natural gas delivered to the building. The state average gas prices are published by EIA for commercial building customers.
<i>Units</i>	\$/therm
<i>Input Restrictions</i>	The energy prices are prescribed and cannot be overwritten
<i>Baseline Building</i>	The baseline building shall use the same utility rate as the proposed design

### State Average Oil Utility Rates

<i>Applicability</i>	When Currency (see above) is “state average energy costs”
<i>Definition</i>	The utility rates for oil delivered to the building. The state average gas prices are published by EIA for commercial building customers.
<i>Units</i>	Data structure
<i>Input Restrictions</i>	The energy prices are prescribed and cannot be overwritten
<i>Baseline Building</i>	The baseline building shall use the same utility rate as the proposed design

## 4.2 Custom Energy Costs

For more detailed analysis of utility rates, the sections below may be used. This section defines the approach for using tariffs, specifying energy and demand charges, ratchets, etc.

### 4.2.1 Utility Costs: Tariffs

This object can be used to define the name of the tariff, the type of tariff, and other details about the overall tariff.

#### *Tariff Name*

<i>Applicability</i>	All projects using custom utility rates
<i>Definition</i>	A unique identifier for the tariff being calculated. The name is used in identifying the output results and in associating all of the charges and other objects that make up a tariff.
<i>Units</i>	Text
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as proposed

**Tariff Meter**

<i>Applicability</i>	All projects using custom utility rates
<i>Definition</i>	<p>Specifies the type of meter the tariff will accept to calculate energy used or demand:</p> <ul style="list-style-type: none"> <li>• Electricity: Specifies that the meter (s) will be electric.</li> <li>• Gas: Specifies that the meter(s) will be natural gas.</li> <li>• Gasoline: Specifies that the meter(s) will be gasoline.</li> <li>• Diesel: Specifies that the meter(s) will be diesel.</li> <li>• Coal: Specifies that the meter(s) will be coal.</li> <li>• FUEL-OIL#1: Specifies that the meter(s) will be fuel oil #1.</li> <li>• FUEL-OIL#2: Specifies that the meter(s) will be fuel oil #2.</li> <li>• Propane: Specifies that the meter(s) will be propane.</li> <li>• Steam: Specifies that the meter(s) will be steam.</li> <li>• District Heating: Specifies that the meter(s) will be purchased hot water.</li> <li>• District Cooling: Specifies that the meter(s) will be purchased chilled water.</li> <li>• Electricity Purchased: Specifies that the meter(s) will be purchased electricity. This meter is quantity of electricity purchased from the utility and is always positive.</li> <li>• Electricity Surplus Sold: Specifies that the meter(s) will be the surplus electricity sold to the grid. This meter is the excess electricity produced and sent out to the electrical grid. This value is always positive and indicates the surplus electricity from generation that exceeds whole building demand and fed into the grid.</li> <li>• Electricity Net Purchased: This meter is the net electricity purchased from the utility. This value can be either positive or negative. Positive values are defined as electricity purchased from the utility. Negative values are defined as surplus electricity fed back into the grid.</li> </ul>
<i>Units</i>	List of all the output meters mentioned above
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as proposed

### ***Net Metering Option***

<i>Applicability</i>	All projects using custom utility rates
<i>Definition</i>	<p>This input sets whether the specified tariff is used for buying, selling or both to the utility. The choices are:</p> <ul style="list-style-type: none"> <li>• Buy From Utility: The values from the metered variable are used and are shown as being purchases from the utility. The corresponding meter for this option should be specified as “Electricity Purchased.”</li> <li>• Sell To Utility: The values from the metered variable are used for a “sell back” rate to the utility. The charges in the rate should be expressed as negative values. The corresponding meter for this option should be specified as “Electricity Surplus Sold.”</li> <li>• Net Metering: Negative values are used to reduce any positive values during the specific period on the tariff when negative values occur. The corresponding meter for this option should be specified as “Electricity Net Purchased.”</li> </ul>
<i>Units</i>	List: Buy From Utility, Sell To Utility, Net Metering
<i>Input Restrictions</i>	None. The default selection for this input is Buy From Utility.
<i>Baseline Building</i>	Same as proposed



### Conversion Factors

*Applicability* All projects using custom utility rates

*Definition* A choice that allows several different predefined conversion factors to be used. These multipliers are used to convert energy and/or demand into the units specified by the utility in their tariff.

- kWh
- Therm
- MMBtu
- Megajoule (MJ)
- KBtu
- Mil cubic feet (MCF)
- Centum cubic feet (CCF)

The following table shows the conversion factors for each of the units. The simulation results for energy use are in joules (J) and energy demand are in watts (W). The conversion factors specified below are used to convert energy and demand to the corresponding unit.

Choice	Energy Conversion Factor	Demand Conversion Factor
kWh	2.778E-07	0.001
Therm	9.48E-09	0.00003412
MMBtu	9.48E-10	0.000003412
MJ	0.000001	0.0036
KBtu	9.48E-07	0.003412
MCF	9.48E-10	0.000003412
CCF	9.48E-09	0.00003412

*Units* List of the unit choice or user defined

*Input Restrictions* One of the units defined in the list. If “User Defined” is selected, the corresponding energy and demand conversion factor needs to be provided.

*Baseline Building* Same as proposed

#### 4.2.2 Utility Costs: Charges

Utility charges can be energy charges or demand charges. Energy or demand charges can be either a fixed flat rate based on consumption, or vary based on time of use (TOU) or season of use. Some utilities also follow real-time pricing where tariffs can change frequently. Also with charges based on consumption, a

utility may also charge a fixed monthly fee irrespective of energy use or energy demand. The descriptors in the section below describe each of these charges.

### ***Tariff Variability***

<i>Applicability</i>	All projects using custom utility rates
<i>Definition</i>	<p>Tariffs can be defined as a flat rate, or vary by the TOU, season or a real-time pricing. The variance in tariff can be defined through one or more of the variables below.</p> <ul style="list-style-type: none"> <li>• Monthly <p>This would be a flat monthly rate charged by the utility per customer. This is irrespective of energy use or energy demand.</p> </li> <li>• Time of Use Period Schedule <p>This schedule defines the time-of-use periods that occur each day. The different variables that can occur in a day are</p> <ul style="list-style-type: none"> <li>– Peak</li> <li>– Shoulder</li> <li>– Off-peak</li> <li>– Mid-peak</li> </ul> <p>Both energy and demand charges can be defined for each TOU period.</p> </li> <li>• Seasonal Schedules</li> <li>• Utilities can also vary tariffs based on season. Tariffs can be defined for the following seasons <ul style="list-style-type: none"> <li>– Winter</li> <li>– Spring</li> <li>– Summer</li> <li>– Autumn</li> </ul> </li> </ul>
<i>Units</i>	List: Monthly Charge, TOU Period Schedule, Seasonal Schedule
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as proposed

### ***Time of Use Period Schedule***

<i>Applicability</i>	All projects using custom utility rates
<i>Definition</i>	<p>Unique name of a yearly schedule that specifies the TOU type for the entire year. The schedule specifies months and times in a year billed as peak, shoulder, off-peak, or mid-peak. This schedule is used for all TOU energy billing. TOU demand charges are calculated using the block-charges input.</p>
<i>Units</i>	Schedule name with TOU variables defined
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as proposed

**Seasonal Schedule**

<i>Applicability</i>	All projects using custom utility rates
<i>Definition</i>	Unique name of a yearly schedule that specifies the season type for the entire year. The schedule specifies months in a year billed using winter, summer, autumn, or spring tariffs. This schedule is used for the billing of all seasonal energy and demand charges using the block charges input.
<i>Units</i>	Schedule name with seasonal variables defined
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as proposed

**Demand Window**

<i>Applicability</i>	All projects using custom utility rates
<i>Definition</i>	<p>The determination of demand can vary by utility. Some utilities use the peak instantaneous demand measured, but most use a 15-minute average demand or a 1-hour average demand. Some gas utilities measure demand as the use during the peak day or peak week.</p> <p>The choices for demand window are:</p> <ul style="list-style-type: none"> <li>• Quarter hour</li> <li>• Half hour</li> <li>• Full hour</li> <li>• Day</li> <li>• Week</li> </ul> <p>The value for demand window must coincide with the value for number of timesteps. This is explained in Section 3.2.6 of this manual.</p>
<i>Units</i>	List: Quarter Hour, Half Hour, Full Hour, Day, Week
<i>Input Restrictions</i>	None. If no value is entered, Quarter Hour is assumed.
<i>Baseline Building</i>	Same as proposed

**Monthly Charge**

<i>Applicability</i>	All projects using custom utility rates
<i>Definition</i>	Many utilities refer to this as a customer charge. This input accepts a list of 12 numeric values that add a fixed monthly charge to each billing cycle. If a single value is entered, the value will be used for all 12 billing periods.
<i>Units</i>	\$/month
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as proposed

**Energy Charge: Simple**

<i>Applicability</i>	All projects using custom utility rates
<i>Definition</i>	Energy charges are the charges associated with the energy use during a billing period. This input accepts a numeric value that allows specification of an energy charge that is constant with time and quantity, or a list of 12 values that allows the specification of an energy charge that is constant with quantity but may vary by billing period. Energy charges that vary with quantity are defined in the descriptor Block Charges.
<i>Units</i>	\$/unit
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as proposed

**Demand Charge: Simple**

<i>Applicability</i>	All projects using custom utility rates
<i>Definition</i>	Demand charges are the charges associated with the energy demand for the billing period. This input accepts either a single value that specifies a demand charge that is constant with time and quantity, or a list of 12 values that allows the specification a demand charge that is constant with quantity but may vary by billing period. The units are \$/peak-unit. As few as one value may be entered in the list, which will be used for all months within the billing period. Demand charges that vary with the quantity of demand, are defined in the descriptor Block Charges.
<i>Units</i>	\$/peak-unit
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as proposed

**Energy Charge: Block**

<i>Applicability</i>	All projects using custom utility rates
<i>Definition</i>	Block charges define the energy charges that vary according to the amount of energy used. The time period over which a block energy charge is to be used needs to be defined. <ul style="list-style-type: none"> <li>• For TOU energy charges, the time period can be off-peak, peak, shoulder, mid-peak. If no TOU rates apply, then the time period should be annual.</li> <li>• For seasonal energy charges, the time period can be summer, winter, autumn, or spring. If no seasonal rates apply, then the time period should be annual.</li> </ul>
<i>Units</i>	List: For TOU energy charges, the options should be Annual, Off Peak, Peak, Mid-Peak, Shoulder. For seasonal energy changes, the options should be Annual, Summer, Winter, Autumn, Spring.
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as proposed

**Demand Charge: Block**

<i>Applicability</i>	All projects using custom utility rates
<i>Definition</i>	Block charges defines the demand charges that vary according to the energy demand. The time period over which a block demand charge is to be used needs to be defined. <ul style="list-style-type: none"> <li>• For TOU demand charges, the time period can be off-peak, peak, shoulder, or mid-peak. If no TOU rates apply, then the time period should be annual.</li> <li>• For Seasonal demand charges, the time period can be summer, winter, autumn, or spring. If no seasonal rates apply, then the time period should be annual.</li> </ul>
<i>Units</i>	List:  For TOU demand charges, the options should be Annual, Off Peak, Peak, Mid-Peak, Shoulder.  For seasonal demand changes, the options should be Annual, Summer, Winter, Autumn, Spring.
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as proposed

**Block Charges: Limits**

<i>Applicability</i>	All projects using custom utility rates
<i>Definition</i>	Block charges define the energy or demand charges that vary according to the amount used. The limits for the blocks need to be defined either in kW for demand charges or kWh for energy charges, along with the energy cost for each block.
<i>Units</i>	For demand charges: kW and \$/kW for each of the block  For energy charges: kWh and \$/kW for each of the blocks  Up to 15 blocks may be specified for each group.
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as proposed

**4.2.3 Utility Costs: Ratchets**

Ratchets allow the modeling of tariffs that include some type of seasonal ratcheting. Ratchets are most common when used with electric demand charges. A ratchet is when a utility requires that the demand charge for a month with a low demand may be increased to be more consistent with a month that set a higher demand charge.

The time period over which the ratchet is calculated is defined by inputs for “Season From” and “Season To.” Ratchets take the hourly metered values as calculated in the parent tariff and determine a peak quantity for each billing period. If a season is specified, the ratchet may compute the demand for a specific season, such as summer. In addition, the ratcheted demand may be adjusted by an offset or multiplied by a fraction. A value is calculated for each billing period for use in associated tariff and block-charge.

**Ratchet Name**

<i>Applicability</i>	All projects using custom utility rates
<i>Definition</i>	A unique identifier for the ratchet being defined calculated. The name is used in identifying the output results and in associating all of the charges and other objects that are affected by the ratchet. Along with the name of the ratchet, the associated tariff also needs to be specified.
<i>Units</i>	Text
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as proposed

**Season From**

<i>Applicability</i>	All projects using custom utility rates
<i>Definition</i>	This input is the name of the season that is being examined. The maximum value for all of the months in the named season is what is used with the ratchet multiplier fraction and ratchet offset value. This is most commonly summer or annual.
<i>Units</i>	List: Summer, Winter, Spring, Autumn, Annual, Monthly  This input also requires a descriptor for Seasonal Schedule that defines the months for each season
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as proposed

**Season To**

<i>Applicability</i>	All projects using custom utility rates
<i>Definition</i>	This input is the name of the season that the ratchet applies to. This is most commonly winter or annual. The ratchet only applies to the months in the names season.
<i>Units</i>	List: Summer, Winter, Spring, Autumn, Annual, Monthly  This input also requires a descriptor for Seasonal Schedule that defines the months for each season
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as proposed

**Ratchet Multiplier Fraction**

<i>Applicability</i>	All projects using custom utility rates
<i>Definition</i>	This is the value by which the peak demand in the months defined under Season From are multiplied to calculate the minimum demand applicable to months defined under Season To. The higher of the actual month demand or this calculated value is used to specify the demand for the applicable month. If both ratchet multiplier and ratchet offset are defined, the multiplier is applied to the offset demand or energy value, which then determines the minimum demand or energy for a month.
<i>Units</i>	Text
<i>Input Restrictions</i>	None. Default is 1.
<i>Baseline Building</i>	Same as proposed

***Ratchet Offset Value***

<i>Applicability</i>	All projects using custom utility rates
<i>Definition</i>	An offset may be defined that can either be added (in case of a positive offset) or subtracted (in case of a negative offset) from the calculated demand. The demand offset value (in kW) needs to be defined, which would be applied to the peak demand. If both ratchet multiplier and ratchet offset are defined, the multiplier is applied to the offset demand or energy value, which then determines the minimum demand or energy for a month.
<i>Units</i>	Number
<i>Input Restrictions</i>	None
<i>Baseline Building</i>	Same as proposed

## 5.0 Reporting

This chapter summarizes the requisite content and format of the PRM-RM standard reports. The establishment of these standard reporting requirements will standardize the way energy modeling output data is presented to various rating authorities. By standardizing the reports, all rating authorities will be able to view the same building information and evaluate the project for certification, labeling, or tax credit. Section G1.3.2 requires that documentation is provided to the rating authority in a report that include the following:

- a. A brief description of the project, the key energy efficiency improvements compared with the requirements in Sections 5 through 10, the simulation program used, the version of the simulation program, and the results of the energy analysis. This summary shall contain the calculated values for the baseline building performance, the proposed building performance, and the percentage improvement.
- b. An overview of the project that includes the number of stories (above and below grade), the typical floor size, the uses in the building (e.g., office, cafeteria, retail, parking, etc.), the gross area of each use, and whether each use is conditioned space.
- c. A list of the energy-related features that are included in the design and on which the performance rating is based. This list shall document all energy features that differ between the models used in the baseline building performance and proposed building performance calculations.
- d. A list showing compliance for the proposed design with all the requirements of Sections 5.4, 6.4, 7.4, 8.4, 9.4, and 10.4 (mandatory provisions).
- e. A list identifying those aspects of the proposed design that are less stringent than the requirements of Sections 5.5, 6.5, 7.5, 9.5, and 9.6 (prescriptive provisions).
- f. A table with a summary by end use of the energy cost savings in the proposed building performance.
- g. A site plan showing all adjacent buildings and topography that may shade the proposed building (with estimated height or number of stories).
- h. Building elevations and floor plans (schematic is acceptable).
- i. A diagram showing the thermal blocks used in the computer simulation.
- j. An explanation of any significant modeling assumptions.
- k. Backup calculations and material to support data inputs (e.g., U-factors for building envelope assemblies, NFRC ratings for fenestration, end-uses identified in Table G3.1, “1. Design Model,” paragraph [a]).
- l. Input and output reports from the simulation program or compliance software, including a breakdown of energy use by at least the following components: lights, internal equipment loads, service water-heating equipment, space-heating equipment, space-cooling and heat rejection equipment, fans, and other HVAC equipment (such as pumps). The output reports shall also show the amount of unmet load hours for both the proposed design and baseline building design.
- m. Purchased energy rates used in the simulations.
- n. An explanation of any error messages noted in the simulation program output. For any exceptional calculation methods employed, document the predicted energy savings by energy type, the energy cost savings, a narrative explaining the exceptional calculation method performed, and theoretical or empirical information supporting the accuracy of the method.



- o. The reduction in proposed building performance associated with on-site renewable energy.
- p. The version of the software and the link to the website that contains the ASHRAE Standard 140 results for the version used in accordance with Section G2.2.4.

PNNL and Karpman Consulting have developed [compliance forms and an associated review manual](#) that meets the documentation requirements listed above.

## 6.0 References

- ANSI/ASHRAE. 2013d. *ANSI/ASHRAE Standard 170-2013, Ventilation of Health Care Facilities*. American Society of Heating, Refrigerating and Air-Conditioning Engineers, Atlanta, Georgia
- ANSI/ASHRAE. 2013c. *ANSI/ASHRAE Standard 55-2013, Thermal Environmental Conditions for Human Occupancy*. American Society of Heating, Refrigerating and Air-Conditioning Engineers, Atlanta, Georgia.
- ANSI/ASHRAE. 2017. *ANSI/ASHRAE Standard 140-2017, Standard Method of Test for the Evaluation of Building Energy Analysis Computer Programs*. American Society of Heating, Refrigerating and Air-Conditioning Engineers, Atlanta, Georgia.
- ANSI/ASHRAE (2004). *ANSI/ASHRAE Standard 62.1-2004, Ventilation for Acceptable Indoor Air Quality*. American Society of Heating, Refrigerating and Air-Conditioning Engineers, Atlanta, Georgia.
- ANSI/ASHRAE (2007). *ANSI/ASHRAE Standard 62.1-2007, Ventilation for Acceptable Indoor Air Quality*. American Society of Heating, Refrigerating and Air-Conditioning Engineers, Atlanta, Georgia.
- ANSI/ASHRAE (2013b). *ANSI/ASHRAE Standard 62.1-2013, Ventilation for Acceptable Indoor Air Quality*. American Society of Heating, Refrigerating and Air-Conditioning Engineers, Atlanta, Georgia.
- ANSI/ASHRAE/IES (2010). *ANSI/ASHRAE/IES 90.1-2010, Energy Standard for Buildings Except Low-Rise Residential Buildings*. American Society of Heating, Refrigerating and Air-Conditioning Engineers, Atlanta, Georgia.
- ANSI/ASHRAE/IES (2013). *ANSI/ASHRAE/IES 90.1-2013, Energy Standard for Buildings Except Low-Rise Residential Buildings*. American Society of Heating, Refrigerating and Air-Conditioning Engineers, Atlanta, Georgia.
- ANSI/ASHRAE/IES (2016). *ANSI/ASHRAE/IES 90.1-2016, Energy Standard for Buildings Except Low-Rise Residential Buildings*. American Society of Heating, Refrigerating and Air-Conditioning Engineers, Atlanta, Georgia.
- ANSI/ASHRAE/IES (2019). *ANSI/ASHRAE/IES 90.1-2019, Energy Standard for Buildings Except Low-Rise Residential Buildings*. American Society of Heating, Refrigerating and Air-Conditioning Engineers, Atlanta, Georgia.
- ASHRAE (2009). *Handbook of Fundamentals*. American Society of Heating, Refrigerating and Air-Conditioning Engineers, Atlanta, Georgia.
- ASHRAE (2017). *Handbook of Fundamentals*. American Society of Heating, Refrigerating and Air-Conditioning Engineers, Atlanta, Georgia.
- ASTM (2010). *ASTM E779, Standard Test Method for Determining Air Leakage Rate by Fan Pressurization*. American Society for Testing and Materials, West Conshohocken, Pennsylvania.
- CEC - California Energy Commission (2013b). *2013 Building Energy Efficiency Standards*. California Energy Commission, Sacramento, CA.

CEC - California Energy Commission (2013). *2013 Nonres ACM Reference Listing*. Retrieved October 8, 2015, from ca.gov: [http://www.energy.ca.gov/title24/2013standards/implementation/documents/2013\\_nonres\\_ACM\\_reference/](http://www.energy.ca.gov/title24/2013standards/implementation/documents/2013_nonres_ACM_reference/).

CEC - California Energy Commission (2016). *2016 Nonres ACM Reference Listing*. Retrieved September 5, 2017, from ca.gov: <http://www.energy.ca.gov/2015publications/CEC-400-2015-037/CEC-400-2015-037-CMF.pdf>.

COMNET (2017). Retrieved from Commercial Buildings Energy Modeling Guidelines & Procedures: <http://www.comnet.org/reference-appendices>

De Soto, W., Klein, S. A., & Beckman, W. A. (2006). "Improvement and validation of a model for photovoltaic array performance." *Solar Energy* 80(1):78-88.

IMC (2012). International Mechanical Code 2012. International Code Council. <https://codes.iccsafe.org/public/document/code/287/4962363>

IMC (2015). International Mechanical Code 2015. International Code Council. <https://codes.iccsafe.org/public/document/code/549/9788963>

[Karpman 2019. Whole Building Performance Energy Modeling Guidelines for Connecticut. Version 3.1. September 2019. https://www.energizect.com/sites/default/files/WBP-EMG-V3.1-Final-Sept-2019.pdf. Accessed on February 2021.](https://www.energizect.com/sites/default/files/WBP-EMG-V3.1-Final-Sept-2019.pdf)

PRM-RM 2010. ANSI/ASHRAE/IES Standard 90.1-2010 Performance Rating Method Reference Manual, PNNL-25130 [http://www.pnnl.gov/main/publications/external/technical\\_reports/PNNL-25130.pdf](http://www.pnnl.gov/main/publications/external/technical_reports/PNNL-25130.pdf)

Rosenberg, M., & Hart R. (2016) *Developing Performance Cost Index Targets for ASHRAE Standard 90.1 Appendix G - Performance Rating Method*. PNNL-25202-Rev1. Pacific Northwest National Laboratory, Richland, Washington. [http://www.pnnl.gov/main/publications/external/technical\\_reports/PNNL-25202Rev1.pdf](http://www.pnnl.gov/main/publications/external/technical_reports/PNNL-25202Rev1.pdf)

Thornton, B.A, M Rosenberg, EE Richman, W Wang, Y Xie, J Zhang, H Cho, VV Mendon, RA Athalye, and B Liu. 2011. *Achieving the 30% Goal: Energy and Cost Savings Analysis of ASHRAE Standard 90.1-2010*. PNNL-20405, Pacific Northwest National Laboratory, Richland, Washington. [http://www.pnl.gov/main/publications/external/technical\\_reports/PNNL-20405.pdf](http://www.pnl.gov/main/publications/external/technical_reports/PNNL-20405.pdf)

Trane (2016). <https://www.trane.com/Commercial/Uploads/PDF/11598/News-%20Free%20Cooling%20using%20Water%20Economizers.pdf>. Accessed on June, 2017.

Tregenza P., & Waters, I. (1983). "Daylight coefficients." *Lighting Research and Technology* 15(2):65-71.

USDOE (2015). *EnergyPlus*. <http://energyplus.net>. Content last updated February 4, 2015.

Winkelmann, F., & S. Selkowitz, S. (1985). *Daylighting Simulation in DOE-2: Theory, Application, Validation and Applications*. LBL-19829, Lawrence Berkeley Laboratory, Berkeley, California. <http://simulationresearch.lbl.gov/dirpubs/19829.pdf>.

# **Pacific Northwest National Laboratory**

902 Battelle Boulevard  
P.O. Box 999  
Richland, WA 99354  
1-888-375-PNNL (7665)

***[www.pnnl.gov](http://www.pnnl.gov)***